

CULMI



**Culmi Air-Cond &
Refrigeration Parts Supply Sdn Bhd**

トルケム

Moisture Control SOLVENT GS 836


Use for refrigerants R12, R22, R134a, R404a, R410a.
Add directly into the air-cond condenser
system, capillary tube or copper of
refrigerants for moisture control,
degreasing & cleaning purposes.



トルケム

Moisture Control SOLVENT GS 836

Use for refrigerants R12, R22, R134a, R404a, R410a.
Add directly into the air-cond condenser
system, capillary tube or copper of
refrigerants for moisture control,
degreasing & cleaning purposes.

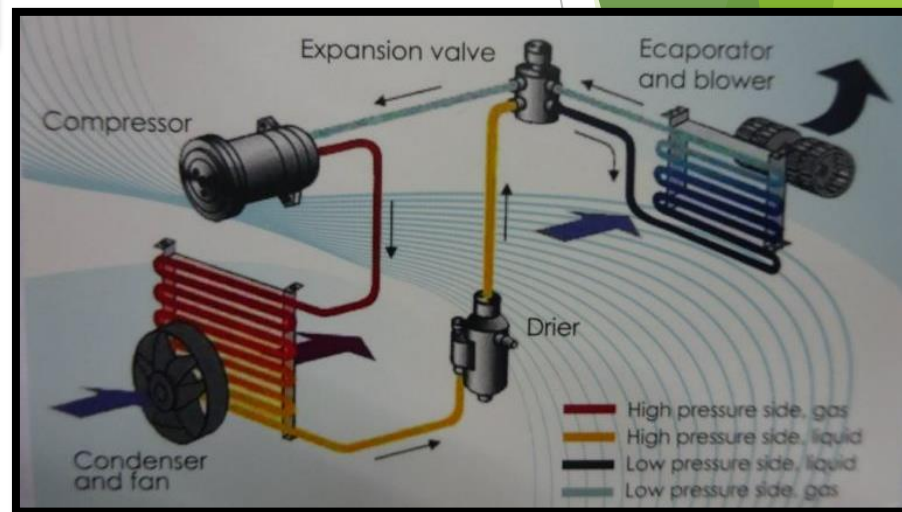

Necessity of Cycle Cleaning

Case 1 Replacing a burnt compressor,

Case 2 Replacing an A/C or
refrigeration system by
utilizing the existing pipes,

Impurities, deteriorated oil,
metal scrap, and swarf will
remain in the system and
the connection tubes.

There will be a high
possibility of impurities and
deteriorated oil adhering to
the inside of the tubes.

If the system is used
further, there will be a
high possibility of
clogging the capillary
tubes and breaking the
compressor causing
system damage.

It is necessary to clean
the system and the
pipes.