

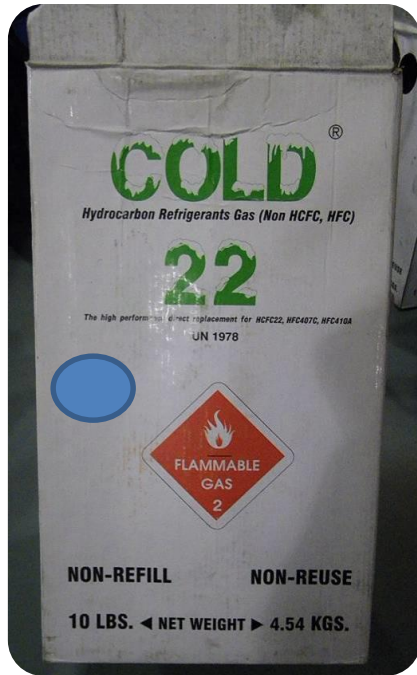


CULMI AIR-COND & REFRIGERATION PARTS SUPPLY SDN BHD

COLD 22 Hydrocarbon Refrigerant Replacement Performed With The Involvement Of:
m/s CULMI Air-Cond (Refrigerant Recovery Machine & Related Equipment Supplier)
m/s Ambang Wira Sdn Bhd (COLD 22 Replacement Contractor)

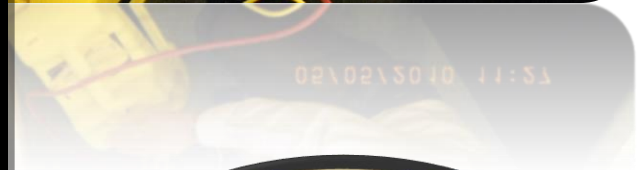


CULMI AIR-COND & REFRIGERATION PARTS SUPPLY SDN BHD

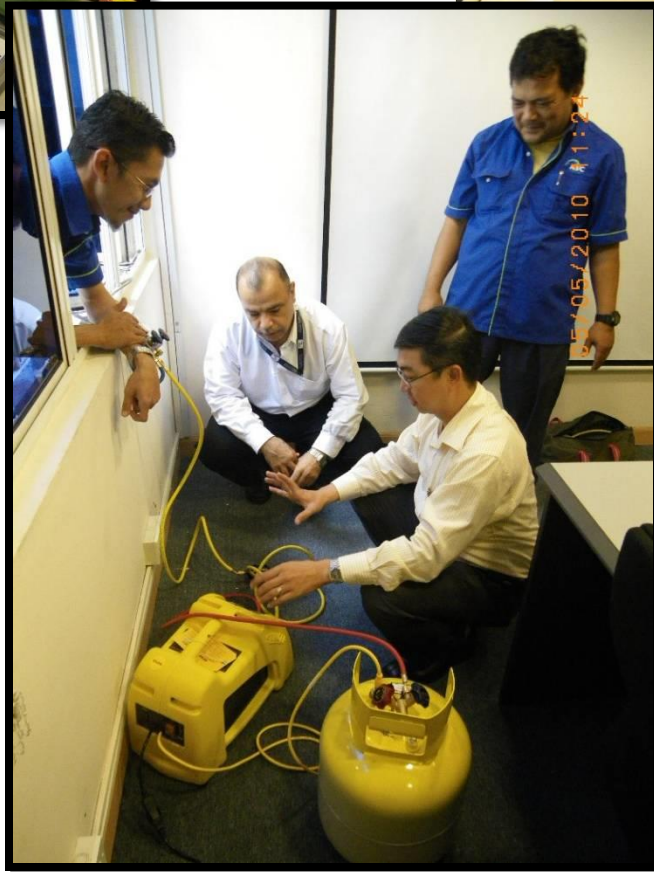

CULMI AIR-COND & REFRIGERATION PARTS SUPPLY SDN BHD

COLD 22 Hydrocarbon Refrigerant Replacement – Process : R22 Refrigerant Recovery

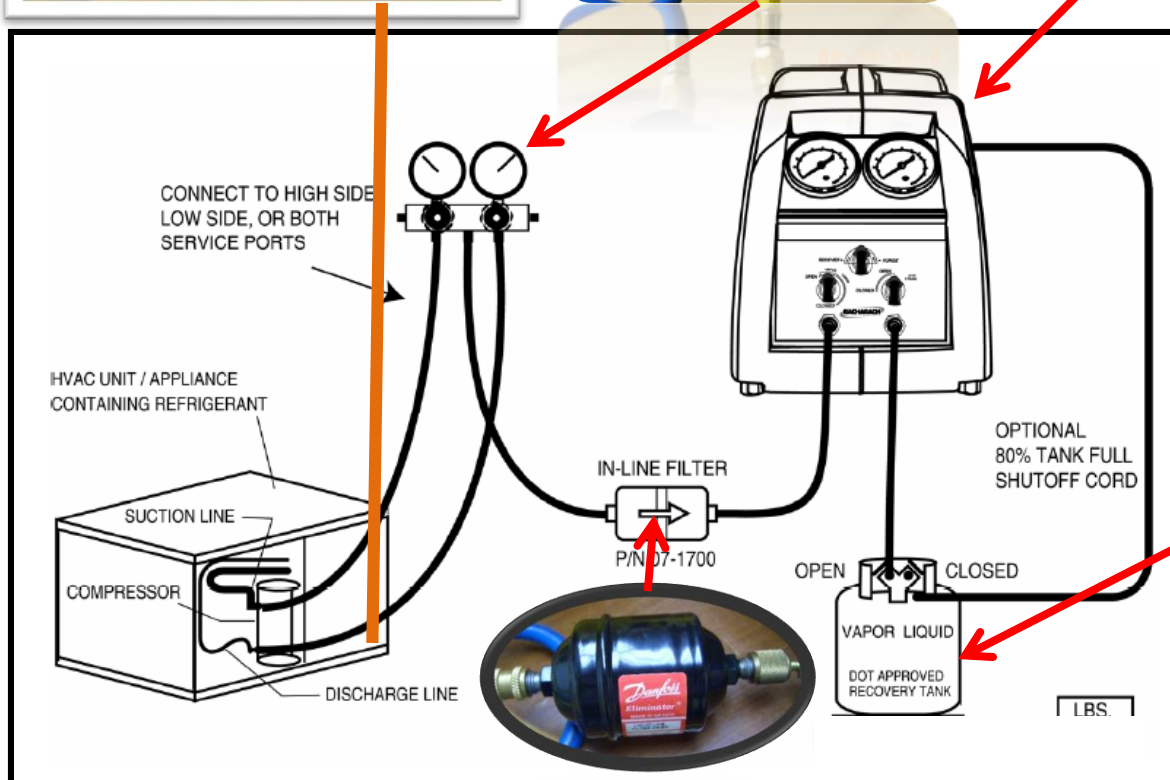


CULMI AIR-COND & REFRIGERATION PARTS SUPPLY SDN BHD

Cold 22 Hydrocarbon Refrigerant Replacement – Process : System Vacuuming



Vacuuming Time:

- 1) 1.0~3.0 HP Air-Cond Units : 30 minutes
- 2) 4.0~6.0 HP Air-Cond Units : 45 minutes
- 3) 7.5~15 HP Air-Cond Units : 1 hour

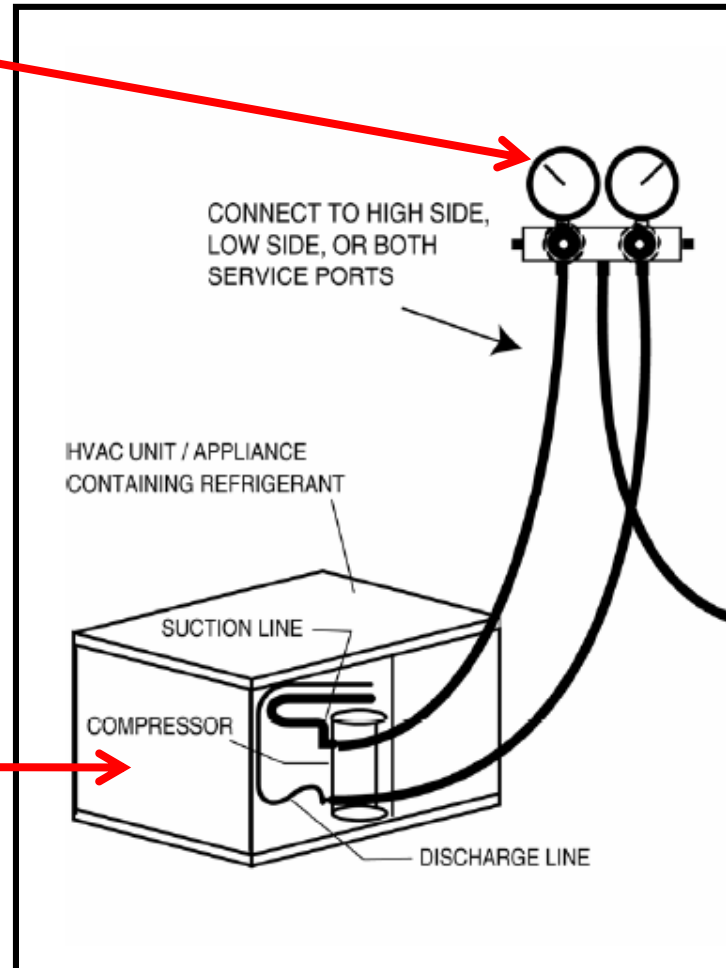

CULMI AIR-COND & REFRIGERATION PARTS SUPPLY SDN BHD

COLD 22 Hydrocarbon Refrigerant Replacement – Process : Hydrocarbon Charging

Hydrocarbon Amount:



1) 45% of R22 Refrigerant



COLD 22



**No
smoking**

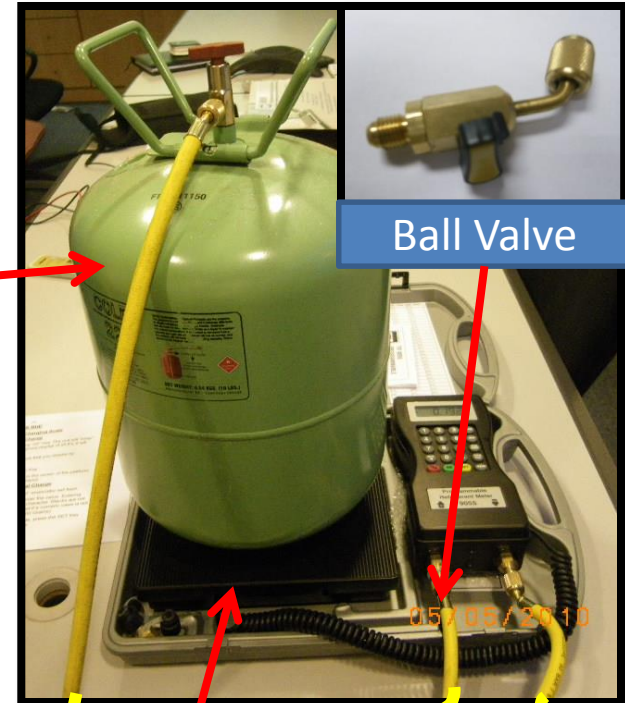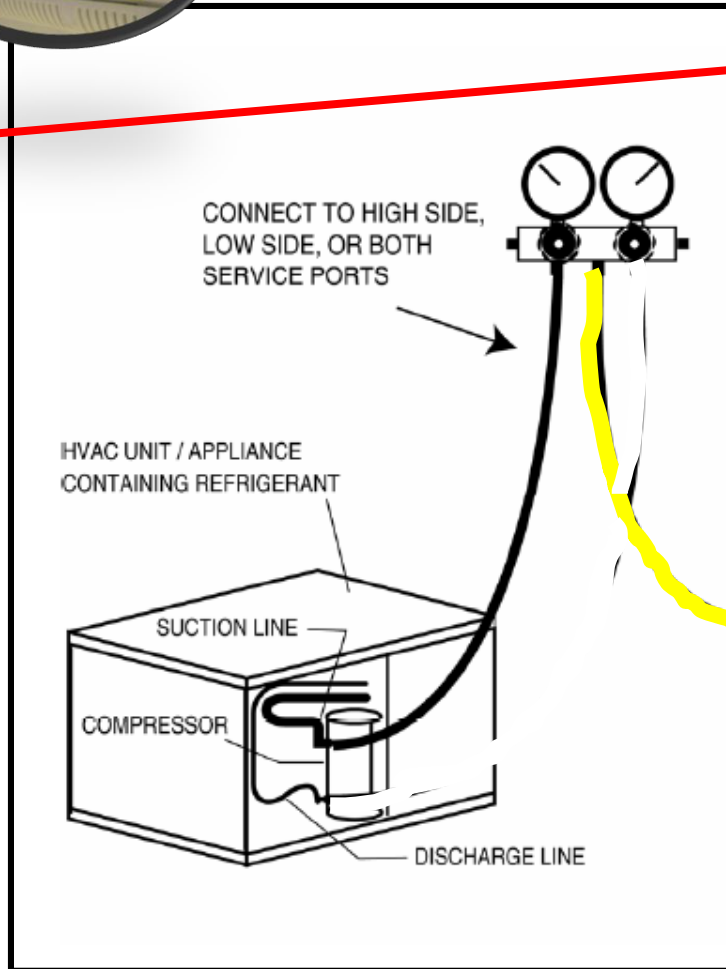

Ball Valve



Programmable Charging Scale