


## Shihlin EC Series to Panasonic PLC

### q. **Panasonic** Series

HMI communication device setting: Panasonic-FP

Configuration for the RS-232 connection:

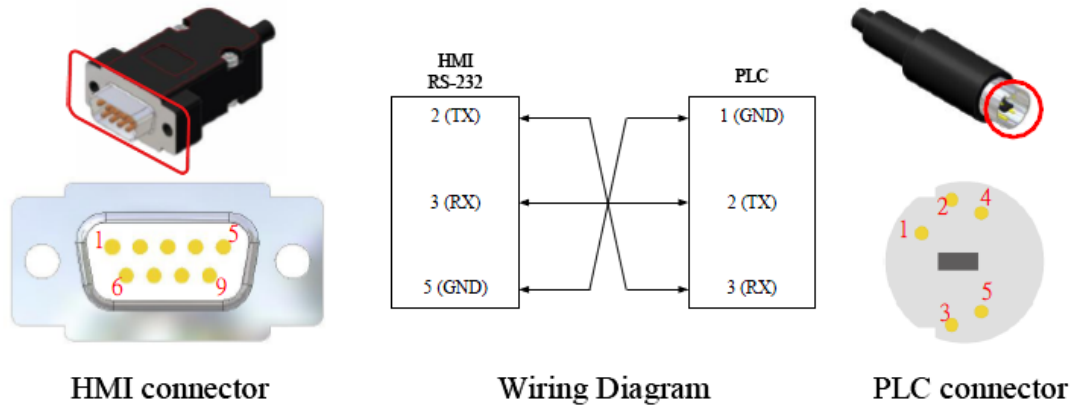

The following table lists Panasonic-FP Series parameter settings. Users can set parameters according to test requirements:

Type	Baud rate (Bps)	Parity	Data bit	Stop bit	PLC station
FP0	9600	Odd	8	1	N/A
FP0R					
FP-e					
FPE					
FP-X	19200	Odd	8	1	N/A
FP2	115200				