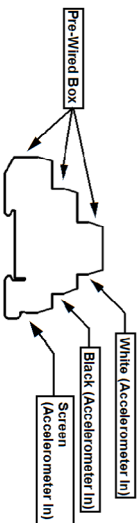


Typical Connection Details For HS-CExxx-xx Series Enclosures

Connection Label

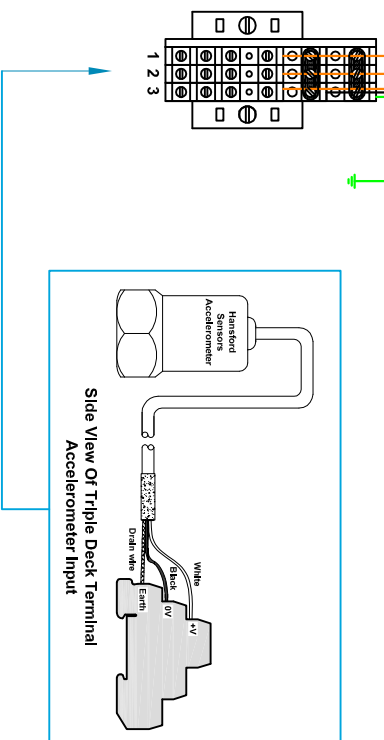
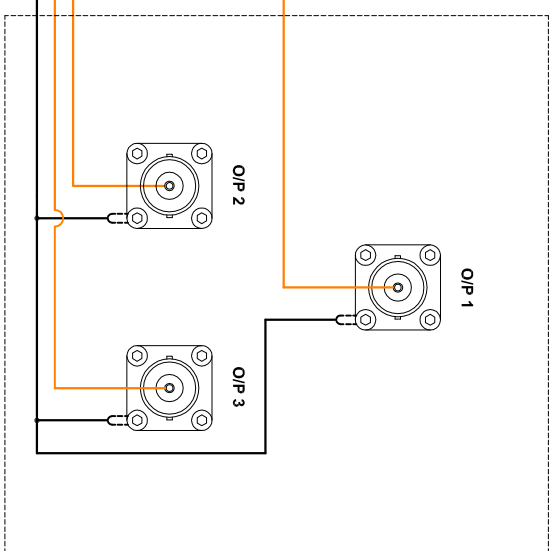
Connection Details for Accelerometer Input





Note: Please consider grounding implications when connecting the screen

Side View Of Triple Deck Terminal

This label can be found on the inside of the door or on the back of the connection panel



BNC Connectors for Taking Reading via the Data Collector

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	 <p>Hansford Sensors Ltd Excellence In Vibration Monitoring Artisan, Hillbottom Road Sands Industrial Estate High Wycombe Bucks HP12 4HJ</p>	 <p>Do Not Scale</p>	Description: HS-CExxx-xx Series Enclosure Wiring Details for a Painted Steel or Stainless Steel Enclosure Drawing No: CD168	Scale: 2 : 1 Sheet: 1 of 1	Form Number: QF024 Issue 3
A	Release	01/02/17	MJS	SRB	Tolerances Unless Stated 0 or 0.0 ±0.5 0.00 ±0.15 Angle ±5°					
1	2	3	4	5	6	7	8			