Galltec Mess- und Regeltechnik GmbH

D-71145 Bondorf · Germany Tel. +49 (0)7457-9453-0 · Fax +49 (0)7457-3758 E-Mail: sensoren@galltec.de Internet:www.galltec-mela.de

MELA Sensortechnik GmbH

D-07987 Mohlsdorf-Teichwolframsdorf · Germany Tel. +49(0)3661-62704-0 · Fax +49(0)3661-62704-20 E-mail:mela@melasensor.de · Internet: www.galltec-mela.de





Product info sheet Room humidistat

Hygroswitch Hygroswitch-i

Type Survey

Туре	Product No.	Type of contact
Hygroswitch	4204201K	changeover contact: max. 5A, with adjusting knob
Hygroswitch-i	4204201L	changeover contact: max. 5A, with internal scale
Hygroswitch	4204701K	changeover contact (gold plated): 1100 mA
Hygroswitch-i	4204701L	changeover contact (gold plated): 1100 mA, with internal scale

Description of the hygrostat

The humidity measuring element which is manufactured by Galltec under the name Polyga®, consists of several plastic fabric bands each with 90 individual fibres with a diameter of 3 µm each. The fibres are provided with hygroscopic characteristics by a special process. The measuring element adsorbs and desorbs moisture. The effect, swelling predominantly in longitudinal direction, is transmitted via a lever system to a microswitch with a small switching distance. The measuring element responds to the change in air humidity. It is possible to adjust the lever system by setting the adjustment knob so that the microswitch is actuated when the set air humidity is reached

The fan shaped measuring element is accomodated inside the housing and must be protected against coarse dust, dirt and water. The humidistats are designed for pressureless systems. The installation location must be selected so that condensed water cannot enter the inside of the housing. The installation position preferably with ventilation slots at rightangles to wind direction.

Application

The room humidistat Hygroswitch is an on-off controller to control the relative air humidity. It is used to control air humidifying and dehumidifying in offices and computer rooms. Other areas of use are storage of foodstuffs and luxury foods, cooling rooms for fruit and vegetables, greenhouses for gardening use, the textile industry, the paper and printing industry, the film industry and hospitals

In the case of the room humidistat Hygroswitch-i the external adjustment knob is replaced with an adjustment wheel with a scale inside the housing. The adjustment wheel needs to be aligned to the red mark.

Notes on voltage

The measurement location of the humidity controller should be selected such that there is no build-up of condensate on or in the device. This applies particularly for operation with a voltage higher than 48V. If the voltage is higher, there is a risk of voltage arcing in the event of water condensation on the microswitch or connecting terminals which might destroy the controller. In the case of voltage below 48V, the humidity controller can be used up to 100%rh.

Technical Data

measuring element Polyga®-measuring element, water resistent control range 40...90%rh breaking capacity

max. 250VAC and

0.1 ... 5A ohmic load for dehumidifying

0.1 ... 2A ohmic load for humidifying

0.1 ... 1A for inductive load (power factor >0.8)

lifetime > 6.000 breaking cycles

Please observe the notes on voltage.

optional microswitch with gold contact

breaking capacity

max. 48 VAC and

1...100 mA

	0 0000
allowable operating temperature	00 U60°C
allowable storage temperature	4060°C
air-speed	
installation altitude	. ≤ 4.000m above sea level
influence of temperature	
ref. to 23 °C	≤ +/- 0.2 % r.h. / K
typ. response time t_{50} at v=2m/s.	1.2min
electrical contacting	connecting terminals
applied directives / standards	

low-voltage directive 2014/35/EU

EMC directive 2014/30/EU

DIN FN 60730-1:2012-10

DIN EN 00730-1.2012-10	
DIN EN 60730-2-13:2008-09	
action	1.C.L
rated impulse voltage	4 kV
ball indentation test for temperature .	92°C
protective system	IP30D
degree of pollution	2
dimensions	. approx. 81x81x28 mm
independently mounted sensing conf	trol
installation	wall mounting
weight	approx. 58 g
_	• • • • • •


Opening the housing




Apply a flat-headed screwdriver at the top in the locking slot and press inwards until the housing springs open.

This information is based on current knowledge and is intended to provide details of our products and their possible applications. It does not, therefore, act as a guarantee of specific properties of the products described or of their suitability for a particular application. It is our experience that the equipment may be used across a broad spectrum of applications under the most varied conditions and loads. We cannot appraise every individual case. Purchasers and/or users are responsible for checking the equipment for suitability for any particular application. Any existing industrial rights of protection must be observed. The perfect quality of our products is guaranteed under our General Conditions of Sale. Issue: September 2016 Hygroswitch_e. Subject to modifications.

Connection diagram

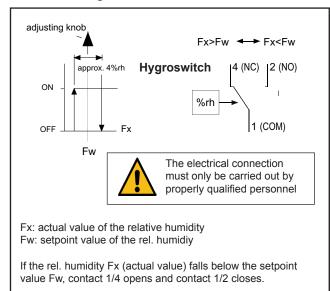

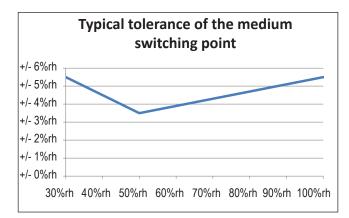

1-point-adjustment at 48 % r.h. / 23 °C Long-term drift: ≤ ±1%r.h. p.a.

Typical switching differential with typical tolerance

Setpoint value humidity	Switching differential	Tolerance	
50 % r.h.	5 % r.h.	+/- 1,5 % r.h.	
60 % r.h.	4 % r.h.	+/- 1,5 % r.h.	
70 % r.h.	4 % r.h.	+/- 1,5 % r.h.	
80 % r.h.	3 % r.h.	+/- 1 % r.h.	
90 % r.h.	3 % r.h.	+/- 1 % r.h.	


Physical influence of temperature on the relative air humidity

at a temperature fluctuation of ±1°C referred to various room temperatures.

•					
	10°C	20°C	30°C	50°C	
10%rh	+/-0.7%rh	+/-0.6%rh	+/-0.6%rh	+/-0.5%rh	
50%rh	+/-3.5%rh	+/-3.2%rh	+/-3.0%rh	+/-2.6%rh	
90%rh	+/-6.3%rh	+/-5.7%rh	+/-5.4%rh	+/-4.6%rh	

It is thus of extreme importance that the temperature is constant for measurements of the relative air humidity. The air must be homogenous.

Dimensions diagram

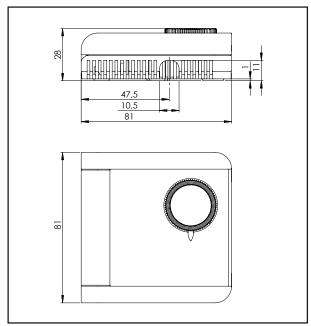

Mounting

has to be carried out by properly qualified personnel

- The humidistat must not come into direct contact with water, e.g. splashed water when cleaning the climatic chamber etc.
- * The mounting location should be chosen so that a representative measurement of the air humidity can be guaranteed, i.e. the humidity readings at the mounting location should correspond to those in the room as far as possible.
- * The humidistat should be exposed to the flow of air.
- * When mounting the humidistat on a patress, avoid external air getting onto the humidity measuring element of the humidistat by sealing it appropriately.

Cleaning instruction

1. Disconnect the device from the power supply

2. Remove the cover. Clean the cord shaped measuring element using a soft brush and clean water. Do not use a detergent as it cannot be dispersed.

It is important that no water is allowed to get onto the other components, particularly microswitches, terminals or printed circuit boards.

2. Air drying. Do not use warm or hot air (hair dryer).

Maintenance

The measuring element is maintenance-free in pure ambient air. Aggressive media containing solvent can cause measuring errors depending on the type and concentration. Deposits which eventually form a water-repellent film over the measuring element are harmful (such as resin aerosols, lacquer aerosols, smoke deposits etc.).

Contact with the inner parts of the humidistat nullifies the warranty.