

HFE35

MINIATURE 3-PHASES RELAY



Features

- 3-phases latching relay
- 100A switching capability at Res.load
- According to the fault current and electrical life test of IEC 62055-31: UC1, UC2, UC3 (please see below table and notes2)
- Heavy load up to 22.2kVA
- 4kV dielectric strength (between coil and contacts)
- Environmental friendly product (RoHS compliant)
- Outline Dimensions: (128.0 x 30.5 x 34.5) mm

CONTACT DATA

Contact arrangement	3U, 3V
Contact resistance	Typ.:0.35mΩ max. (at 100A) ¹⁾
Contact material	AgSnO ₂
Contact rating (Res. load)	100A 220VAC
Max. switching voltage	440VAC
Max. switching current	100A
Max. switching power	22000VA
Mechanical endurance	1 x 10 ⁵ OPS

Notes: 1) Typical value: Sampling quantity for contact resistance shall not less than 20 pcs, take the average value from 5 continuous measurements for each sample.

CHARACTERISTICS

Insulation resistance		1000MΩ (at 500VDC)
Dielectric strength	Between coil & contacts	4000VAC 1 min
	Between open contacts	2000VAC 1 min
Creepage distance		8mm
Set time (at nomi. volt.)		30ms max.
Reset time (at nomi. volt.)		30ms max.
Shock resistance	Functional	98m/s ²
	Destructive	980m/s ²
Vibration resistance		10Hz to 55Hz 1.5mm DA
Humidity		5% to 85% RH
Ambient temperature		-40°C to 75°C
Termination		QC
Unit weight		Approx.300g
Construction		Dust protected

Notes: The data shown above are initial values.

COIL

Coil power	Single coil latching: Approx. 5W
	Double coils latching: Approx. 10W

COIL DATA

at 23°C

Nominal Voltage VDC	Pick-up Voltage VDC max.	Pulse Duration ms min.	Coil Resistance x (1±10%) Ω	
6	4.8	100	Single coil latching	4.5
9	7.2	100		10
12	9.6	100		18
24	19.2	100		72
48	38.4	100		288
6	4.8	100	Double coils latching	2.25+2.25
9	7.2	100		5+5
12	9.6	100		9+9
24	19.2	100		36+36
48	38.4	100		144+144

Notes: When requiring other nominal voltage, special order allowed.

ELECTRICAL ENDURANCE

UC Class	Voltage (Uc)	Current (Ic)	Power Factor	Close Open time (s)	Electrical endurance (OPS)	
415 (UC1)	220VAC	80A	COSØ=1	10:20	3000	Total:6000
		10A	COSØ=0.4		3000	
416 (UC2)		80A	COSØ=1		5000	Total:10000
			COSØ=0.5		5000	
417 (UC3)	100A		COSØ=1	5000	Total:10000	
			COSØ=0.5	5000		

Notes: 1) Electrical endurance meet IEC62055-31 test requirement, do the inductive load test after the resistive load test.

2) Only some typical ratings of UC are listed above, if more special ratings required, please contact us.

ORDERING INFORMATION

Type	HFE35	12	-3D	T	2	-R	(XXX)
Coil voltage	6, 9, 12, 24, 48VDC						
Contact form ¹⁾	3SD: 3 Form B (Double-contact) 3SH: 3 Form A (Double-contact)						
Contact material	T: AgSnO ₂						
Sort	1: Single coil latching		2: Double coils latching				
Polarity	R: Negative polarity		Nil: Positive polarity				
Special code ^{2) 3)}	XXX: Customer special requirement						

Notes: 1) 3H, 3SH means that relay is on the "reset" status when delivery; 3D, 3SD means that relay is on the "set" status when delivery. If no special requirement by customer, we will keep the relay on the "set" status when delivery.

2) Please make clear your technical requirements, and choose from the following 3 UC ratings:

UC1: meet the UC1 requirements on IEC62055-31: Carrying test 3000A peak current for 10ms;

UC2: meet the UC2 requirements on IEC62055-31: Making test:2.5KA/10ms, carrying test 4.5KA/10ms;


UC3: meet the UC3 requirements on IEC62055-31: Making test:3KA/10ms, carrying test 6KA/10ms.

3) The customer special requirement express as special code after evaluating by Hongfa. e.g. (415) stands for UC1; e.g. (416) stands for UC2; e.g. (417) stands for UC3.

OUTLINE DIMENSIONS, WIRING DIAGRAM

Unit: mm

Outline Dimensions

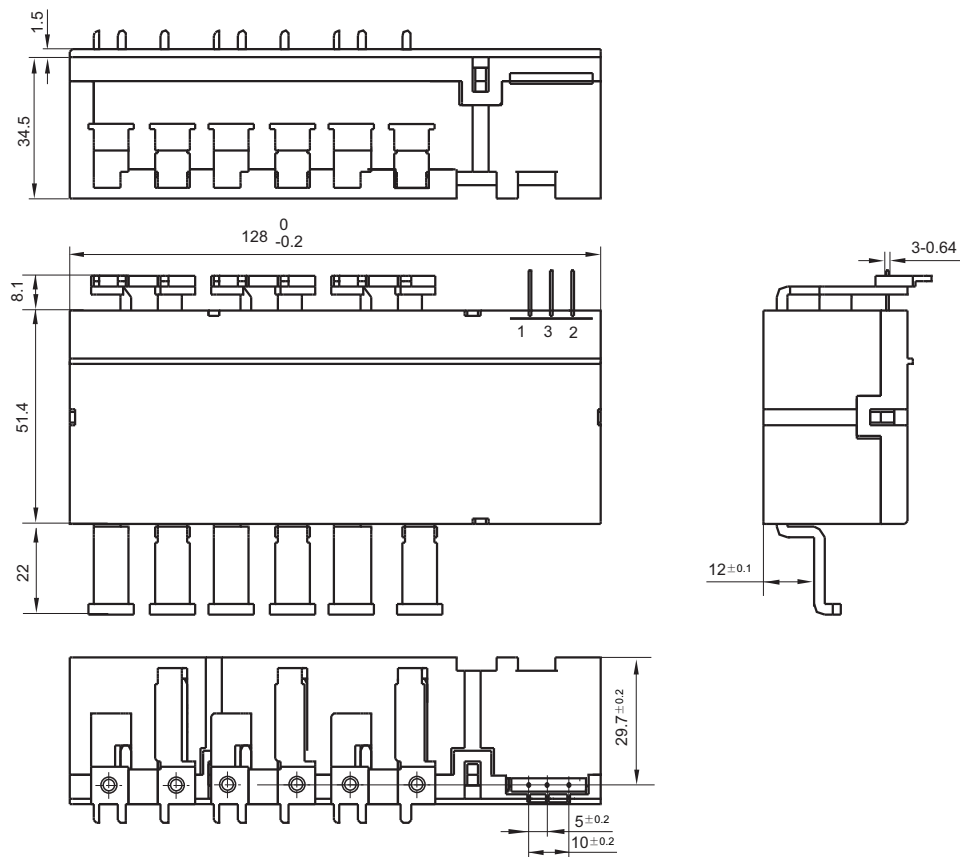


Remark: In case of no tolerance shown in outline dimension: outline dimension $\leq 1\text{mm}$, tolerance should be $\pm 0.1\text{mm}$; outline dimension $> 1\text{mm}$ and $\leq 5\text{mm}$, tolerance should be $\pm 0.2\text{mm}$; outline dimension $> 5\text{mm}$, tolerance should be $\pm 0.4\text{mm}$.

Coil Wiring Diagram

Positive polarity

Negative polarity

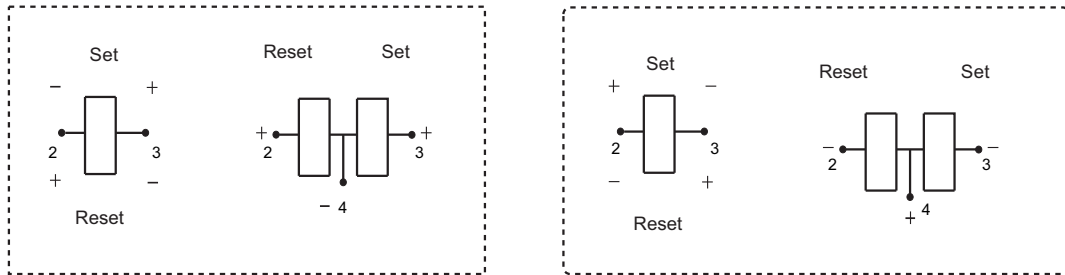

Notice:

1. Relay is on the "reset" or "set" status when being released from stock, with the consideration of shock risen from transit and relay mounting, relay would be changed to "set" or "reset" status, therefore, when application (connecting the power supply), please reset the relay to "set" or "reset" status on request.
2. In order to maintain "set" or "reset" status, energized voltage to coil should reach the rated voltage, impulse width should be 5 times more than "set" or "reset" time. Do not energize voltage to "set" coil and "reset" coil simultaneously. And also long energized time (more than 1 min) should be avoided.
3. The terminals of relay without twisted copper wire can not be tin-soldered, can not be moved willfully, more over two terminals can not be fixed at the same time.
4. Relays used for metering measuring applications are usually made with dust proof structure, while most relays could be made specially per customer's specific requirements. No longer than 6 months' storage time is recommended for this kind of relay, and please pay attention to the storage environment. To ensure contact reliability, we will keep contact status be closed when delivery if no special required by customer.

Disclaimer

The specification is for reference only. Specifications subject to change without notice.

We could not evaluate all the performance and all the parameters for every possible application. Thus the user should be in a right position to choose the suitable product for their own application. If there is any query, please contact Hongfa for the technical service. However, it is the user's responsibility to determine which product should be used only.

© Xiamen Hongfa Electroacoustic Co., Ltd. All rights of Hongfa are reserved.