
Features

- Multi-channel (4 channel/ 2 channel) simultaneous controlling
- Transmit 2-channels of real-time temperature data to PCs
- Record and monitor temperature using DAQ Master (comprehensive device management software)
- USB-powered device with USB communication interface (Modbus RTU)
- Supports various types of input (thermocouple, RTD, mA, V) and different sensors can be assigned to each channel.
- Easy wiring with plug/socket type terminal
- · Compact, space-saving design
- DIN rail or screw mount









Comprehensive Device Management Program (DAQMaster)

- DAQMaster is comprehensive device management program for convenient management of parameters and multiple device data monitoring.
- Visit our website (www.autonics.com) to download user manual and comprehensive device management program.

< Computer specification for using software >

| Item | Minimum requirements |
|------------|--|
| System | IBM PC compatible computer with Intel Pentium III or above |
| Operations | Microsoft Windows 98/NT/XP/Vista/7/8/10 |
| Memory | 256MB+ |
| Hard disk | 1GB+ of available hard disk space |
| VGA | Resolution: 1024×768 or higher |
| Others | RS-232 serial port (9-pin), USB port |

< DAQMaster screen >




H-10 **Autonics**

Specifications

| Model | | SCM-USU2I | | |
|----------------|---------------------|--|--|--|
| Power supply | | USB BUS POWER (5VDC) | | |
| Permissible | voltage range | 90 to 110% of rated voltage | | |
| Communica | tion method | USB | | |
| Protocol | | Modbus RTU | | |
| Display met | hod | Check via PC Software (DAQMaster) | | |
| | RTD | DPt100 Ω , DPt50 Ω , JPt100 Ω , Cu100 Ω , Cu50 Ω , Nickel120 Ω | | |
| Input type | Thermocouple | K(CA), J(IC), E(CR), T(CC), B(PR), R(PR), S(PR), N(NN), C(TT), G(TT), L(IC), U(CC), Platinel II | | |
| put typo | Analog | Voltage: -60-60mV, 0-200mV, 0-1V, 1-5V, 0-5V, 0-10V Current: 0-20mA, 4-20mA | | |
| | RTD | •At room temperature range (23°C±5°C) : (PV ±0.3% or ±1°C, select the higher one) ±1-digit | | |
| Display | Thermocouple | ●Out of room temperature range : (PV ±0.5% or ±2°C, select the higher one) ±1-digit | | |
| accuracy*1 | Analog | •At room temperature range (23°C±5°C): ±0.3% F.S. ±1-digit •Out of room temperature range: ±0.5% F.S. ±1-digit | | |
| Sampling cy | rcle | 50ms (2-CH simultaneous sampling) | | |
| Dielectric str | rength | 500VAC 50/60Hz for 1 min. (between input terminal and power terminal) | | |
| Vibration | | 0.75mm amplitude at frequency of 5 to 55Hz (for 1 min.) in each X, Y, Z direction for 2 hours | | |
| Shock | | 500m/s² (approx. 50G) in each X, Y, Z direction for 3 times | | |
| Insulation re | sistance | Min. 100MΩ (at 500VDC megger) | | |
| Memory rete | ention | Approx. 10 years (when using non-volatile semiconductor memory type) | | |
| Environ- | Ambient temperature | -10 to 50°C, storage: -20 to 60°C | | |
| ment | Ambient humidity | 35 to 85%RH, storage: 35 to 85%RH | | |
| Protection s | tructure | IP20 (IEC standard) | | |
| Insulation ty | ре | Double insulation or reinforced insulation | | |
| Installation | | DIN rail or panel mounting | | |
| Accessory | | USB 2.0 AB type cable: 1 (length: 1m) | | |
| Approval | | C€ № | | |
| Weight**2 | | Approx. 195g (approx. 140g) | | |

- •Below -100°C of thermocouple K, J, T, N, E, and L, U, PLII, RTD Cu50 Ω , DPt50 Ω
- : (PV ±0.3% or ±2°C, select the higher one)±1-digit
- •Below 200°C of thermocouple C, G and R, S
- : (PV ±0.3% or ±3°C, select the higher one)±1-digit
- •Below 400°C of thermocouple B does not have accuracy standard.
- Out of room temperature range
- •RTD Cu50Ω, DPt50Ω: (PV 0.5% or ±3°C, select the higher one)±1-digit
- •Thermocouple R, S, B, C, G, L, U: (PV ±0.5% or ±5°C, select the higher one)±1-digit
- •Below -100°C of other sensors: within ±5°C
- X2: The weight includes packaging. The weight in parentheses is for unit only.
- XEnvironment resistance is rated at no freezing or condensation.

■ Connections And Block Diagram

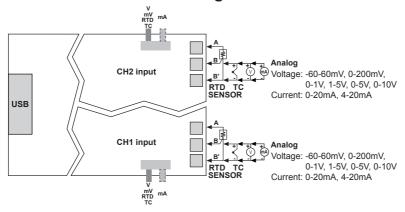

 $\ensuremath{\mathbb{X}}$ Input parts and USB cable connection part are insulated each other.

(A) Photoelectric Sensors

(B) Fiber Optic

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/

(H) Temperature Controllers

(I) SSRs / Power Controllers

> (J) Counters

Meters

Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers


(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

Autonics H-11


■ Dimensions (unit: mm)

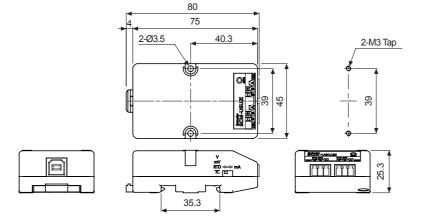

Installation

Mounting & Removing the unit on DIN rail


- Mounting
 - 1) Hook DIN rail connector on to DIN rail.
- 2) Push the unit down to the direction "①".
- Removing
- 1) Pull the rail lock of the unit to the direction "②".
- 2) Remove the unit by pulling to the direction "3".



Mounting the unit to panel

- 1) The unit is able to mount on the panel with two mounting holes.
- 2) For mounting this unit to panel, use M3 screws. Tightening torque is 0.4N.m.


Use long fixing screws and several units are fixed by stacking as multi-layer.



| Number of layers(N) | 'A' (23N+0.5) | 'B' (23N-3) |
|---------------------|------------------|----------------|
| 1 | 23.5mm | 20mm |
| 2 | 46.5mm | 43mm |
| 3 | 69.5mm | 66mm |
| 4 | 92.5mm | 89mm |

H-12 Autonics

Unit Description



1. Mounting hole:

Used when the unit mounts to the panel.

2. Power indicator (red):

Turns ON the power indicator (red) when supplying the power.

Used when the unit mounts on DIN rail.

4. Input type selector:

Input type selector by each CH. The left selector is for CH1 and the right one is for CH2 in the face.

V, mV, RTD, TC ← ► mA (default)

- 5. CH1 connector
- 6. CH2 connector

■ Input Sensor Type And Temperature Range

| | | · • | <u> </u> | | | |
|---------------|-------------|----------|-----------|------------------------------|---------------------------------------|--|
| Input type | | | Display | Temperature range (°C) | Temperature range (°F) | |
| | K (CA) | | K (CA).H | -200 to 1350 | -328 to 2462 | |
| | | | K (CA).L | -200.0 to 1350.0 | -328.0 to 2462.0 | |
| | 1 (10) | | J (IC).H | -200 to 800 | -328 to 1472 | |
| | J (IC) | | J (IC).L | -200.0 to 800.0 | -328.0 to 1472.0 | |
| | E (CR) | | E (CR).H | -200 to 800 | -328 to 1472 | |
| | E (CR) | | E (CR).L | -200.0 to 800.0 | -328.0 to 1472.0 | |
| | T (CC) | | T (CC).H | -200 to 400 | -328 to 752 | |
| | T (CC) | | T (CC).L | -200.0 to 400.0 | -328.0 to 752.0 | |
| | B (PR) | | B (PR) | 0 to 1800 | 32 to 3272 | |
| Thermo-couple | R (PR) | | R (PR) | 0 to 1750 | 32 to 3182 | |
| | S (PR) | | S (PR) | 0 to 1750 | 32 to 3182 | |
| | N (NN) | | N (NN) | -200 to 1300 | -328 to 2372 | |
| | C (TT)*1 | | C (TT) | 0 to 2300 | 32 to 4172 | |
| | G (TT)**2 | | G (TT) | 0 to 2300 | 32 to 4172 | |
| | 1 (10) | | L (IC).H | -200 to 900 | -328 to 1652 | |
| | L (IC) | | L (IC).L | -200.0 to 900.0 | -328.0 to 1652.0 | |
| | U (CC) | | U (CC).H | -200 to 400 | -328 to 752 | |
| | | | U (CC).L | -200.0 to 400.0 | -328.0 to 752.0 | |
| | Platinel II | | PLII | 0 to 1390 | 32 to 2534 | |
| | Cu50Ω | | CU50 .L | -200.0 to 200.0 | -200.0 to 392.0 | |
| | Cu100Ω | | CU100 .L | -200.0 to 200.0 | -200.0 to 392.0 | |
| | JPt100Ω | | JPt100.H | -200 to 600 | -328 to 1112 | |
| RTD | | | JPt100 .L | -200 to 600.0 | -328.0 to 1112.0 | |
| עוט | DPt50Ω | | DPt50 .L | -200 to 600.0 | -328.0 to 1112.0 | |
| | DD#1000 | | DPt100.H | -200 to 600 | -328 to 1112 | |
| | DPt100Ω | | DPt100. L | -200.0 to 600.0 | -328 to 1112.0 | |
| | Nickel1200 | Σ | NI120.H | -80 to 200 | -112 to 392 | |
| | | 0-10V | AV1 | | | |
| | | 0-5V | AV2 | | | |
| | Voltage | 1-5V | AV3 | | | |
| \nalag | voltage | 0-1V | AV4 | -9999 to 9999 | | |
| Analog | | 0-200mV | AmV1 | (the display range varies de | pending on the decimal point setting. | |
| | | -60-60mV | AmV2 | | | |
| | 0 | 0-20mA | AmA1 | | | |
| | Current | 4-20mA | AmA2 | | | |

X1: C (TT): Same as existing W5 (TT).

X2: G (TT): Same as existing W (TT).

(A) Photoelectric Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(I) SSRs / Power Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors

(R) Graphic/ Logic Panels

■ Parameter Groups

1. Parameter 1 group

| Parameter | Display | Descriptions |
|-------------------------------------|--------------------------|--|
| Alarm output⊡ target CH | Alarm□ Target CH | Set the CH for monitoring by alarm. Setting range: CH1, CH2, CH1 or CH2, CH1 and CH2 |
| Alarm output⊡ mode ^{ж1} | Alarm□ Mode | Setting range : OFF, AL-1, AL-2 |
| Alarm output□ low-limit SV CH□ | Alarm□ Low_CH□ | Setting range : Refer to the 'lnput type and Temperature Range' |
| Alarm output□ high-limit SV CH□ | Alarm□ High_CH□ | *When changing alarm operation mode, alarm output high/low-limit SV is automatically reset as min./max. value which has no alarm. |
| Alarm output□ hysteresis CH□ | Alarm□ Hysteresis_CH□ | Set the hysteresis of alarm output. Setting range : 1 to 100 (000.1 to 100.0) |

※1: Alarm output mode

| Mode | Name | Operations | | Descriptions |
|------|------------------------------------|-------------------------------------|-------------------------------------|---|
| OFF | | _ | | No alarm output |
| AL-1 | Absolute value high-limit alarm | OFF ↓H ↑ ON A PV 90°C | OFF ↓H ON PV 110°C | Alarm output turns ON when PV is more than alarm absolute value. |
| | | Alarm absolute value: Sets 90°C | Alarm absolute value: Sets 110°C | |
| AL-2 | Absolute value low-limit alarm | ON H OFF PV 90°C | ON THU OFF PV 110°C | Alarm output turns ON when PV is lower than alarm absolute value. |
| | Alarm absolute value: Sets 90°C | Alarm absolute value: Sets 110°C | | |

[※]H: Alarm output hysteresis

2. Parameter 2 group

| Parameter | Display | Descriptions |
|--|-----------------------|--|
| CH□ input type | CH□ Input Type | Setting range: Refer to the '®Input type and temperature range'. |
| CH_ sensor temperature unit | CH_ Unit | °C↔°F ※Does not set in analog input. |
| CH□ low-limit input value | CH□ Low Range | Set the low-limit input value within analog input range. Setting range: min. range to {high-limit input value (CH□ High Range)-F.S. 10% digit}] |
| CH□ high-limit input value | CH□ High Range | Set the high-limit input value within analog input range. Setting range: {low-limit input value (CH□ Low Range)+F.S. 10% digit}] to max. range |
| CH□ decimal point place of scale value | CH□ Scale Dot | Within high/low-limit scale value, set the decimal point place for display value (PV). Setting range: 0, 0.0, 0.00, 0.000 |
| CH low-limit scale value | CH□ Low Scale | Set display scale for analog low-limit input value (CH Low Range). Setting range : -9999 to 9999 |
| CH□ high-limit scale value | CH□ High Scale | Set display scale for analog high-limit input value (CH□ High Range). Setting range : -9999 to 9999 |
| CH□ analog display unit | CH□ Digital Unit | For analog input, set the display unit. Setting range: °C, °F, %, OFF |
| CH□ input correction | CH□ Input Bias | Input correction is to correct deviation occurred from temperature sensor. **XAfter input correcting, when present value (PV) is over the temperature range of the sensor, HHHH or LLLL is displayed. Setting range: -999 to 999 (-999.9) |
| CH _□ input digital filter | CH□ Digital Filter | If the present value (PV) is fluctuating repeatedly by rapid change of input signal, stable recording is difficult. Input digital filter makes the present value stable. When input digital filter is set as 0.4 sec., input digital filter is applied for the input values for 0.4 sec. and the present value is may be different with the actual input value. Setting range: 0.1 to 120.0 (sec.) |

 $\times\square$: Enables to set in analog input.

H-14 Autonics

3. Parameter 3 group

| Parameter | Display | Descriptions | |
|------------------------------------|----------------------|--|--|
| Communication write enable/disable | | Parameter setting is enable or disable by software (DAQMaster) setting. (reading parameter set value (Read) is always possible.) Enable: Enables changing and writing by parameters Disable: Disables changing and writing by parameters | |
| Parameter reset | Parameter Initialize | Setting range : NO, YES | |

XParameters reset by changing the parameter

| Group | Parameter | Display | Reset parameters | |
|-------------------|-----------------------------|-------------|--|--|
| Parameter 1 group | Alarm output□ mode | Alarm□ Mode | Alarm□ High/Low_CH□ | |
| Parameter 2 | CH□ input type | | Alarm□ High/Low_CH□, CH□ Low/High Range, CH□ Scale Dot, CH□ Low/High Scale, CH□ Digital Unit, CH□ Input Bias | |
| | CH□ sensor temperature unit | CH□ Unit | Alarm□ High/Low_CH□, CH□ Input Bias | |

■ Troubleshooting

Displays at software (DAQMaster).

| Display | Description | Troubleshooting |
|----------|--|---|
| OPEN | Flashes if input is broken or disconnected. | Check input sensor status. |
| IHHHH | Flashes if present value is higher than the temperature range of the sensor. | When input is within the rated temperature range of the |
| 11 1 1 1 | Flashes if present value is lower than the temperature range of the sensor. | sensor, this display disappears. |

^{*}When error displays and input is connected or within the rated temperature range of the sensor, the error display disappears and the unit operates normally.

■ Factory Default

| Group | Parameter display | Factory default | Parameter display | Factory default |
|----------------------|----------------------|------------------------------------|-----------------------|-----------------|
| Parameter 1 group | Alarm□ Target CH | Alarm1/2 : CH1 Alarm3/4 : CH2 | Alarm□ High_CH□ | 1350 |
| | Alarm□ Mode | Alarm1/3 : AL-1 Alarm2/4 : AL-2 | Alarm□ Hysteresis_CH□ | 1 |
| | Alarm□ Low_CH□ | -200 | _ | <u> </u> |
| | CH□ Input Type | K (CA).H | CH□ Low Scale | 000.0 |
| | CH□ Unit | °C | CH□ High Scale | 100.0 |
| Parameter 2 group | CH□ Low Range | 000.0 | CH□ Digital Unit | % |
| 2 group | CH□ High Range | 100.0 | CH□ Input Bias | 0 |
| | CH□ Scale Dot | 0 | CH□ Digital Filter | 0.1 |
| Parameter 3 group | Communications Write | Enable | Parameter Initialize | NO |

(A) Photoelectric Sensors

(B) Fiber Optic

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels

Field Network Devices

(T) Software

Autonics H-15

Driver Installation

USB Driver Installation



- Visit our website (http://www.autonics.com) and download 'SCM-USU2I Driver'.
- 2) Unzip the downloaded file to the desired directory.
- 3) When connecting this product with an USB port, the 'Found New Hardware Wizard' appears automatically.

At 'Do you want to search software by connecting 'Window Update'?', click 'No' and the following dialog box appears to start Driver installation. Select 'Install from a list or specific location (Advanced)' and click 'Next'.




4) Select 'Search for the best driver in these locations' and 'Include this location in the search'.

Click 'Browse'.

5) The 'Browse Folder' dialog box appears. Select 'SCM-USU2I(AUTONICS) CDC USB to UART' and click 'Finish'. Click 'Next' to start the USB Driver installation.




6) The 'Hardware Installation' dialog box appears. Click 'Continue Anyway' to proceed with installation.



The following dialog box appears when the USB Driver is installed properly.

Click 'Finish'.





*Check that drivers are installed properly at 'Device Manager' after installing USB Driver and Serial Port Driver.

Select My Computer > Properties > Hardware tab > Device Manager.

Or select Start > Control Panel > System > Hardware tab > Device Manager.

Make sure that 'SCM-WF48 Driver(Autonics Corp)' is found and in 'Universal Serial Bus Controller' category and 'SCM-USU2I(AUTONICS) CDC USB to UART(COM5)' is found in 'Ports (COM and LPT)'.

(A) Photoelectric Sensors

(B) Fiber Optic

> (C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Sockets

(H) Temperature

Controllers

(I) SSRs / Power Controllers

Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers

(R) Graphic/ Logic Panels

(S) Field Network

(T) Softwar


Software

■ Functions

○ High/Low Scale [CH□ Low Scale/CH□ High Scale]


For analog input, this function is to set (-9999 to 9999) for particular high/low limit value in order to display high/low limit value of measurement input. If measurement inputs are 'a' and 'b' and particular values are 'A' and 'B', it will display a=A, b=B as below graphs.

*This Driver Installation shows the procedure for Windows XP. There might be some differences in the specification above depending on OS.



Display scale function is able to change display value for max./min. measured input by setting high limit scale [H - 5E] and low limit scale [L - 5E] in program mode.

XE.g.) Set high/low scale value (input range is 0 to 10V)

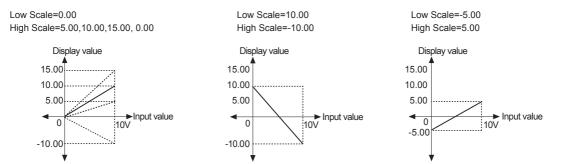

Autonics H-17

Proper Usage

O Caution during use

- When connecting PC with the unit, and changing PC USB port to another (changed) USB port, USB driver will be reinstalled. This is not unit malfunction.
- In case of connect PC with the several units, number of COM port will be numbered in order. This is not unit malfunction. (e.g.: COM14, COM15 ... COM256)
- When connecting PC with the unit via USB connector, check COM port number before communication. (This is not unit malfunction.)
- When connecting PC with the unit via USB cable, do not use the extension cable to extend USB cable length. It may cause malfunction.
- When connecting PC with the unit via USB hub which is external power supply type, external power must be supplied for normal operation.
- USB cable must be the dedicated specifications.
- When using USB cable over 3m, make sure the noise countermeasures.
- USB cable should not be broken or shorted. Check the cable before supplying the power.
- Check the connection is correct.
- Use the unit within the rated voltage range.
- For preventing inductive noise, the unit should be separated with high-voltage cable or power cable.
- Do not use the unit with the below environment.
 - · Place where severe vibration or shock is present
 - · Place where strong alkalis or acids are used
 - · Place where direct ray of the sun is present
 - Place where strong magnetic field or electric noise are generated
- Storage

Keep the unit -20 to 60°C, 35 to 85%RH with avoiding direct ray of light. It is recommended to keep the unit package as it is.

- This unit may be used in the following environments.
 - · It shall be used indoor.
 - Altitude up to 2,000m
 - Pollution degree 2
 - · Installation category I

H-18 Autonics