PRUDENTAIRE®

BG Bar Grille

MADE IN MALAYSIA

MEMBER

BG | Bar Grille

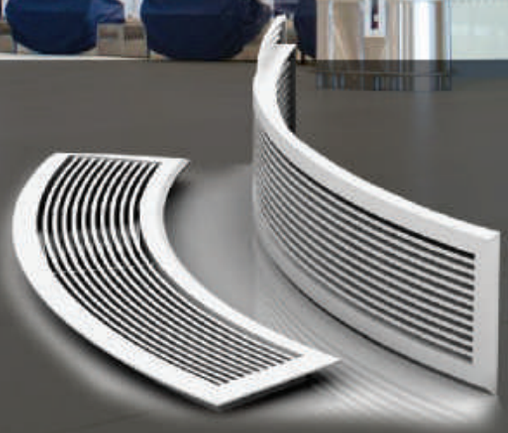

Introduction

Making use of the extruded vanes side profiles & angle of deflection, the Bar Grille is able to manipulate the airflow orientation and thus creating the desired flow profile. Depending on the model type, the grilles can be wall mounted and windowsill mounted. For standard model, the areodynamic free area of 53% (see-through area of >60%) can be further increased upon customer's request.

Available in highly customizable shape profile, the Bar Grille is one of the preferred choice for providing aesthestic value-added points. Thus Bar Grilles are commonly found in facilities such as offices, shopping centers, hotels and airports etc. for both supply and exhaust purposes.

CONSTRUCTIONS & MATERIALS

- 0° & 15° deflection configurations
- Customizable deflection angles
- Highly customizable shape profiles
- Optional removable core vanes
- Standard vanes pitch is 12mm
- Stainless Steel & Aluminium construction available

Frame Construction	Vanes Construction	Surface Finishing
AL 1.2mm	AL 6.0x1.8 mm	RAL 9010 SG
Extruded Aluminium	Extruded Aluminium	White (Matt) / Natural Anodised Customizable Colors



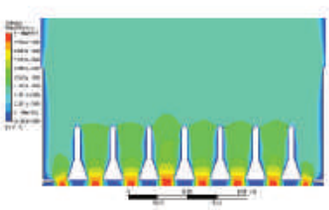

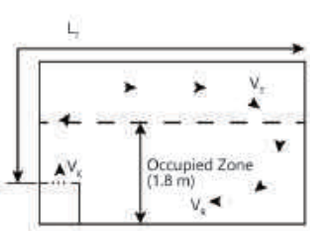

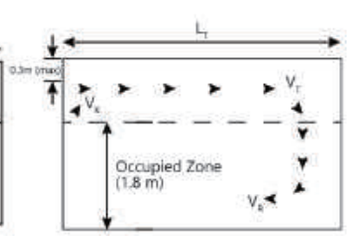

DIMENSIONS

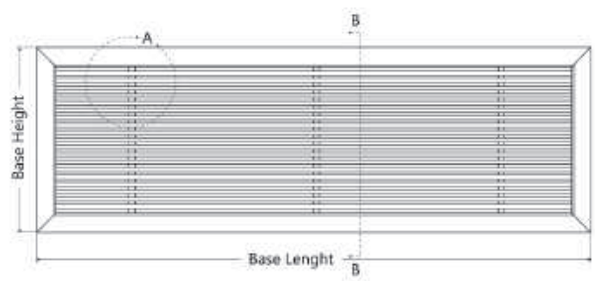

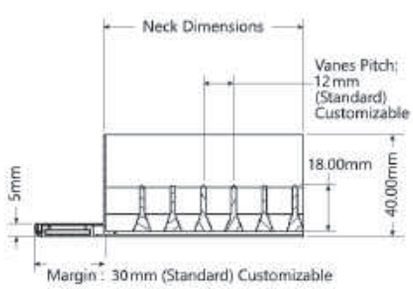

Correction Factors

Conditions	15° Deflection
Effective Area (m^2)	x 0.95
V_k	x 1.05
Pressure Lost (Pa)	x 1.0
NR	+0

PrudentAire®

Supply



* Diffuser performance data factored in Coanda effect & fully opened Radial OBD conditions.

* The effective area given is to the best estimation & knowledge of Prudentaire's engineers at the point of entry.

NR25 NR35 NR40 NR45

Grille Neck Size, mm	Neck Area (Eff. Area) m²	Unit Volume Flowrate, m³/hr Unit Volume Flowrate, l/s	250 70	300 84	400 112	500 140	600 168	800 224	1000 280	1400 392	1600 448
150 x 250	0.0375 (0.019)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	6.0 3.7 9.5 23	7.0 4.4 14 30	9.0 5.8 23 36	12 7.3 40 43	14 8.8 55 45	- - - -	- - - -	- - - -	- - - -
150 x 300	0.045 (0.023)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	5.5 3.0 7 25	6.2 3.6 10 27	8.5 4.8 16 34	11 6.0 27 37	13 7.2 40 42	17 9.7 65 >45	- - - -	- - - -	- - - -
150 x 400	0.06 (0.031)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	5.0 2.2 <4 23	6.0 2.7 5 25	8.0 3.6 9 32	9.5 4.5 14 36	11 5.4 22 38	16 7.2 40 45	- - - -	- - - -	- - - -
150 x 500	0.075 (0.038)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	5 2.2 <4 20	7 2.9 7 26	8.5 3.7 9.5 31	9.5 4.4 14 33	14 5.8 25 40	17 7.3 40 43	- - - -	- - - -
150 x 600	0.09 (0.047)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	6.0 2.4 <4 22	7.5 3.0 7 27	9.0 3.5 9 30	12 4.7 16 36	15 5.9 25 41	20 8.3 50 >45	- - - -
150 x 800	0.12 (0.063)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	6.8 2.2 <4 23	7.5 2.6 5 25	10.5 3.5 9 32	13 4.4 14 37	17 6.2 27 42	20 7.1 40 45
150 x 1000	0.15 (0.078)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	6.5 2.1 <4 23	9.5 2.8 6 30	12 3.6 9 34	15 5.0 18 40	18 5.7 25 42

NR25 NR35 NR40 NR45

200 x 400	0.12 (0.063)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	6.5 2.6 5 24	8.0 3.3 8 28	9.0 4.0 12 32	12.5 5.3 20 37	16 6.6 30 42	21 9.3 65 >45	- - - -
200 x 500	0.15 (0.078)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	5.5 2.1 <4 21	7 2.6 5 25	8.5 3.1 7 28	11.5 4.2 12 35	14 5.2 19 40	18.5 7.3 40 45	- - - -

Supply

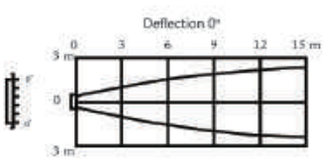





NR25 NR35 NR40 NR50

Grille Neck Size, mm	Neck Area (Eff. Area) m²	Unit Volume Flowrate, m³/hr Unit Volume Flowrate, l/s	250 70	300 84	400 112	500 140	600 168	800 224	1000 280	1400 392	1600 448
200 x 600	0.12 (0.063)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	6.8 2.2 <4 23	7.5 2.6 5 25	10.5 3.5 9 32	13 4.4 14 37	17 6.2 27 42	20 7.1 40 45
200 x 800	0.16 (0.084)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	7.0 2.0 <4 21	9.5 2.6 5 27	11.5 3.3 8 32	16 4.6 15 37	17 5.3 22 40
200 x 1000	0.2 (0.108)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	- - - -	8 2.1 <4 24	10 2.6 5 28	14 3.6 9.5 34	14.5 4.1 12 36

NR25 NR35 NR40 NR50

300 x 500	0.15 (0.084)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	7.0 2.0 <4 21	9.5 2.6 5 27	11.5 3.3 8 32	16 4.6 15 37	17 5.3 22 40
300 x 600	0.18 (0.099)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	- - - -	9.0 2.2 <4 25	11 2.8 5.5 30	14 3.9 12 36	16 4.5 14 37
300 x 800	0.24 (0.133)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	- - - -	- - - -	9.5 2.1 <4 25	13 2.9 6 32	14 3.3 8 34
300 x 1000	0.3 (0.167)	Throw Distance (0.25 m/s), m Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - - -	- - - -	- - - -	- - - -	- - - -	- - - -	8.5 1.7 <4 22	11 2.3 <4 27	12.5 2.7 5 30

Drop Correction

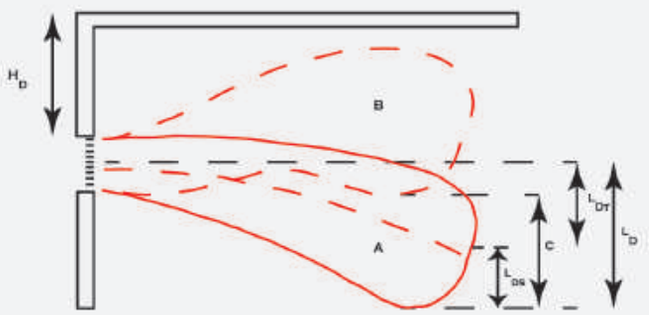

Label	Description
A	Envelope of non-isothermal air stream without drop correction
B	Envelope of a non-isothermal air stream with drop correction
L_{DS}	Distance between the centre of an air current and the lowest point of the envelope
L_{DT}	Distance between the centre of the grille core and the air current centerline
C	Correction factor, m
L_T	Throw distance, m
H_d	Grilles-Ceiling height, m

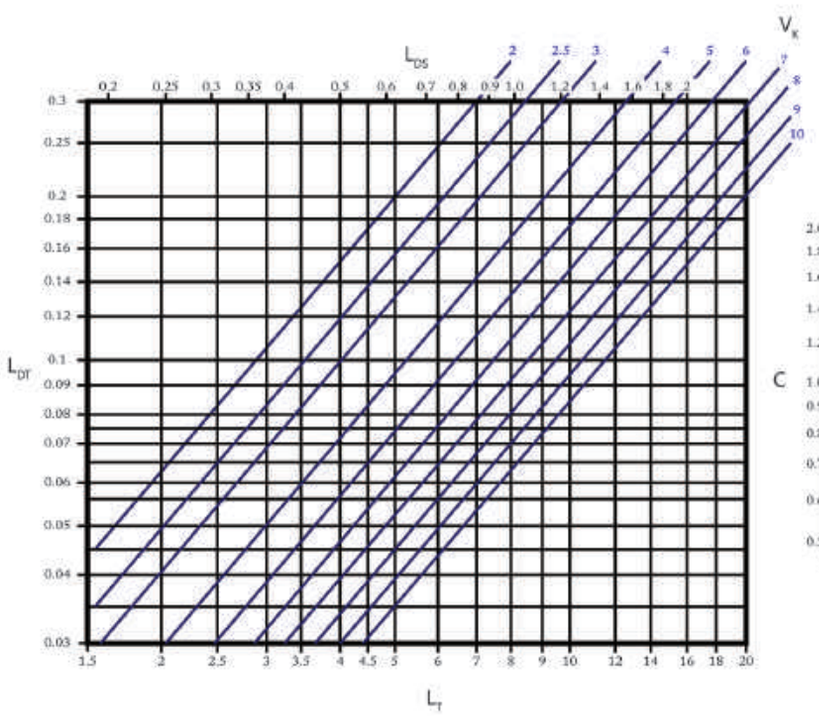

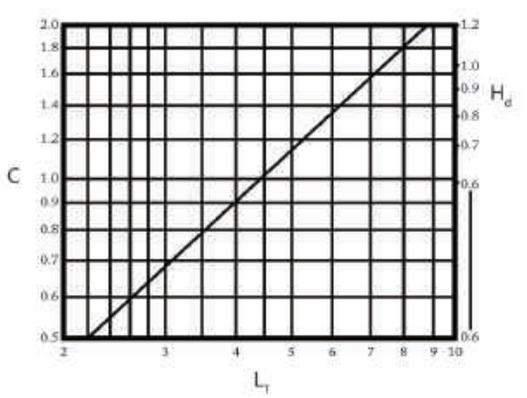

Airstream Drop

The total drop is the maximum vertical distance between the centre of a grille core and the lowest point of a specified enveloper, determined by the envelope velocity V_K.

The total drop consist of two elements :

$$L_D = L_{DS} + L_{DT}$$

Drop Correction L_D

Drop correction is possible by projecting the air current upward, with supply grille having adjustable horizontal bars. The drop effect can be significantly corrected if the air is projected upward 15° to 20°, as shown in the drop correction diagram. The correction factors "C" in the diagram are only valid if the minimum distance Hd between the centre of the grille and the ceiling is maintained.

Exhaust

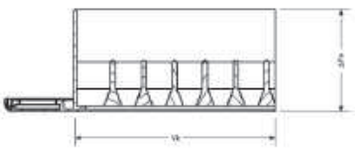

* The effective area given is to the best estimation & knowledge of Prudentaire's engineers at the point of entry.

* For 15° deflector vanes, air flow rate will be reduced by 5% at listed pressure lost and NR values.

NR25 NR35 NR40 NR45

Grille Neck Size, mm	Neck Area (Eff. Area) m²	Unit Volume Flowrate, m³/hr Unit Volume Flowrate, l/s	250 70	300 84	400 112	500 140	600 168	800 224	1000 280	1500 420	2000 560
150 x 250	0.0375 (0.014)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	5.0 4 25	6.0 6.0 30	7.7 9.0 40	- - -	- - -	- - -	- - -	- - -	- - -
150 x 300	0.045 (0.017)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	4.0 2.5 <20	4.7 4.0 25	6.5 7.0 34	8.2 10 42	9.8 14 47	- - -	- - -	- - -	- - -
150 x 400	0.06 (0.023)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	3.0 <1 <20	3.6 2.5 <20	4.8 3.5 20	6.0 6.0 27	7.2 8.0 37	9.7 14 47	- - -	- - -	- - -
150 x 500	0.075 (0.028)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	3.0 <1 <20	4.0 2.5 20	5.0 4 27	6.0 6.0 33	7.9 10 42	9.9 15 52	- - -	- - -
150 x 600	0.09 (0.035)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	3.2 1.5 <20	4.0 2.5 20	4.8 3.5 26	6.3 7.0 36	7.9 10 45	11.9 22 >55	- - -
150 x 800	0.12 (0.047)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	3.0 <1 <20	3.5 2 20	4.7 4.0 30	5.9 6.0 37	8.9 13 50	- - -

NR25 NR35 NR40 NR50

200 x 400	0.08 (0.031)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	3.6 2.5 <20	4.5 3.0 24	5.4 5.0 30	7.2 8.0 40	- - -	- - -	- - -
200 x 500	0.1 (0.039)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	3.6 2.5 <20	4.3 3.0 24	5.7 5.5 34	7.1 8.0 40	- - -	- - -
200 x 600	0.12 (0.047)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	3.0 <1 <20	3.5 2 20	4.7 4.0 30	5.9 6.0 37	8.9 13 50	- - -

NR25 NR35 NR40 NR45

200 x 800	0.16 (0.063)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	3.5 2.0 20	4.3 4.0 28	6.5 7.0 40	8.7 13 52
200 x 1000	0.2 (0.080)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	- - -	3.5 2.0 22	5.2 4.5 34	6.9 8.0 45

NR25 NR35 NR40 NR45

300 x 500	0.15 (0.063)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	3.5 2.0 20	4.3 4.0 28	6.5 7.0 40	8.7 13 52
300 x 600	0.18 (0.074)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	3.0 <1 <20	3.8 2.5 24	5.6 5.0 36	7.5 9.0 47
300 x 800	0.24 (0.099)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	- - -	2.8 <1 <20	4.2 3.0 28	5.6 5.0 37
300 x 1000	0.3 (0.125)	Face Velocity, m/s Total Pressure Loss, Pa Noise Rating (NR)	- - -	- - -	- - -	- - -	- - -	- - -	- - -	3.3 <1 23	4.4 4.0 32

BAR GRILLE TECHNICAL SPECIFICATION

Frame Construction

1. Frame to be in extruded aluminium. Frame thickness should be in minimum 1.2mm thick.
2. The margin to be in 28mm from the neck height to the edge.
3. Frame height to be in 40mm.
4. The corner of the frame should pressed with a 90° corner piece to ensure the frames are in 90°.

Vanes Construction

1. Vanes to be in extruded aluminium. Vanes thickness should be 1.8mm thick at the tail and 6.0mm at the surface.
2. Height of the vanes to be in 18mm only.
3. Vanes pitch to be in 12mm, unless otherwise stated.
4. All the vanes to be support with minimum 2 support bar.

Finishing

1. Finishing to be in powder coated RAL 9010 SG white matt, unless otherwise stated.

Performance

1. Free area of the grill to be in 53%
2. Standard vanes deflection configuration to be 0°, unless otherwise stated.
3. Bar Grille are designed to be wall mounted and windowsill mounted.

AVAILABLE TYPES

Fixed Type - Hollow Bar

Fixed Type - Slot In

Removable Type

Removable Type

Box Type - Hollow Bar

Box Type - Slot In

Frameless - Hollow Bar

Frameless - Slot In

PrudentAire®

GRILLE + ACCESSORIES COMBINATION

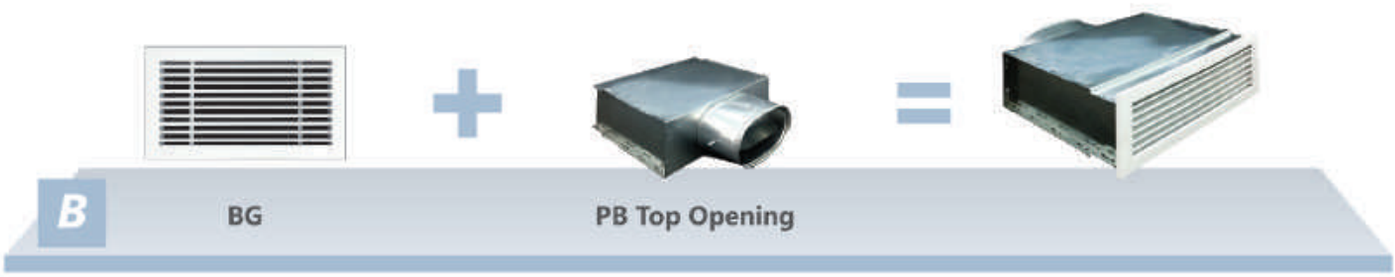

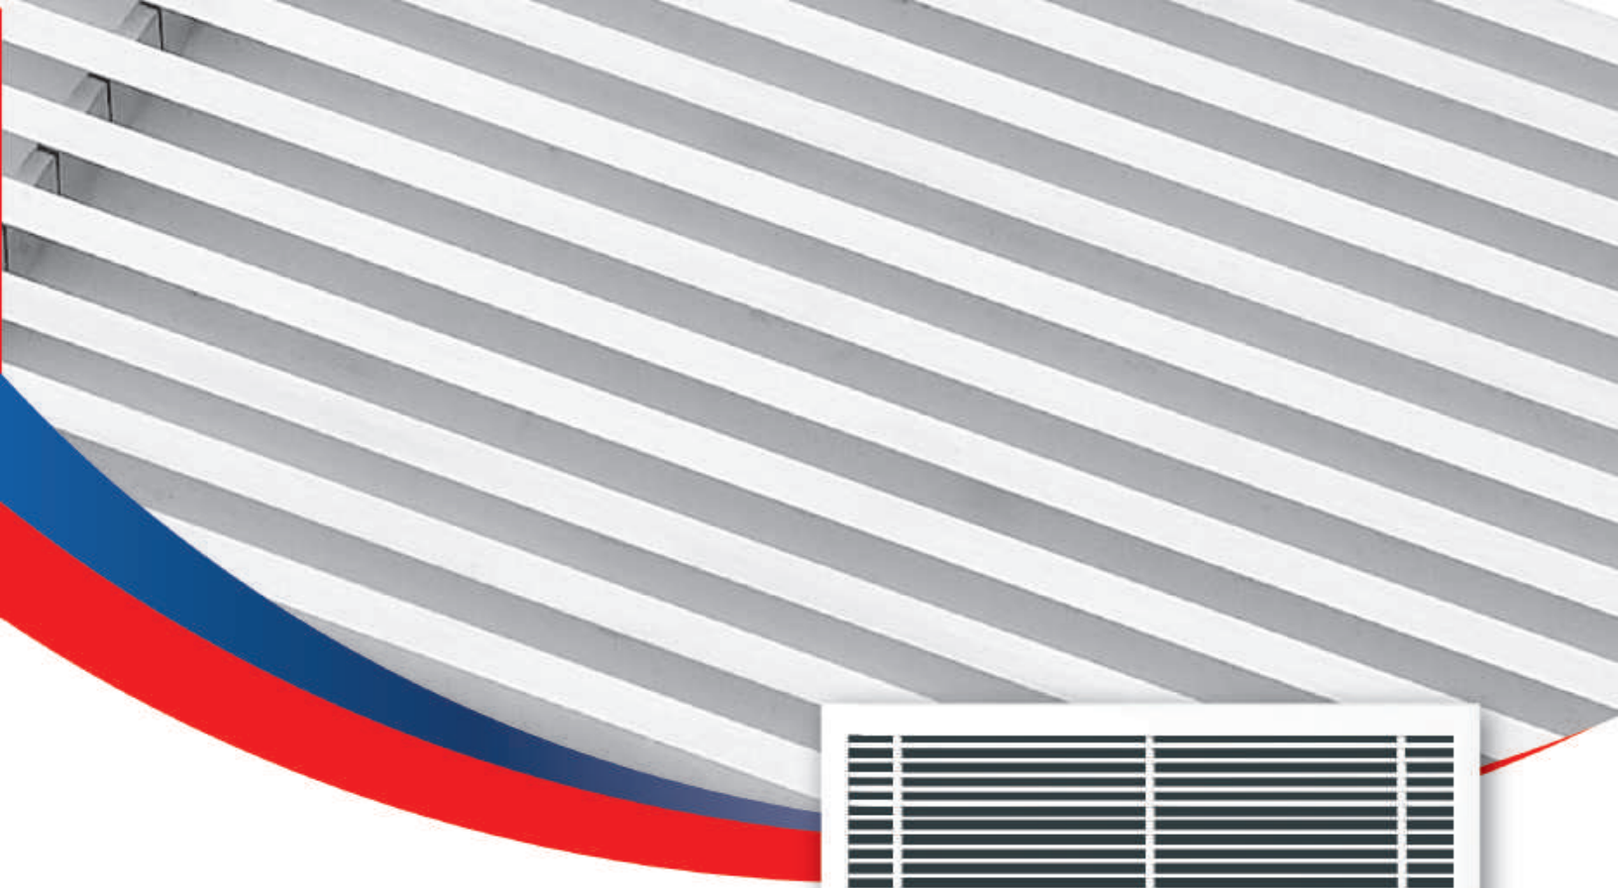

BG | Bar Grille

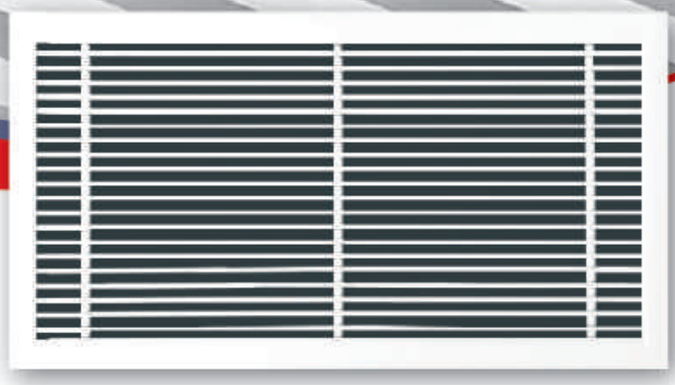

Products Range

- Grilles
- Diffusers
- Dampers
- Fire & Smoke Protection
- VAV
- Others
- Accessories

Prudent Aire Sdn Bhd 514037-D
Lot 2102, Jalan KPB12, Off Jalan Suria Park 1, Kg Baru Balakong,
43300 Seri Kembangan, Selangor Darul Ehsan, Malaysia
Tel : +603-9100 3858 (HL) / 9101 3869 / 9101 5868
Fax : +603-9100 4868 Email : sales@prudentaire.com

www.prudentaire.com

All stated specification are updated at the printing date and subject to change without notice or obligation.