

# **Aluminum Rods Bare Conductors And Cables**

Universal Cable (M) Berhad, incorporated in 1967 has grown steadily to become the country's single largest cable manufacturer today since its 1990 merger with Leader Cable Industry Berhad under the flagship of its parent, Leader Universal Holdings Berhad (LEADER).

Through its far sighted planning and unceasing product and service innovation, UCMB has successfully cultivated a manufacturing profile of an extensive range of cable and wire products.

From household cables, XLPE cables, telecommunication cables for both domestic and export markets to aluminium rods and high voltage cable, UCMB has achieved a distinguished reputation as a leading supplier of power and telecommunication cables to major corporations both local and foreign.

Today UCMB, a subsidiary of the LEADER group of companies has one of the most advanced facilities for manufacturing aluminium and aluminium alloy rods for the wire and cable industry in the Asia Pacific region.

The aluminium and aluminium alloy rods manufactured today for the wire and cable industry by UCMB are renowned internationally for its world class quality standards.

This catalogue serves as a guide to UCMB's manufacturing processes and standards in the manufacture of aluminium rod, conductor and cables.



# CONTENTS

	Page
<b>INTRODUCTION.....</b>	<b>1</b>
<b>ALL ALUMINIUM CONDUCTORS ( AAC )</b>	
● BS 215, Part 1 .....	10
● AS 1531 .....	11
● ASTM B 231 .....	11
● DIN 48201, Part 5 .....	13
● JIS C 3109 .....	13
<b>ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC )</b>	
● BS 3242 / MS 1143 .....	15
● AS 1531 .....	15
● DIN 48201, Part 6 .....	16
● ASTM B 399 .....	17
<b>ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR )</b>	
● BS 215, Part 2 .....	19
● AS 3607 .....	19
● ASTM B 232 .....	20
● JIS C 3110 .....	22
● DIN 48204 .....	23
<b>PVC COVERED ALUMINIUM CONDUCTORS</b>	
● BS 215, Part I and BS 6485 .....	24
<b>ALUMINIUM 1350 AND ALUMINIUM ALLOY RODS</b>	
● Chemical composition .....	25
● Mechanical and electrical properties .....	25
● Diameter tolerance .....	25
<b>APPENDIX : TECHNICAL DATA</b>	
● Properties of aluminium, aluminium alloy and copper .....	26
● Comparison of aluminium and copper conductors .....	27
● Current rating calculation for bare conductor ( IEC 61597 ) .....	28
● Current rating calculation for bare conductor .....	29
● Wire gauges .....	32
● Common conversion factor .....	34
● Formula for electrical calculation .....	35
● Publications referred to .....	36

# ALUMINIUM CONDUCTORS

Aluminium & aluminium alloy conductors are the preferred and dominant conductors in several areas of power transmission and distribution. The major areas dominated by aluminium and aluminium alloy conductors are non-insulated overhead power transmission, insulated overhead power transmission and non overhead power distribution.

This dominance is due to the excellent overall properties of aluminium and aluminium alloy conductors. Aluminium and aluminium alloy conductors offer good conductivity, light weight, excellent resistance to corrosion, good bending properties, greater tensile strength than copper and excellent compatibility with most common insulation used by the wire and cable industry.

These conductors now command a significant share of the insulated, interior wire market particularly in the larger dimensions (i.e. heavy current installations) where weight and ease of handling are important factors.



This trend is due to their excellent overall properties. Principally these are listed as:

1. **Conductivity**  
In excess of twice that of copper by unit weight.
2. **Strength**  
A range of strengths from dead soft to that of mild steel, depending on the required temperature of aluminium alloy.
3. **Workability**  
Permitting a wide range of processing from wire drawing to stranding. This offers excellent bend quality.
4. **Light Weight**  
Ease of handling, low installation costs, longer spans and more distance between pull-ins.
5. **Corrosion resistance**  
Most industrial, marine and chemical atmospheres cause corrosion.  
In addition, the corrosion resistance of all alloys can be further improved by anodizing.
6. **Compatibility with insulation**  
Does not adhere to or combine with usual insulating materials. No tin-coating required : clean stripping.



Aluminium and aluminium alloy electrical conductors are made by various processes from wire-drawing (i.e. rod breakdown to fine wire) to wire stranding from a large diameter of redraw aluminium and aluminium alloy rods.

These rods fabricated by melting the aluminium ingots (from smelter), plus required alloying materials, in an alloying furnace and rolled in a "rod-mill". Subsequent operations may vary according to the end-products desired such as additional processes of annealing and heat-treating.







Our EC grade aluminium rods and aluminium alloy rods are widely used in the production of overhead power transmission and distribution cables where the characteristics of aluminium are of importance.

With strong and consistent emphasis on quality, Universal Cable continues to strive for improvement in the production of our aluminium and aluminium alloy rods to better meet customer requirements and expectations.

# ALL ALUMINIUM CONDUCTORS ( AAC )

The stranded All Aluminium Conductor (AAC) are made up of concentric-lay-stranded aluminium wires only. The conductor may be made up of 7, 19, 37, 61 or more wires in 1, 2, 3, 4 or more layers around a central wire. Each successive layer shall have six more wires than the layer immediately beneath. For a given cross-sectional area, the conductor becomes more flexible as the number of wires is increased (with a corresponding decrease in size of each wire).

When All Aluminium Conductors are to be used in overhead lines, full hard drawn temper wires are used. The illustration below show some typical stranding patterns.

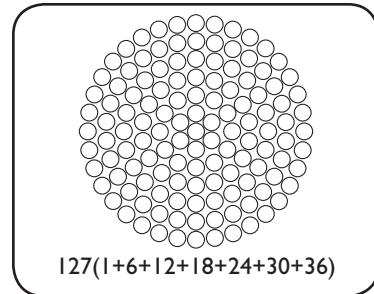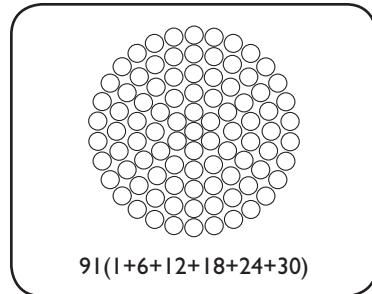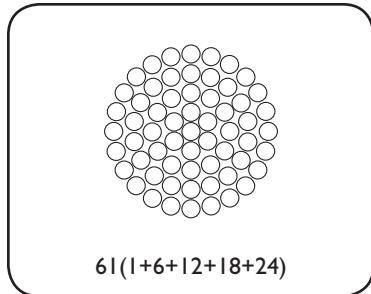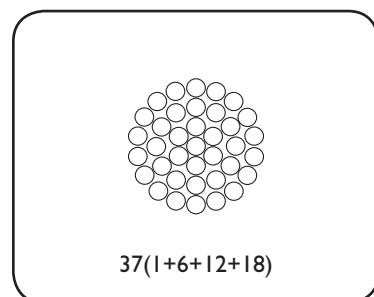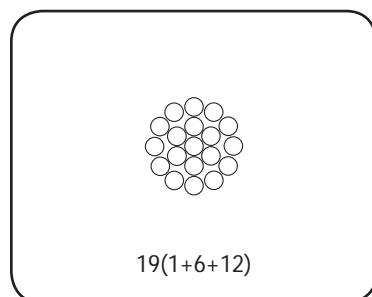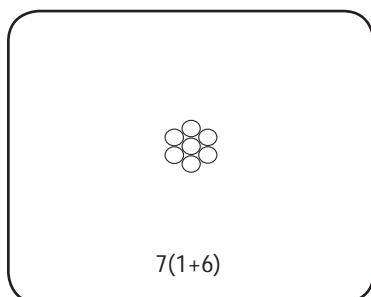

## ALL ALUMINIUM CONDUCTORS ( AAC ) ( BS 215, Part 1 )

Code name	Nominal area	Construction, No/Wire diameter	Calculated area	Approx. overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C	Hard-drawn copper equivalent area
	mm <sup>2</sup>	No./mm	mm <sup>2</sup>	mm	Kg/Km	kN	Ohm/Km	mm <sup>2</sup>
Midge	22	7/2.06	23.3	6.18	64	3.99	1.227	14.6
Ant	50	7/3.10	52.8	9.30	145	8.28	0.5419	33.2
Fly	60	7/3.40	63.6	10.2	174	9.90	0.4505	40.0
Wasp	100	7/4.39	106	13.2	290	16.00	0.2702	66.6
Hornet	150	19/3.25	158	16.3	434	24.70	0.1825	99.3
Chafer	200	19/3.78	213	18.9	587	32.40	0.1349	134
Cockroach	250	19/4.22	266	21.1	731	40.40	0.1083	167
Butterfly	300	19/4.65	323	23.3	888	48.75	0.08916	203
Centipede	400	37/3.78	415	26.5	1,145	63.10	0.06944	261

## ALL ALUMINIUM CONDUCTORS ( AAC / 1350 ) ( AS 1531 )

Code name	Construction, No/Wire diameter	Calculated sectional area	Approx. overall diameter	Approx. weight	Calculated minimum breaking load	Calculated DC resistance at 20°C	Hard-drawn copper equivalent area
	No./mm	mm <sup>2</sup>	mm	Kg/Km	kN	Ohm/Km	mm <sup>2</sup>
Leo	7/2.50	34.4	7.50	94.3	5.71	0.833	21.6
Leonids	7/2.75	41.6	8.25	113	6.72	0.689	26.2
Libra	7/3.00	49.5	9.00	135	7.98	0.579	31.1
Mars	7/3.75	77.3	11.3	211	11.8	0.370	48.6
Mercury	7/4.50	111	13.5	304	16.9	0.258	69.8
Moon	7/4.75	124	14.3	339	18.9	0.232	78.0
Neptune	19/3.25	158	16.3	433	24.7	0.183	99.3
Orion	19/3.50	183	17.5	503	28.7	0.157	115
Pluto	19/3.75	210	18.8	576	31.9	0.137	132
Saturn	37/3.00	262	21.0	721	42.2	0.110	165
Sirius	37/3.25	307	22.8	845	48.2	0.0941	193
Taurus	19/4.75	337	23.8	924	51.3	0.0857	212
Triton	37/3.75	409	26.3	1,120	62.2	0.0706	257
Uranus	61/3.25	506	29.3	1,400	75.2	0.0572	318
Ursula	61/3.50	587	31.5	1,620	87.3	0.0493	369
Venus	61/3.75	674	33.8	1,860	97.2	0.0429	424

## ALL ALUMINIUM CONDUCTORS ( AAC ) ( ASTM B 231 )

Code name	Nominal Size	Hard-drawn copper equivalent area	Stranding class *	Construction, No/Wire diameter	Calculated area	Approx. diameter	Standard weight	Calculated breaking strength	Calculated DC resistance at 20°C
	AWG/KCM	AWG/KCM		No./mm	mm <sup>2</sup>	mm	Kg/Km	Kg	Ohm/Km
Peachbell	6	8	A	7/1.56	13.4	4.68	37	258	2.15
Rose	4	6	A	7/1.96	21.1	5.88	58	399	1.37
Iris	2	4	AA,A	7/2.47	33.5	7.41	92	611	0.860
Pansy	1	3	AA,A	7/2.78	42.5	8.34	117	745	0.679
Poppy	1/0	2	AA,A	7/3.12	53.5	9.36	147	901	0.539
Aster	2/0	1	AA,A	7/3.50	67.4	10.5	185	1,134	0.428
Phlox	3/0	1/0	AA,A	7/3.93	84.9	11.8	234	1,372	0.340
Oxlip	4/0	2/0	AA,A	7/4.42	107	13.3	296	1,735	0.268
Sneezewort	250	157.2	AA	7/4.80	127	14.4	349	2,047	0.228
Valerian	250	157.2	A	19/2.91	126	14.6	348	2,110	0.228
Daisy	266.8	3/0	AA	7/4.96	135	14.9	372	2,185	0.213
Laurel	266.8	3/0	A	19/3.01	135	15.1	372	2,257	0.213
Peony	300	188.7	A	19/3.19	152	16.0	418	2,478	0.190
Tulip	336.4	4/0	A	19/3.38	171	16.9	470	2,782	0.169
Daffodil	350	220	A	19/3.45	178	17.3	489	2,898	0.162
Canna	397.5	250	AA,A	19/3.67	201	18.4	554	3,222	0.143
Goldentuft	450	283	AA	19/3.91	228	19.6	628	3,571	0.126
Cosmos	477	300	AA	19/4.02	241	20.1	664	3,775	0.120
Syringa	477	300	A	37/2.88	241	20.2	664	3,938	0.120
Zinna	500	314	AA	19/4.12	253	20.6	698	3,965	0.114
Hyacinth	500	314	A	37/2.95	253	20.7	696	4,131	0.114
Dahlia	556.5	350	AA	19/4.35	282	21.8	778	4,420	0.102
Mistletoe	556.5	350	AA,A	37/3.12	283	21.8	779	4,516	0.102
Meadowsweet	600	377	AA,A	37/3.23	303	22.6	835	4,840	0.0951
Orchid	636	400	AA,A	37/3.33	322	23.3	887	5,145	0.0895
Heuchera	650	409	AA	37/3.37	330	23.6	909	5,269	0.0874
Verbena	700	440	AA	37/3.49	354	24.4	975	5,651	0.0815
Flag	700	440	A	61/2.72	355	24.5	976	5,824	0.0813

\* NOTE : AA - For bare conductors usually used in overhead lines.

A - For conductors to be covered with weather - resistant materials, and for bare conductors where greater flexibility than is afforded by Class AA is required.

## ALL ALUMINIUM CONDUCTORS ( AAC ) ( ASTM B 231 )

Code name	Nominal Size	Hard-drawn copper equivalent area	Stranding class *	Construction, No./Wire diameter	Calculated area	Approx. diameter	Standard weight	Calculated breaking strength	Calculated DC resistance at 20°C
	AWG/KCM	AWG/KCM		No./mm	mm <sup>2</sup>	mm	Kg/Km	Kg	Ohm/Km
Violet	715.5	450	AA	37/3.53	362	24.7	997	5,781	0.0796
Nasturtium	715.5	450	A	61/2.75	362	24.8	998	5,954	0.0796
Petunia	750	472	AA	37/3.62	381	25.3	1,049	5,974	0.0757
Cattail	750	472	A	61/2.82	381	25.4	1,049	6,156	0.0757
Arbutus	795	500	AA	37/3.72	402	26.0	1,107	6,308	0.0717
Lilac	795	500	A	61/2.90	403	26.1	1,110	6,510	0.0716
Coskscomb	900	566	AA	37/3.96	456	27.7	1,255	6,979	0.0633
Snapdragon	900	566	A	61/3.09	457	27.8	1,260	7,223	0.0630
Magnolia	954	600	AA	37/4.08	484	28.6	1,332	7,409	0.0596
Goldenrod	954	600	A	61/3.18	485	28.6	1,334	7,650	0.0595
Hawkweed	1,000	629	AA	37/4.18	508	29.3	1,398	7,776	0.0568
Camellia	1,000	629	A	61/3.25	506	29.3	1,394	7,990	0.0570
Bluebell	1,033.5	650	AA	37/4.25	525	29.8	1,446	8,039	0.0549
Larkspur	1,033.5	650	A	61/3.31	525	29.8	1,446	8,288	0.0549
Marigold	1,113	700	AA,A	61/3.43	564	30.9	1,552	8,900	0.0511
Hawthorn	1,192.5	750	AA,A	61/3.55	604	32.0	1,663	9,533	0.0477
Narcissus	1,272	800	AA,A	61/3.67	645	33.0	1,777	10,011	0.0447
Columbine	1,351	850	AA,A	61/3.78	685	34.0	1,885	10,620	0.0421
Carnation	1,431	900	AA,A	61/3.89	725	35.0	1,997	10,981	0.0398
Gladiolus	1,510.5	950	AA,A	61/4.00	767	36.0	2,111	11,611	0.0376
Coreopsis	1,590	1,000	AA	61/4.10	805	36.9	2,218	12,199	0.0358
Jessamine	1,750	1,101	AA	61/4.30	886	38.7	2,440	13,418	0.0325
Cowslip	2,000	1,260	A	91/3.77	1,016	41.5	2,798	15,584	0.0284
Sagebrush	2,250	1,415	A	91/3.99	1,138	43.9	3,164	17,043	0.0256
Lupine	2,500	1,570	A	91/4.21	1,267	46.3	3,523	18,974	0.0230
Bitterroot	2,750	1,730	A	91/4.42	1,396	48.6	3,883	20,915	0.0208
Trillium	3,000	1,890	A	127/3.90	1,517	50.7	4,219	22,725	0.0192
Bluebonnet	3,500	2,200	A	127/4.22	1,776	54.9	4,988	26,607	0.0165

\* NOTE : AA - For bare conductors usually used in overhead lines.  
A - For conductors to be covered with weather - resistant materials, and for bare conductors where greater flexibility than is afforded by Class AA is required.

## ALL ALUMINIUM CONDUCTORS ( AAC ) ( DIN 48201, Part 5 )

Nominal area	Construction, No./Wire diameter	Calculated area	Approx. overall diameter	Standard weight	Calculated breaking strength	Calculated DC resistance at 20°C	Hard-drawn copper equivalent area
mm <sup>2</sup>	No./mm	mm <sup>2</sup>	mm	Kg/Km	Kg	Ohm/Km	mm <sup>2</sup>
16	7/1.70	15.9	5.1	43.5	290	1.802	10.0
25	7/2.10	24.2	6.3	66.3	425	1.181	15.2
35	7/2.50	34.4	7.5	94.0	590	0.8332	21.6
50	7/3.00	49.5	9.0	135	810	0.5786	31.1
50	19/1.80	48.3	9.0	133	862	0.5950	30.4
70	19/2.10	65.8	10.5	181	1,155	0.4371	41.4
95	19/2.50	93.3	12.5	256	1,599	0.3085	58.6
120	19/2.80	117	14.0	322	1,916	0.2459	73.6
150	37/2.25	147	15.8	405	2,581	0.1960	92.5
185	37/2.50	182	17.5	500	3,115	0.1587	114
240	61/2.25	243	20.3	670	4,030	0.1191	153
300	61/2.50	299	22.5	827	4,865	0.09650	188
400	61/2.89	400	26.0	1,105	6,208	0.07221	251
500	61/3.23	500	29.1	1,381	7,616	0.05781	314
625	91/2.96	626	32.6	1,733	9,716	0.04625	394
800	91/3.35	802	36.9	2,220	12,076	0.03611	504
1000	91/3.74	1,000	41.1	2,767	14,868	0.02897	629

## ALL ALUMINIUM CONDUCTORS ( AAC ) ( JIS C 3109 )

Nominal area	Construction, No./Wire diameter	Calculated area	Approx. overall diameter	Standard weight	Minimum breaking load	Calculated DC resistance at 20°C	Hard-drawn copper equivalent area
mm <sup>2</sup>	No./mm	mm <sup>2</sup>	mm	Kg/Km	Kgf	Ohm/Km	mm <sup>2</sup>
30	7/2.3	29.1	6.9	79.5	79.5	0.983	18.3
38	7/2.6	37.2	7.8	102	102	0.769	23.4
55	7/3.2	56.3	9.6	154	154	0.507	35.4
95	7/4.2	97.0	12.6	265	265	0.295	61.0
150	19/3.2	153	16.0	419	419	0.188	96.2
200	19/3.7	204	18.5	560	560	0.140	128
240	19/4.0	239	20.0	655	655	0.120	150
300	37/3.2	298	22.4	820	820	0.0969	187
400	37/3.7	398	25.9	1,097	1,097	0.0726	250
510	37/4.2	513	29.4	1,413	1,413	0.0563	323
660	61/3.7	656	33.3	1,812	1,812	0.0441	412
850	61/4.2	845	37.8	2,334	2,334	0.0342	531
980	91/3.7	978	40.7	2,716	2,716	0.0297	615
1,260	91/4.2	1,261	46.2	3,499	3,499	0.0230	793

# ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC )

All Aluminium alloy conductor (AAAC) contains a small percentage (about 0.6%) of silicon and magnesium elements. It provides several benefits for overhead lines.

## 1. Strength

About twice that of aluminium EC 1350

## 2. Weight

20% (approx.) lighter than ACSR conductor of equal diameter.

## 3. Corrosion resistance

It has a high resistance to atmospheric corrosion which is suitable for coastal and industrial areas.

## 4. Surface hardness


AAAC's surface is significantly harder than aluminium EC 1350. It is less liable to damage during installation which is an important advantage of EHV transmission lines where corona and radio interference is a major consideration.

## 5. Termination


Much simpler jointing accessories required compared to ACSR.

## 6. AC Resistance


AAAC is a non-magnetic material. It does not exhibit the magnetic core losses found in ACSR conductor.

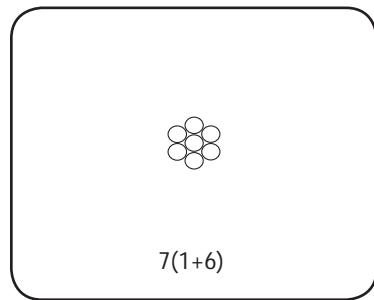


7(1+6)

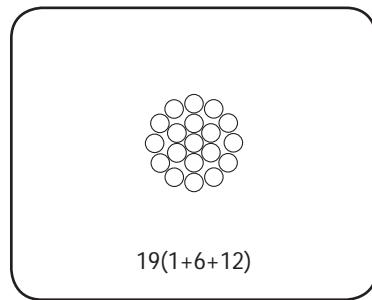


19(1+6+12)

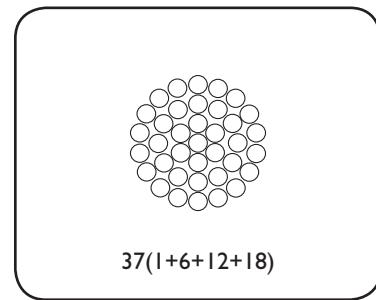


37(1+6+12+18)

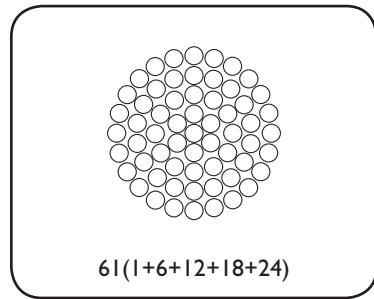

61(1+6+12+18+24)

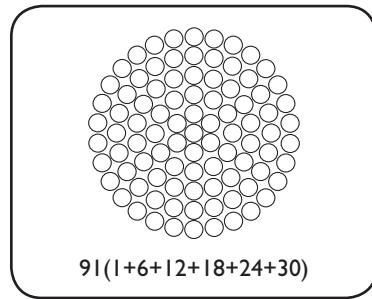

91(1+6+12+18+24+30)

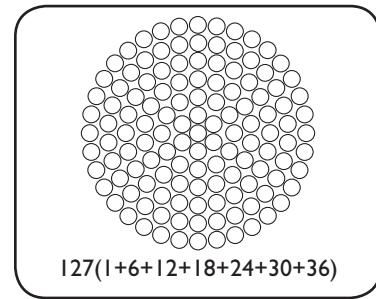

127(1+6+12+18+24+30+36)

## ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC ) ( BS 3242 / MS 1143 )

Code name	Nominal aluminium area	Construction, No./Wire diameter	Sectional area	Approx. overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C
	mm <sup>2</sup>	No./mm	mm <sup>2</sup>	mm	Kg/Km	kN	Ohm/Km
Almond	25	7/2.34	30.1	7.0	82	8.44	1.094
Cedar	30	7/2.54	35.5	7.6	97	9.94	0.9281
Fir	40	7/2.95	47.8	8.9	131	13.40	0.6880
Hazel	50	7/3.30	59.9	9.9	164	16.80	0.5498
Oak	100	7/4.65	119	14.0	325	33.30	0.2769
Ash	150	19/3.48	181	17.4	497	50.65	0.1830
Elm	175	19/3.76	211	18.8	580	59.10	0.1568
Upas	300	37/3.53	362	24.7	997	101.5	0.09155

## ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC / 1120 ) ( AS 1531 )

Code name	Construction, No./Wire diameter	Sectional area	Calculated equivalent aluminium area	Approx. overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C
	No./mm	mm <sup>2</sup>	mm <sup>2</sup>	mm	Kg/Km	kN	Ohm/Km
Chlorine	7/2.50	34.4	32.8	7.5	94.3	8.18	0.864
Chromium	7/2.75	41.6	39.7	8.3	113	9.91	0.713
Fluorine	7/3.00	49.5	47.2	9.0	135	11.8	0.599
Helium	7/3.75	77.3	73.7	11.3	211	17.6	0.383
Hydrogen	7/4.50	111	106	13.5	304	24.3	0.266
Iodine	7/4.75	124	118	14.3	339	27.1	0.239
Krypton	19/3.25	158	150	16.3	433	37.4	0.189
Lutetium	19/3.50	183	173	17.5	503	41.7	0.163
Neon	19/3.75	210	199	18.8	576	47.8	0.142
Nitrogen	37/3.00	262	248	21.0	721	62.2	0.114
Nobelium	37/3.25	307	291	22.8	845	72.8	0.0973
Oxygen	19/4.75	337	320	23.8	924	73.6	0.0884
Phosphorus	37/3.75	409	387	26.3	1,120	93.1	0.0731
Selenium	61/3.25	506	478	29.3	1,400	114	0.0592
Silicon	61/3.50	587	555	31.5	1,620	127	0.0511
Sulphur	61/3.75	674	636	33.8	1,860	145	0.0444

## ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC / 6201 ) ( AS 1531 )

Code name	Construction, No./Wire diameter	Sectional area	Calculated equivalent aluminium area	Approx. overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C
	No./mm	mm <sup>2</sup>	mm <sup>2</sup>	mm	Kg/Km	kN	Ohm/Km
Diamond	7/2.50	34.4	29.3	7.5	94.3	9.64	0.967
Dolomite	7/2.75	41.6	35.4	8.3	113	11.6	0.799
Emerald	7/3.00	49.5	42.2	9.0	135	13.9	0.671
Garnet	7/3.75	77.3	65.8	11.3	211	21.7	0.430
Jade	7/4.50	111	94.8	13.5	304	31.2	0.298
Jasper	7/4.75	124	106	14.3	339	34.8	0.268
Opal	19/3.25	158	134	16.3	433	44.2	0.212
Patronite	19/3.50	183	155	17.5	503	51.3	0.183
Pearl	19/3.75	210	178	18.8	576	58.8	0.159
Ruby	37/3.00	262	221	21.0	721	73.5	0.128
Ruthenium	37/3.25	307	260	22.8	845	86.1	0.109
Rutile	19/4.75	337	285	23.8	924	94.4	0.0991
Sapphire	37/3.75	409	345	26.3	1,120	115	0.0819
Spinel	61/3.25	506	427	29.3	1,400	135	0.0662
Tantalum	61/3.50	587	495	31.5	1,620	156	0.0572
Topaz	61/3.75	674	568	33.8	1,860	179	0.0498

## ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC ) ( DIN 48201, Part 6 )

Nominal area	Construction, No./Wire diameter	Calculated area	Approx. overall diameter	Standard weight	Calculated breaking strength	Calculated DC resistance at 20°C
mm <sup>2</sup>	No./mm	mm <sup>2</sup>	mm	Kg/Km	Kg	Ohm/Km
16	7/1.70	15.9	5.1	43.5	453	2.091
25	7/2.10	24.2	6.3	66.4	691	1.370
35	7/2.50	34.4	7.5	94.1	979	0.9669
50	7/3.00	49.5	9.0	135	1,410	0.6714
50	19/1.80	48.3	9.0	133	1,377	0.6905
70	19/2.10	65.8	10.5	181	1,875	0.5073
95	19/2.50	93.3	12.5	257	2,657	0.3580
120	19/2.80	117	14.0	322	3,333	0.2854
150	37/2.25	147	15.7	406	4,191	0.2274
185	37/2.50	182	17.5	501	5,174	0.1842
240	61/2.25	243	20.2	671	6,909	0.1383
300	61/2.50	299	22.5	828	8,530	0.1120
400	61/2.89	400	26.0	1,106	11,400	0.08380
500	61/3.23	500	29.1	1,382	14,239	0.06709
625	91/2.96	626	32.6	1,735	17,840	0.05367
800	91/3.35	802	36.9	2,222	22,850	0.04190
1000	91/3.74	1,000	41.1	2,770	28,480	0.03362

## ALL ALUMINIUM ALLOY CONDUCTORS ( AAAC ) ( ASTM B 399 )


Code name	Conductor size		Stranding class *	Construction, No./Wire diameter	Approx. diameter	Standard weight	Calculated breaking strength	Calculated DC resistance at 20°C
	KCM	mm <sup>2</sup>		No./mm	mm	Kg/Km	Kg	Ohm/Km
Akron	30.58	15.5	A	7/1.68	5.0	42.8	503	2.16
Alton	48.69	24.7	A	7/2.12	6.4	68.1	801	1.36
Ames	77.47	39.3	AA,A	7/2.67	8.0	108	1,270	0.855
Azusa	123.3	62.5	AA,A	7/3.37	10.1	172	1,938	0.536
Anaheim	155.4	78.7	AA,A	7/3.78	11.3	217	2,438	0.426
Amherst	195.7	99.2	AA,A	7/4.25	12.8	274	3,082	0.337
Alliance	246.9	125	AA	7/4.77	14.3	345	3,883	0.268
Butte	312.8	158	A	19/3.26	16.3	437	4,769	0.211
Canton	394.5	200	AA,A	19/3.66	18.3	551	6,011	0.168
Cairo	465.4	236	AA	19/3.98	19.9	652	7,108	0.142
Darien	559.5	283	AA	19/4.36	21.8	782	8,530	0.118
Elgin	652.4	331	AA	19/4.71	23.6	913	9,955	0.101
Flint	740.8	375	AA	37/3.59	25.1	1,033	11,020	0.0894
Greeley	927.2	470	AA	37/4.02	28.1	1,295	13,818	0.0713

\* NOTE : AA - For bare conductors usually used in overhead lines  
A - For conductors to be covered with weather - resistant materials.

# ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR )

ACSR is a composite, concentrically stranded conductor in which the light weight and good conductivity of aluminium are combined with the high tensile strength of steel. It is composed of one or more layers of EC grade hard-drawn aluminium wires helically stranded around an inner core of high strength zinc-coated steel wires. The inner steel core may be a single zinc-coated steel wire, or concentrically stranded of one or more layer of zinc-coated steel wires.

ACSR has long been widely used as overhead high tension transmission lines and has an established reputation for economy and dependability. The illustration below shows typical standard sizes and stranding patterns..

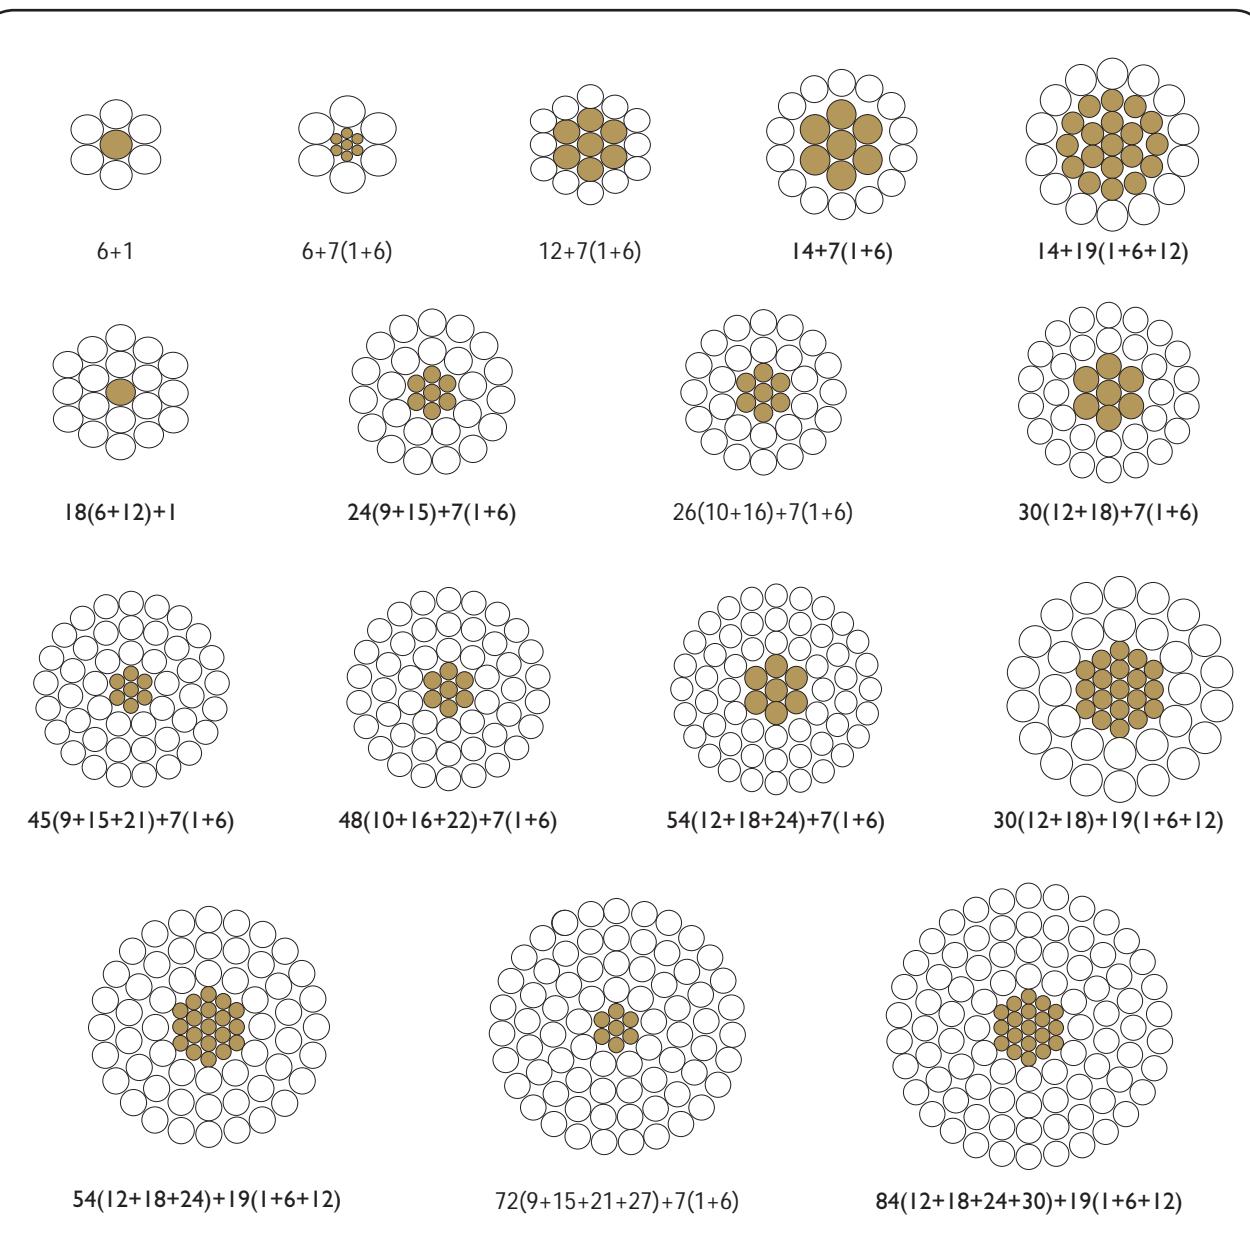

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( BS 215, 2 )

Code name	Nominal aluminium area	Construction, No./Wire diameter		Cross-sectional area		Approx. overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C
		Aluminium	Steel	Aluminium	Total				
	mm²	No./mm	No./mm	mm²	mm²	mm	Kg/Km	kN	Ohm/Km
Gopher	25	6/2.36	1/2.36	26.25	30.62	7.08	106	9.61	1.093
Weasel	30	6/2.59	1/2.59	31.61	36.88	7.77	128	11.45	0.9077
Ferret	40	6/3.00	1/3.00	42.41	49.48	9.00	172	15.20	0.6766
Rabbit	50	6/3.35	1/3.35	52.88	61.70	10.05	214	18.35	0.5426
Skunk	60	12/2.59	7/2.59	63.22	100.1	12.95	464	52.94	0.4567
Horse	70	12/2.79	7/2.79	73.37	116.2	13.95	538	61.20	0.3936
Dog	100	6/4.72	7/1.57	105.0	118.6	14.15	394	32.70	0.2733
Wolf	150	30/2.59	7/2.59	158.1	194.9	18.13	726	69.20	0.1828
Dingo	150	18/3.35	1/3.35	158.7	167.5	16.75	506	35.70	0.1815
Lynx	175	30/2.79	7/2.79	183.4	226.2	19.53	842	79.80	0.1576
Caracal	175	18/3.61	1/3.61	184.3	194.5	18.05	587	41.10	0.1563
Panther	200	30/3.00	7/3.00	212.1	261.5	21.00	974	92.25	0.1363
Jaguar	200	18/3.86	1/3.86	210.6	222.3	19.30	671	46.55	0.1367
Batang *	300	18/4.78	7/1.68	323.0	338.5	24.16	1,010	69.67	0.08914
Zebra	400	54/3.18	7/3.18	428.9	484.5	28.62	1,621	131.9	0.06740

\* Not in BS 215 : Part 2

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( AS 3607 )

Code name	Construction, No./Wire diameter		Calculated equivalent aluminium area	Cross - Sectional area	Approx. overall diameter	Approx. weight	Calculated minimum breaking load	Calculated DC resistance at 20°C
	Aluminium	Steel						
	No./mm	No./mm	mm²	mm²	mm	Kg/Km	kN	Ohm/Km
Almond	6/2.50	1/2.50	29.0	34.36	7.50	119	10.5	0.975
Apricot	6/2.75	1/2.75	35.1	41.58	8.30	144	12.6	0.805
Apple	6/3.00	1/3.00	41.8	49.48	9.00	171	14.9	0.677
Banana	6/3.75	1/3.75	65.2	77.31	11.3	268	22.7	0.433
Cherry	6/4.75	7/1.60	105	120.4	14.3	402	33.4	0.271
Grape	30/2.50	7/2.50	144	181.6	17.5	677	63.5	0.196
Lemon	30/3.00	7/3.00	207	261.5	21.0	973	90.4	0.136
Lychee	30/3.25	7/3.25	243	306.9	22.8	1,140	105	0.116
Lime	30/3.50	7/3.50	282	356.0	24.5	1,320	122	0.100
Mango	54/3.00	7/3.00	373	431.2	27.0	1,440	119	0.0758
Orange	54/3.25	7/3.25	438	506.0	29.3	1,690	137	0.0646
Olive	54/3.50	7/3.50	508	586.9	31.5	1,960	159	0.0557
Pawpaw	54/3.75	19/2.25	583	672.0	33.8	2,240	178	0.0485
Peach	54/4.75	19/2.85	936	1085	42.8	3,660	292	0.0303
Standard High - Strength Conductor								
Quince	3/1.75	4/1.75	8.74	16.84	5.3	95	12.7	3.25
Raisin	3/2.50	4/2.50	17.8	34.36	7.5	195	24.4	1.59
Sultana	4/3.00	3/3.00	31.5	49.48	9.0	243	28.3	0.897
Walnut	4/3.75	3/3.75	49.2	77.31	11.3	380	43.9	0.573

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( ASTM B 232 )

Code name	Nominal size	Hard-drawn copper equivalent area	Construction, No./Wire diameter		Calculated area		Approx. overall diameter	Standard weight	Calculated breaking load	Calculated DC resistance at 20°C
			Aluminium	Steel	Aluminium	Steel				
	AWG/KCM	AWG/KCM	No./mm	No./mm	mm <sup>2</sup>	mm <sup>2</sup>	mm	kg/km	kgf	ohm/km
Turkey *	6	8	6/1.68	1/1.68	13.30	2.22	5.04	54	541	2.16
Swan *	4	6	6/2.12	1/2.12	21.18	3.53	6.36	86	847	1.35
Swanate	4	6	7/1.96	1/2.61	21.18	5.35	6.53	100	1,070	1.36
Sparrow *	2	4	6/2.67	1/2.67	33.59	5.60	8.01	136	1,291	0.854
Sparate *	2	4	7/2.47	1/3.30	33.54	8.55	8.24	159	1,649	0.855
Robin	1	3	6/3.00	1/3.00	42.41	7.07	9.00	171	1,617	0.676
Raven *	1/0	2	6/3.37	1/3.37	53.52	8.92	10.1	216	1,984	0.536
Quail *	2/0	1	6/3.78	1/3.78	67.33	11.22	11.3	272	2,400	0.426
Pigeon *	3/0	1/0	6/4.25	1/4.25	85.12	14.19	12.8	344	3,001	0.337
Penguin *	4/0	2/0	6/4.77	1/4.77	107.2	17.9	14.3	433	3,780	0.268
Waxwing *	266.8	3/0	18/3.09	1/3.09	135.0	7.5	15.5	430	3,113	0.214
Partridge *	266.8	3/0	26/2.57	7/2.00	134.9	22.0	16.3	545	5,111	0.215
Ostrich	300.0	188.7	26/2.73	7/2.12	152.2	24.7	17.3	615	5,754	0.190
Widgeon	336.4	4/0	18/3.47	1/3.47	170.2	9.5	17.4	543	3,926	0.169
Linnet *	336.4	4/0	26/2.89	7/2.25	170.6	27.8	18.3	690	6,418	0.170
Oriole *	336.4	4/0	30/2.69	7/2.69	170.5	39.8	18.8	785	7,881	0.170
Chickadee *	397.5	250	18/3.77	1/3.77	200.9	11.2	18.9	640	4,500	0.143
Brant *	397.5	250	24/3.27	7/2.18	201.6	26.1	19.6	762	6,640	0.144
Ibis *	397.5	250	26/3.14	7/2.44	201.3	32.7	19.9	814	7,387	0.144
Lark *	397.5	250	30/2.92	7/2.92	200.9	46.9	20.4	924	9,229	0.145
Pelican *	477.0	300	18/4.14	1/4.14	242.3	13.5	20.7	772	5,335	0.119
Flicker *	477.0	300	24/3.58	7/2.39	241.6	31.4	21.5	915	7,809	0.120
Hawk *	477.0	300	26/3.44	7/2.67	241.6	39.2	21.8	976	8,855	0.120
Hen *	477.0	300	30/3.20	7/3.20	241.3	56.3	22.4	1,110	10,772	0.120
Osprey *	556.5	350	18/4.47	1/4.47	282.5	15.7	22.4	900	6,219	0.102
Parakeet *	556.5	350	24/3.87	7/2.58	282.3	36.6	23.2	1,068	9,005	0.103
Dove *	556.5	350	26/3.72	7/2.89	282.6	45.9	23.6	1,142	10,285	0.103
Eagle	556.5	350	30/3.46	7/3.46	282.1	65.8	24.2	1,298	12,594	0.103
Peacock	605.0	380.5	24/4.03	7/2.69	306.1	39.8	24.2	1,159	9,778	0.0946
Squab	605.0	380.5	26/3.87	7/3.01	305.8	49.8	24.5	1,236	11,030	0.0947
Woodduck	605.0	380.5	30/3.61	7/3.61	307.1	71.6	25.3	1,413	13,131	0.0946
Teal	605.0	380.5	30/3.61	19/2.16	307.1	69.6	25.2	1,398	13,574	0.0946
Swift	636.0	400	36/3.38	1/3.38	323.0	9.0	23.7	960	6,246	0.0892
Kingbird *	636.0	400	18/4.78	1/4.78	323.0	17.9	23.9	1,030	7,112	0.0893
Rook *	636.0	400	24/4.14	7/2.76	323.1	41.9	24.8	1,222	10,306	0.0897
Grosbeak *	636.0	400	26/3.97	7/3.09	321.8	52.5	25.2	1,302	11,411	0.0900
Scoter	636.0	400	30/3.70	7/3.70	322.6	75.3	25.9	1,484	13,794	0.0900
Egret	636.0	400	30/3.70	19/2.22	322.6	73.5	25.9	1,472	14,310	0.0900
Flamingo	666.6	419	24/4.23	7/2.82	337.3	43.7	25.4	1,276	10,759	0.0859
Gannet	666.6	419	26/4.07	7/3.16	338.3	54.9	25.8	1,366	11,960	0.0856
Stilt	715.5	450	24/4.39	7/2.92	363.3	46.9	26.3	1,372	11,561	0.0797
Starling	715.5	450	26/4.21	7/3.28	361.9	59.1	26.7	1,465	12,847	0.0800
Redwing	715.5	450	30/3.92	19/2.35	362.1	82.4	27.4	1,651	15,673	0.0802
Coot	795.0	500	36/3.77	1/3.77	401.9	11.2	26.4	1,194	7,583	0.0717
Cuckoo *	795.0	500	24/4.62	7/3.08	402.3	52.2	27.7	1,522	12,630	0.0720
Drake *	795.0	500	26/4.44	7/3.45	402.6	65.40	28.1	1,627	14,246	0.0720
Tern *	795.0	500	45/3.38	7/2.25	403.8	27.8	27.0	1,335	10,017	0.0717
Condor	795.0	500	54/3.08	7/3.08	402.3	52.2	27.7	1,522	12,756	0.0720
Mallard	795.0	500	30/4.14	19/2.48	403.8	91.8	29.0	1,841	17,465	0.0719

\* Indicates those " preferred " sizes most commonly used

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( ASTM B 232 )

Code name	Nominal size	Hard-drawn copper equivalent area	Construction, No./Wire diameter		Calculated area		Approx. overall diameter	Standard weight	Calculated breaking load	Calculated DC resistance at 20°C
			Aluminium	Steel	Aluminium	Steel				
	AWG/KCM	AWG/KCM	No./mm	No./mm	mm <sup>2</sup>	mm <sup>2</sup>	mm	kg/km	kgf	ohm/km
Ruddy	900.0	566	45/3.59	7/2.40	455.5	31.7	28.7	1,509	11,114	0.0636
Canary	900.0	566	54/3.28	7/3.28	456.3	59.1	29.5	1,726	14,466	0.0635
Catbird	954.0	600	36/4.14	1/4.14	484.6	13.5	29.0	1,440	8,964	0.0595
Rail *	954.0	600	45/3.70	7/2.47	483.8	33.5	29.6	1,602	11,794	0.0599
Cardinal *	954.0	600	54/3.38	7/3.38	484.5	62.8	30.4	1,833	15,362	0.0598
Tanager	1,033.5	650	36/4.30	1/4.30	522.8	14.5	30.1	1,553	9,670	0.0551
Ortolan	1,033.5	650	45/3.85	7/2.57	523.9	36.3	30.8	1,734	12,575	0.0553
Curlew	1,033.5	650	54/3.51	7/3.51	522.5	67.7	31.6	1,976	16,566	0.0554
Bluejay *	1,113.0	700	45/4.00	7/2.66	565.5	38.9	32.0	1,870	13,536	0.0512
Finch *	1,113.0	700	54/3.65	19/2.19	565.0	71.6	32.9	2,133	17,757	0.0515
Bunting	1,192.5	750	45/4.14	7/2.76	605.8	41.9	33.1	2,004	14,527	0.0478
Grackle	1,192.5	750	54/3.77	19/2.27	602.8	76.9	34.0	2,280	19,011	0.0483
Skylark	1,272.0	800	36/4.78	1/4.78	646.0	17.9	33.5	1,919	11,950	0.0446
Bittern *	1,272.0	800	45/4.27	7/2.85	644.4	44.7	34.2	2,133	15,466	0.0450
Pheasant *	1,272.0	800	54/3.90	19/2.34	645.1	81.7	35.1	2,435	19,801	0.0451
Dipper	1,351.0	850	45/4.40	7/2.93	684.2	47.2	35.2	2,263	16,395	0.0423
Martin	1,351.0	850	54/4.02	19/2.41	685.4	86.7	36.2	2,586	21,021	0.0425
Bobolink *	1,431.0	900	45/4.53	7/3.02	725.3	50.1	36.2	2,400	17,392	0.0399
Plover *	1,431.0	900	54/4.14	19/2.48	726.9	91.8	37.2	2,742	22,277	0.0400
Nuthatch	1,510.0	950	45/4.65	7/3.10	764.2	52.8	37.2	2,529	18,119	0.0379
Parrot	1,510.0	950	54/4.25	19/2.55	766.1	97.0	38.3	2,892	23,514	0.0380
Lapwing *	1,590.0	1,000	45/4.78	7/3.18	807.5	55.6	38.2	2,670	19,118	0.0359
Falcon	1,590.0	1,000	54/4.36	19/2.62	806.2	102.4	39.3	3,046	24,785	0.0361
Chukar	1,780.0	1,119	84/3.70	19/2.22	903.2	73.5	40.7	3,089	23,151	0.0322
Bluebird	2,156.0	1,356	84/4.07	19/2.44	1,093	89	44.8	3,736	27,341	0.0266
Kiwi	2,167.0	1,362	72/4.41	7/2.94	1,100	48	44.1	3,431	22,614	0.0265
Thrasher	2,312.0	1,454	76/4.43	19/2.07	1,171	64	45.8	3,759	25,689	0.0249

\* Indicates those " preferred " sizes most commonly used

## ALUMINIUM CONDUCTORS STEEL REINFORCED / HIGH STRENGTH (ACSR/HS) ( ASTM B 232 )

Code name	Nominal size	Hard-drawn copper equivalent area	Construction, No./Wire diameter		Calculated area		Approx. overall diameter	Standard weight	Calculated breaking load	Calculated DC resistance at 20°C
			Aluminium	Steel	Aluminium	Steel				
	AWG/KCM	AWG/KCM	No./mm	No./mm	mm²	mm²	mm	kg/km	kgf	ohm/km
Grouse	80.0	50.3	8/2.54	1/4.24	40.54	14.12	9.32	222	2,591	0.7112
Petrel	101.8	64.0	12/2.34	7/2.34	51.61	30.10	11.7	379	5,096	0.5614
Minorca	110.8	69.7	12/2.44	7/2.44	56.11	32.73	12.2	412	5,541	0.5163
Leghorn	134.6	84.6	12/2.69	7/2.69	68.20	39.78	13.5	500	6,688	0.4248
Guinea	159.0	100.0	12/2.92	7/2.92	80.36	46.88	14.6	590	7,857	0.3605
Dotterel	176.9	111.2	12/3.08	7/3.08	89.41	52.15	15.4	656	8,553	0.3240
Dorking	190.8	120.0	12/3.20	7/3.20	96.51	56.30	16.0	708	9,233	0.3002
Brahma	203.2	127.8	16/2.86	19/2.48	102.8	91.8	18.1	1,005	14,047	0.2818
Cochin	211.3	132.8	12/3.37	7/3.37	107.0	62.4	16.9	786	10,240	0.2707

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( JIS C 3110 )

Nominal sectional area	Construction, No./Wire diameter		Calculated cross-sectional area		Approx. overall diameter	Approx. weight	Minimum tensile load	Calculated DC resistance at 20°C
	Aluminium	Steel	Aluminium	Steel				
mm²	No./mm²	No./mm²	mm²	mm²	mm	Kg/Km	Kgf	Ohm/Km
25	6/2.3	1/2.3	24.9	4.2	6.9	101	907	1.15
32	6/2.6	1/2.6	31.9	5.3	7.8	129	1,140	0.899
58	6/3.5	1/3.5	57.7	9.6	10.5	233	1,980	0.497
95	6/4.5	1/4.5	95.4	15.9	13.5	385	3,180	0.301
120	30/2.3	7/2.3	124.7	29.1	16.1	574	5,540	0.233
160	30/2.6	7/2.6	159.3	37.2	18.2	733	6,980	0.182
200	30/2.9	7/2.9	198.2	46.2	20.3	912	8,640	0.147
240	30/3.2	7/3.2	241.2	59.3	22.4	1,110	10,210	0.120
330	26/4.0	7/3.1	326.8	52.8	25.3	1,320	10,950	0.0888
410	26/4.5	7/3.5	413.4	67.3	28.5	1,673	13,910	0.0702
520*	54/3.5	7/3.5	519.5	67.3	31.2	1,969	15,600	0.0559
610	54/3.8	7/3.8	612.4	79.4	34.2	2,320	18,350	0.0474
810	45/4.8	7/3.2	814.5	56.3	38.4	2,700	18,480	0.0356

\* Not in JIS C 3110

## ALUMINIUM CONDUCTORS STEEL REINFORCED ( ACSR ) ( DIN 48204 )

Nominal sectional area	Aluminium		Steel		Total sectional area	Overall diameter	Approx. weight	Calculated breaking load	Calculated DC resistance at 20°C
	Construction	Area	Construction	Area					
mm <sup>2</sup>	No./mm <sup>2</sup>	mm <sup>2</sup>	No./mm <sup>2</sup>	mm <sup>2</sup>	mm <sup>2</sup>	mm	Kg/Km	Kg	Ohm/Km
16/2.5	6/1.80	15.3	1/1.80	2.5	17.8	5.4	62	593	1.8793
25/4	6/2.25	23.9	1/2.25	4.0	27.9	6.8	97	920	1.2028
35/6	6/2.70	34.4	1/2.70	5.7	40.1	8.1	140	1,295	0.8353
44/32	14/2.00	44.0	7/2.40	31.7	75.7	11.2	372	4,637	0.6573
50/8	6/3.20	48.3	1/3.20	8.0	56.3	9.6	196	1,752	0.5946
50/30	12/2.33	51.2	7/2.33	29.8	81.0	11.7	378	4,517	0.5644
70/12	26/1.85	69.9	7/1.44	11.4	81.3	11.7	284	2,684	0.4130
95/15	26/2.15	94.4	7/1.67	15.3	109.7	13.6	383	3,587	0.3058
95/55	12/3.20	96.5	7/3.20	56.3	152.8	16.0	712	8,180	0.2992
105/75	14/3.10	105.7	19/2.25	75.5	181.2	17.5	891	10,882	0.2736
120/20	26/2.44	121.6	7/1.90	19.8	141.4	15.5	494	4,584	0.2374
120/70	12/3.60	122.1	7/3.60	71.3	193.4	18.0	901	10,012	0.2364
125/30	30/2.33	127.9	7/2.33	29.8	157.7	16.1	591	5,902	0.2259
150/25	26/2.70	148.9	7/2.10	24.2	173.1	17.1	605	5,546	0.1939
170/40	30/2.70	171.8	7/2.70	40.1	211.9	18.9	794	7,855	0.1682
185/30	26/3.00	183.8	7/2.33	29.8	213.6	19.0	746	6,761	0.1571
210/35	26/3.20	209.1	7/2.49	34.1	243.2	20.3	850	7,644	0.1380
210/50	30/3.00	212.1	7/3.00	49.5	261.6	21.0	981	9,410	0.1363
230/30	24/3.50	230.9	7/2.33	29.8	260.7	21.0	877	7,455	0.1249
240/40	26/3.45	243.1	7/2.68	39.5	282.6	21.9	987	8,819	0.1188
265/35	24/3.74	263.7	7/2.49	34.1	297.8	22.4	1,002	8,460	0.1094
300/50	26/3.86	304.3	7/3.00	49.5	353.8	24.5	1,236	10,719	0.0949
305/40	54/2.68	304.6	7/2.68	39.5	344.1	24.1	1,160	10,129	0.0949
340/30	48/3.00	339.3	7/2.33	29.8	369.1	25.0	1,180	9,441	0.0851
380/50	54/3.00	381.7	7/3.00	49.5	431.2	27.0	1,453	12,333	0.0757
385/35	48/3.20	386.0	7/2.49	34.1	420.1	26.7	1,344	10,640	0.0748
435/55	54/3.20	434.3	7/3.20	56.3	490.6	28.8	1,653	13,900	0.0666
450/40	48/3.45	448.7	7/2.68	39.5	488.2	28.7	1,561	12,259	0.0644
490/65	54/3.40	490.3	7/3.40	63.6	553.9	30.6	1,866	15,591	0.0590
495/35	45/3.74	494.4	7/2.49	34.1	528.5	29.9	1,636	12,272	0.0584
510/45	48/3.68	510.5	7/2.87	45.3	555.8	30.7	1,770	13,702	0.0566
550/70	54/3.60	549.7	7/3.60	71.3	621.0	32.4	2,092	17,077	0.0526
560/50	48/3.86	561.7	7/3.00	49.5	611.2	32.2	1,954	14,921	0.0514
570/40	45/4.02	571.2	7/2.68	39.5	610.7	32.2	1,889	14,074	0.0506
650/45	45/4.30	653.5	7/2.87	45.3	698.8	34.4	2,163	15,863	0.0442
680/85	54/4.00	678.6	19/2.40	86.0	764.6	36.0	2,570	21,419	0.0426
1045/45	72/4.30	1045.6	7/2.87	45.3	1,090.9	43.0	3,249	22,223	0.0277

# PVC - COVERED ALUMINIUM CONDUCTORS

The PVC - covered conductors have been developed primarily to give protection to telecommunication lines which are crossed by power lines and to give protection to the public from low voltage lines in case of accidental contact for short periods.

The PVC - covered power lines have also been found useful in corrosive atmospheres and for preventing faults due to birds and trees. For such purposes, thickness of covering other than those specified in this catalogue may be used. The conductors are sometimes referred to as "Weather - Resistant Line Wire" and may consist of a single solid wire, or all aluminium stranded conductors (AAC) over which a covering has been applied.

The insulation thickness of Type 8 is intended for use where the operating voltages does not exceed 650V r.m.s. between any two conductors or 250V r.m.s. between any conductor and earth.

## PVC - COVERED ALUMINIUM CONDUCTORS ( BS 6485 and BS 215, Part 1 )

Nominal aluminium wire	Construction, No./Wire diameter	Approx. overall diameter of conductor	Calculated DC resistance at 20°C	Approx. breaking load	Approx. overall diameter of covered conductor		Approx. mass of covered conductor
					Type 8	Type 8	
mm <sup>2</sup>	No./mm	mm	Ohm/Km	kN	mm	Kg/Km	
22	7 / 2.06	6.18	1.227	3.99	8.2	100	
50	7 / 3.10	9.30	0.5419	8.28	11.7	220	
60*	7 / 3.40	10.20	0.4504	9.90	13.0	270	
100	7 / 4.39	13.17	0.2702	16.00	16.0	420	
150*	19 / 3.25	16.25	0.1825	25.70	19.7	610	
200	19 / 3.78	18.90	0.1349	32.40	21.7	760	
250*	19 / 4.22	21.10	0.1083	40.40	24.5	970	

\* Not in BS 6485

# ALUMINIUM 1350 AND ALUMINIUM ALLOY RODS

## CHEMICAL COMPOSITION

Element	Composition (%)			
	1350	6201	6101	1120
Silicon	Max. 0.10	0.5 ~ 0.9	0.4 ~ 0.7	0.10
Iron	Max. 0.40	0.50	0.50	0.40
Copper	Max. 0.05	0.10	0.10	0.05 ~ 0.35
Manganese	Max. 0.01	0.03	0.03	0.01
Magnesium	Max. -	0.6 ~ 0.9	0.4 ~ 0.7	0.20
Chromium	Max. 0.01	0.03	0.03	0.01
Zinc	Max. 0.05	0.10	0.10	0.05
Boron	Max. 0.05	0.06	0.06	0.05
Gallium	Max. 0.03	-	-	0.03
Vanadium & Titanium, total	Max. 0.02	-	-	0.02
Other elements, each	Max. 0.03	0.03	0.03	0.03
Other elements, total	Max. 0.10	0.10	0.10	0.10
Aluminium	Min. 99.50	Remainder	Remainder	99.20

## MECHANICAL AND ELECTRICAL PROPERTIES

Designation	Tensile strength	Conductivity	Volume resistivity
	Kgf/mm <sup>2</sup>	% IACS	Ohm.mm <sup>2</sup> /m
Aluminium 1350 Rod			
1350 - O	6.0 ~ 9.9	61.8	0.027899
1350 - H12 & H22	8.5 ~ 11.9	61.5	0.028035
1350 - H14 & H24	10.5 ~ 14.1	61.4	0.028080
1350 - H16 & H26	11.9 ~ 15.5	61.3	0.028126
Aluminium Alloy Rod *			
6201	16 ~ 19	51	0.033806
6101	16 ~ 19	52	0.033156
1120	17 ~ 18.5	58.8	0.029300

\* The aluminium alloy rod after redraw into the final diameter of wire and under controlled heat treatment will comply with the requirements as per ASTM B 398 and IEC 60104. The aluminium alloy rod will age or harden over time, thus immediate redraw into the final diameter of wire is recommended.

## DIAMETER TOLERANCE

Specified diameter	Deviation of mean diameter from specified diameter	Deviation at any point from specified diameter
mm	mm	mm
9.5	± 0.5	± 0.76
7.6	± 0.4	± 0.61

# APPENDIX :

## TECHNICAL DATA

### PROPERTIES OF ALUMINIUM, ALUMINIUM ALLOY AND COPPER

Characteristics	Unit	Aluminium		Aluminium Alloy Rod			Copper	
		Hard-drawn	Annealed	6201	6101	1120	Hard-drawn	Annealed
Specific gravity	g/cm <sup>3</sup>	2.703	2.703	2.703	2.703	2.703	8.89	8.89
Tensile strength	Kgf/mm <sup>2</sup>	Min. 16	Max. 9.2	16 ~ 19	16 ~ 19	17 ~ 18.5	34 ~ 47	20 ~ 28
Electrical resistivity at 20°C	m Ohm.cm	2.8264	2.803	3.38	3.31	2.93	1.777	1.724
Conductivity at 20°C	% IACS	61	61.5	51	52	58.8	97	100
Temperature coefficient at 20°C	per °C	0.00403	0.00410	0.00347	0.00347	0.00390	0.00381	0.00393
Coefficient of linear expansion	× 10-6 / °C	23	23	23	23	23	17	17
Melting Point	°C			660			1083	

### Mechanical properties of aluminium alloy wires as per ASTM B 398

Nominal diameter ( mm )		Tensile strength ( MPa )		Elongation ( % )
Over	Up to and including	Average for a lot	Individual	Individual
1.5	3.25	330	315	3.0
3.25	4.75	315	305	3.0

### Mechanical properties of aluminium alloy wires as per IEC 60104

Nominal diameter ( mm )		Tensile strength ( MPa )		Elongation ( % )
Over	Up to and including	Minimum		Minimum
---	3.5	325		3.0
3.5	---	315		3.0

## Electrical properties of aluminium alloy wires as per ASTM B 398 and IEC 60104

Nominal diameter ( mm )		Tolerance	Resistivity	Conductivity
Over	Up to and including	( mm )	( Ohm.mm <sup>2</sup> /m )	( % IACS )
---	3.00	± 0.03	0.03284	52.5
3.00	---	± 1%	0.03284	52.5

## Mechanical and electrical properties of aluminium 1120 wires as per AS 1531

Nominal diameter ( mm )		Tensile strength	Elongation	Resistivity	Conductivity
Over	Up to and including	( MPa )	( % )	( Ohm.mm <sup>2</sup> /m )	( % IACS )
1.5	2.5	250	0.8	0.0293	58.8
2.5	3.25	250	1.0	0.0293	58.8
3.25	3.75	240	1.2	0.0293	58.8
3.75	4.00	230	1.2	0.0293	58.8
4.00	4.75	230	1.4	0.0293	58.8

## COMPARISON OF ALUMINIUM AND COPPER CONDUCTORS

Particular	Hard-drawn Aluminium Take annealed copper as 100%		Copper (annealed) Take hard-drawn aluminium as 100%
	%	%	%
<b>For equal sectional area and length</b>			
Weight	30	329	
Resistance	164	61	
Approximate breaking load	41	244	
<b>For equal weight and length</b>			
Area	329	30	
Diameter	180	55	
Resistance	50	200	
Approximate breaking load	137	73	
<b>For equal resistance</b>			
Area	164	61	
Diameter	128	78	
Weight	50	200	
Approximate breaking load	68	147	
<b>For equal current and temperature rise</b>			
Weight	42	237	
Diameter	119	84	

## CURRENT RATING CALCULATION FOR BARE CONDUCTOR ( IEC 61597 )

The symbols used in this section :

$D$	= conductor diameter (m)	$v$	= wind speed (m/s)
$\gamma$	= solar radiation absorption coefficient	$T_1$	= ambient temperature (K)
$S_i$	= intensity of solar radiation ( $\text{W}/\text{m}^2$ )	$T_2$	= final equilibrium temperature (K)
$K_e$	= emissivity coefficient in respect to black body	$I_{\max}$	= current rating (A)
$R_T$	= electrical resistance of conductor at temp. $T$ ( $\Omega/\text{m}$ )		
$Nu$	= Nusselt number : $Nu = 0.65 Re^{0.2} + 0.23 Re^{0.61}$		
$s$	= the Stefan-Boltzmann constant ( $5.67 \times 10^{-8} \text{ W.m}^{-2}.K^{-4}$ )		
$Re$	= the Reynolds number : $Re = 1.644 \times 10^9 v D [ (T_1 + 0.5 (T_2 - T_1)) ]^{-1.78}$		
$\lambda$	= the thermal conductivity of the air film in contact with the conductor, $0.02585 \text{ W.m}^{-1}.K^{-1}$		

### Current Rating Formula

$$I_{\max} = [(P_{\text{rad}} + P_{\text{conv}} - P_{\text{sol}})/RT]^{1/2}$$

(a)  $P_{\text{rad}}$  - the heat loss by radiation of the conductor ( $\text{W}/\text{m}$ )  
 $P_{\text{rad}} = s \pi D K_e (T_2^4 - T_1^4)$

(b)  $P_{\text{conv}}$  - the convection heat loss ( $\text{W}/\text{m}$ )  
 $P_{\text{conv}} = \lambda Nu (T_2 - T_1) \pi$

(c)  $P_{\text{sol}}$  - the solar heat gain by the conductor surface ( $\text{W}/\text{m}$ )  
 $P_{\text{sol}} = \gamma D S_i$

(d)  $R_T$  = the electrical resistance of conductor at a temp.  $T$  ( $\Omega/\text{m}$ )

$$R_T = f(x).R_{T2}$$

$\alpha = 0.00403$  (aluminium)

$\alpha = 0.00360$  (aluminium alloy)

$R_{T2}$  = conductor DC resistance at temperature  $T_2$

$$R_{T2} = R_{20} [1 + \alpha (T_2 - 20)]$$

$$f(x) = 0.99609 + 0.018578x - 0.030263x^2 + 0.020735x^3$$

$D_1$  = conductor diameter in cm

$d_1$  = steel core diameter in cm

For conductor other than ACSR,  $d_1 = 0$  cm

$$x = \frac{0.01 (D_1 + 2d_1)}{(D_1 + d_1)} \left[ \frac{8\pi \cdot f (D_1 - d_1)^{1/2}}{R_{T2} (D_1 + d_1)} \right]$$

### Example

ACSR 30/7/2.59mm  
(BS 215 Part 2)

$$\begin{aligned} D &= 18.13 \text{ mm} \\ v &= 1 \text{ m/s} \\ S_i &= 900 \text{ W/m}^2 \\ \gamma &= 0.5 \end{aligned}$$

$$\begin{aligned} R_{20} &= 0.1828 \text{ ohm/km} \\ T_1 &= 40^\circ\text{C} (313 \text{ K}) \\ T_2 &= 80^\circ\text{C} (353 \text{ K}) \\ K_e &= 0.6 \end{aligned}$$

$$\begin{aligned} d &= 7.77 \text{ mm} \\ f &= 50 \text{ Hz} \\ Re &= 964.6 \end{aligned}$$

### Calculation

$$(a) P_{\text{rad}} = 5.67 \times 10^{-8} \times 3.142 \times 0.01813 \times 0.6 \times (313^4 - 353^4) (\text{W}/\text{m}) = 11.49 \text{ W/m}$$

$$(b) P_{\text{conv}} = 0.02585 \times (0.65 \times 964.6^{0.2} + 0.23 \times 964.6^{0.61}) \times (353 - 313) \times 3.142 (\text{W}/\text{m}) = 57.76 \text{ W/m}$$

$$(c) P_{\text{sol}} = 0.5 \times 0.01813 \times 900 (\text{W}/\text{m}) = 8.16 \text{ W/m}$$

$$(d) R_T = f(x).R_{T2} \\ R_{T2} = 0.1828 [1 + 0.00403(80 - 20)] = 0.2270 \text{ ohm/km} = 0.000227 \text{ ohm/m}$$

$$x = \frac{0.01 (1.813 + 1.554)}{(1.813 + 0.777)} \left[ \frac{8\pi (50)(1.813 - 0.777)^{1/2}}{0.227 (1.813 + 0.777)} \right] = 0.61174$$

$$f(x) = 0.99609 + 0.018578 (0.61174) - 0.030263 (0.61174)^2 + 0.020735 (0.61174)^3 = 1.000877$$

$$RT = 1.000877 \times 0.000227 \text{ ohm/m} = 0.0002272 \text{ ohm/m}$$

$$I_{\max} = [(P_{\text{rad}} + P_{\text{conv}} - P_{\text{sol}})/RT]^{1/2}$$

$$I_{\max} = [(11.49 + 57.76 - 8.16)/0.0002272]^{1/2}$$

$$= 519 \text{ A}$$

## CURRENT RATING CALCULATION FOR BARE CONDUCTOR

The symbols used in this section :

$I$	= current rating (A)	$T_0$	= ambient temperature ( $^{\circ}\text{C}$ )
$d$	= conductor inside diameter (cm)	$T_r$	= temperature difference ( $^{\circ}\text{C}$ )
$D$	= overall diameter (cm)	$\Delta T$	= temperature rise ( $^{\circ}\text{C}$ )
$L$	= unity length (cm)	$W_s$	= solar radiation ( $\text{W/cm}^2$ )
$S$	= aluminium sectional area ( $\text{mm}^2$ )	$f$	= operating frequency (Hz)
$\alpha_{20}$	= temperature coefficient at $20^{\circ}\text{C}$ , 0.004 for Aluminium	$f(x)$	= the skin effect constant
$R$	= effective resistance for unity length (ohm)	$h_w$	= heat dissipated due to wind velocity ( $\text{W}/^{\circ}\text{C.cm}^2$ )
$R_a$	= a.c resistance (ohm/km)	$h_r$	= heat dissipated due to radiation ( $\text{W}/^{\circ}\text{C.cm}^2$ )
$R_{d1}$	= maximum conductor d.c resistance at $100^{\circ}\text{C}$ (ohm/km)	$v$	= wind velocity (m/s)
$R_{d20}$	= conductor d.c resistance at $20^{\circ}\text{C}$ (ohm/km)	$\varepsilon$	= black body radiation coefficient

$$\text{Current Rating, } I(A) = \left[ \frac{\pi \cdot D \cdot L \cdot T_r \{ h_w + \varepsilon [ h_r - W_s / (\pi \cdot T_r) ] \}^{1/2}}{R} \right]$$

where by :

(a) Heat dissipated due to wind velocity,  $h_w$

$$h_w (\text{W}/^{\circ}\text{C.cm}^2) = \frac{5.72 \times 10^{-3}}{(273 + T_0 + 0.5T_r)^{0.123}} \left[ \frac{V}{D} \right]^{1/2}$$

(b) Heat dissipated due to radiation,  $h_r$

$$h_r (\text{W}/^{\circ}\text{C.cm}^2) = \frac{5.67 \times 10^{-12} \{ (273 + T_0 + T_r)^4 - (273 + T_0)^4 \}}{T_r}$$

(c) Effective resistance,  $R$

$$R (\text{ohm}) = R_a \cdot L$$

where by :

$$R_a = f(x) \cdot R_{d1} \quad \text{where as } R_{d1} = R_{d20} (1 + \alpha_{20} \cdot \Delta T)$$

$$f(x) = 0.996\ 09 + 0.018\ 578x - 0.030\ 263x^2 + 0.020\ 735x^3$$

$$x = \frac{0.01 (D + 2d)}{(D + d)} \left[ \frac{8\pi \cdot f \cdot (D - d)^{1/2}}{R_{d1} (D + d)} \right]$$

## CURRENT RATING CALCULATION FOR BARE CONDUCTOR


For ACSR with 3 layers of aluminium,

$$Ra = f(x) \cdot f(x)^1 \cdot Rd^1$$

$$f(x)^1 = 0.999\ 47 + 0.028\ 895x - 0.005\ 9348x^2 + 0.000\ 422\ 59x^3$$

where by :

$$x = I / S \text{ where as } I = \text{current, A ( above)} \text{ and } S = \pi / 4 (D^2 - d^2) \text{ mm}^2$$

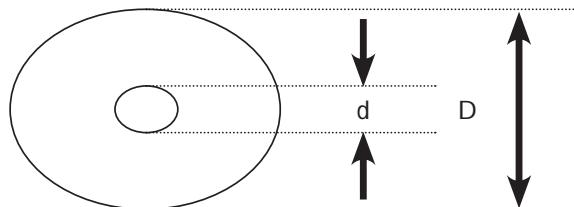

Additional information :

- i) for conductor other than ACSR,  $d = 0 \text{ cm}$
- ii) in most case the following assumption is valid :
  - $W_s = 0.1 \text{ W/cm}^2$
  - $\alpha = 0.9$
  - $L = 1 \text{ cm}$

Example :

Conductor : ACSR 6/1/4.0mm

$d =$	$0.4 \text{ cm}$
$D =$	$1.2 \text{ cm}$
$R_{d20} =$	$0.38 \text{ ohm/km}$

Conditions :

$W_s =$	$0.1 \text{ W/cm}^2$
$v =$	$0.5 \text{ m/s}$
$T_0 =$	$40^\circ\text{C}$
$T_r =$	$60^\circ\text{C}$
$f =$	$50 \text{ Hz}$
$\alpha =$	$0.9$
$L =$	$1 \text{ cm}$

## CURRENT RATING CALCULATION FOR BARE CONDUCTOR

Calculation :

$$h_w = \frac{5.72 \times 10^{-3}}{(273 + 40 + 30)^{0.123}} \left[ \frac{0.5}{1.2} \right]^{\frac{1}{2}} = 0.001801 \text{ W/}^{\circ}\text{C.cm}^2$$

$$h_r = \frac{5.67 \times 10^{-12}}{60} \{ (273 + 40 + 60)^4 - (273 + 40)^4 \} = 0.000922 \text{ W/}^{\circ}\text{C.cm}^2$$

$$R_{d1} = 0.38 \{ 1 + 0.004 (100 - 20) \} = 0.5016 \text{ ohm/km}$$

$$x = \frac{0.01 (1.2 + 0.8)}{(1.2 + 0.4)} \left[ \frac{8\pi (50) (1.2 - 0.4)}{0.5016 (1.2 + 0.4)} \right]^{\frac{1}{2}} = 0.44241$$

$$f(x) = 0.99609 + 0.018578 (0.44241) - 0.030263 (0.44241)^2 + 0.020735 (0.44241)^3 = 1.0001812$$

$$R_a = f(x) \cdot R_{d1} = (1.0001812)(0.5016) = 0.50169 \text{ ohm/km}$$

$$R = (0.50169 \text{ ohm/km}) (1 \text{ cm}) (10^{-5} \text{ km/cm}) = 0.50169 \times 10^{-5} \text{ ohm}$$

Then

**Current Rating,**

$$I(A) = \left[ \frac{\pi(1.2)(1) (60) \{0.001801 + 0.9[0.000922 - 0.1/\pi \cdot 60]\}}{0.50169 \times 10^{-5}} \right]^{\frac{1}{2}}$$

$$= 311.5$$

## WIRE GAUGES

Gauge system		Diameter		Cross-sectional area			Weight of copper	Weight of aluminium
A.W.G.	S.W.G.	mm	mil	mm <sup>2</sup>	sq. mil	CM	kg / km	kg / km
6/0	-	14.732	580	170.5	264200	336400	1515	460.2
5/0	-	13.119	516.5	135.2	209500	266800	1202	365.0
-	7/0	12.700	500	126.7	196400	250000	1126	342.0
-	6/0	11.786	464	109.1	169100	215300	969.9	294.6
4/0	-	11.684	460	107.2	166200	211600	953.2	289.5
-	5/0	10.973	432	94.56	146600	186600	840.6	255.3
3/0	-	10.404	409.6	85.01	131800	167800	755.8	229.5
-	4/0	10.16	400	81.07	125700	160000	720.7	218.9
-	3/0	9.449	372	70.12	108700	138400	623.4	189.3
2/0	-	9.266	364.8	67.43	104500	133100	599.5	182.1
-	2/0	8.839	348	61.36	95110	121100	545.5	165.7
0	-	8.252	324.9	53.49	82910	105600	475.5	144.4
-	0	8.230	324	53.19	82450	105000	472.9	143.6
-	1	7.620	300	45.60	70690	90000	405.4	123.1
1	-	7.348	289.3	42.41	65730	83690	377.0	114.5
-	2	7.011	276	38.60	59830	76180	343.2	104.2
2	-	6.544	257.6	33.63	52120	66370	299.0	90.80
-	3	6.401	252	32.18	49880	63500	286.1	86.88
-	4	5.893	232	27.27	42270	53820	242.4	73.63
3	-	5.827	229.4	26.66	41330	52620	237.0	71.99
-	5	5.385	212	22.77	35300	44940	202.4	61.49
4	-	5.189	204.3	21.15	32780	41730	188.0	57.10
-	6	4.877	192	18.68	28950	36860	166.1	50.43
5	-	4.621	181.9	16.77	26000	33100	149.1	45.28
-	7	4.470	176	15.69	24320	30970	139.5	42.37
6	-	4.115	162	13.30	20620	26250	118.3	35.92
-	8	4.064	160	12.97	20110	25600	115.3	35.02
7	-	3.665	144.3	10.55	16350	20820	93.78	28.48
-	9	3.658	144	10.51	16290	20740	93.41	28.37
8	-	3.264	128.5	8.367	12970	16510	74.39	22.59
-	10	3.251	128	8.302	12870	16380	73.80	22.42
-	11	2.946	116	6.818	10570	13460	60.61	18.41
9	-	2.906	114.4	6.633	10280	13090	58.96	17.91
-	12	2.642	104	5.481	8495	10820	48.72	14.80
10	-	2.588	101.9	5.261	8155	10380	46.77	14.21
-	13	2.337	92	4.289	6648	8465	38.13	11.58
11	-	2.305	90.74	4.172	6467	8234	37.09	11.26
12	-	2.053	80.81	3.309	5129	6531	29.42	8.935
-	14	2.032	80	3.243	5027	6400	28.83	8.756
-	15	1.829	72	2.627	4072	5185	23.35	7.093
13	-	1.828	71.96	2.624	4067	5178	23.33	7.085
14	-	1.628	64.08	2.081	3225	4107	18.50	5.618
-	16	1.626	64	2.075	3217	4096	18.45	5.604
15	-	1.450	57.07	1.650	2558	3257	14.67	4.456
-	17	1.422	56	1.589	2463	3136	14.13	4.290
16	-	1.291	50.82	1.309	2029	2583	11.63	3.534
-	18	1.219	48	1.167	1810	2304	10.38	3.152
17	-	1.150	45.26	1.0380	1609	2048	9.226	2.802
18	-	1.024	40.3	0.8227	1275	1624	7.314	2.221
-	19	1.016	40	0.8107	1257	1600	7.207	2.189
-	20	0.9144	36	0.6567	1018	1296	5.838	1.773
19	-	0.9117	35.89	0.6529	1012	1288	5.804	1.763
-	21	0.8128	32	0.5189	804.2	1024	4.613	1.401
20	-	0.8116	31.95	0.5174	801.9	1021	4.600	1.397
21	-	0.7230	28.46	0.4105	636.3	810.1	3.649	1.108

## WIRE GAUGES

Gauge system		Diameter		Cross-sectional area			Weight of copper	Weight of aluminium
A.W.G.	S.W.G.	mm	mil	mm <sup>2</sup>	sq. mil	CM	kg / km	kg / km
-	22	0.7112	28	0.3973	615.8	784.0	3.532	1.073
22	-	0.6439	25.35	0.3256	504.7	642.6	2.895	0.8792
-	23	0.6096	24	0.2919	452.4	576.0	2.595	0.7880
23	-	0.5733	22.57	0.2581	400.1	509.4	2.295	0.6970
-	24	0.5588	22	0.2452	380.1	484.0	2.180	0.6622
24	-	0.5106	20.1	0.2047	317.3	404.0	1.820	0.5528
-	25	0.5080	20	0.2027	314.2	400.0	1.802	0.5472
-	26	0.4572	18	0.1642	254.5	324.0	1.460	0.4433
25	-	0.4546	17.9	0.1623	251.6	320.4	1.443	0.4383
-	27	0.4166	16.4	0.1363	211.3	269.0	1.212	0.3680
26	-	0.4049	15.94	0.1288	199.6	254.1	1.145	0.3477
-	28	0.3759	14.8	0.1110	172.0	219.0	0.9867	0.2997
27	-	0.3606	14.2	0.1021	158.3	201.5	0.9077	0.2757
-	29	0.3454	13.6	0.09372	145.3	185.0	0.8332	0.2530
28	-	0.3211	12.64	0.08097	125.5	159.8	0.7198	0.2186
-	30	0.3150	12.4	0.07791	120.8	153.8	0.6926	0.2104
-	31	0.2947	11.6	0.06819	105.7	134.6	0.6062	0.1841
29	-	0.2860	11.26	0.06422	99.54	126.7	0.5709	0.1734
-	32	0.2743	10.8	0.05908	91.58	116.6	0.5252	0.1595
30	-	0.2548	10.03	0.05097	79.01	100.6	0.4531	0.1376
-	33	0.2540	10	0.05067	78.54	100.0	0.4505	0.1368
-	34	0.2337	9.2	0.04289	66.48	84.64	0.3813	0.1158
31	-	0.2268	8.928	0.04039	62.60	79.71	0.3590	0.1090
-	35	0.2134	8.4	0.03575	55.42	70.56	0.3178	0.09653
32	-	0.2019	7.95	0.03203	49.64	63.20	0.2847	0.08647
-	36	0.1930	7.6	0.02927	45.36	57.76	0.2602	0.07902
33	-	0.1798	7.08	0.02540	39.37	50.13	0.2258	0.06858
-	37	0.1727	6.8	0.02343	36.32	46.24	0.2083	0.06326
34	-	0.1602	6.305	0.02014	31.22	39.75	0.1791	0.05439
-	38	0.1524	6	0.01824	28.27	36.00	0.1622	0.04925
35	-	0.1426	5.615	0.01597	24.76	31.53	0.1420	0.04313
-	39	0.1321	5.2	0.01370	21.24	27.04	0.1218	0.03700
36	-	0.1270	5	0.01267	19.63	25.00	0.1126	0.03420
-	40	0.1219	4.8	0.01167	18.10	23.04	0.1038	0.03152
37	-	0.1131	4.453	0.01005	15.57	19.83	0.08931	0.02713
-	41	0.1118	4.4	0.009810	15.21	19.36	0.08721	0.02649
-	42	0.1016	4	0.008107	12.57	16.00	0.07207	0.02189
38	-	0.1007	3.965	0.007968	12.35	15.72	0.07084	0.02151
-	43	0.09140	3.6	0.006567	10.18	12.96	0.05838	0.01773
39	-	0.08970	3.531	0.006319	9.794	12.47	0.05618	0.01706
-	44	0.08128	3.2	0.005189	8.042	10.24	0.04613	0.01401
40	-	0.07988	3.145	0.005012	7.768	9.891	0.04456	0.01353
41	45	0.07113	2.8	0.003973	6.159	7.842	0.03532	0.01073
42	-	0.06334	2.494	0.003151	4.884	6.219	0.02801	0.008508
-	46	0.06069	2.4	0.002919	4.524	5.760	0.02595	0.007880
43	-	0.05641	2.221	0.002499	3.873	4.932	0.02222	0.006747
-	47	0.05080	2	0.002027	3.142	4.000	0.01802	0.005472
44	-	0.05023	1.978	0.001982	3.072	3.911	0.01762	0.005351
45	-	0.04474	1.761	0.001572	2.436	3.102	0.01397	0.004244
-	48	0.04064	1.6	0.001297	2.011	2.560	0.01153	0.003502
46	-	0.03984	1.568	0.001246	1.932	2.460	0.01108	0.003365
47	-	0.03548	1.397	0.0009884	1.532	1.951	0.008787	0.002669
48	-	0.03159	1.244	0.0007838	1.215	1.547	0.006968	0.002116
-	49	0.03048	1.2	0.007297	1.131	1.440	0.006487	0.00197
49	-	0.02813	1.108	0.0006216	0.9635	1.227	0.005526	0.001678
-	50	0.02540	1	0.0005067	0.7854	1.000	0.004505	0.001368
50	-	0.02505	0.9863	0.0004929	0.7641	0.9728	0.004382	0.001331

## COMMON CONVERSION FACTOR

Equivalent				Reciprocal	
Mass					
1	cwt	=	50.802	kg	0.0197
1	oz	=	28.349	gm	0.0352
1	lb	=	0.4536	kg	2.2046
1	lb	=	0.00454	tonne ( metric )	220.26
1	ton ( long )	=	1.016	tonne ( metric )	0.09842
Length					
1	in	=	25.4	mm	0.03937
1	ft	=	0.3048	mm	3.2808
1	yd	=	0.9144	mm	1.0936
1	mile	=	1.6093	km	0.6214
Area					
1	in <sup>2</sup>	=	645.16	mm <sup>2</sup>	0.00155
1	ft <sup>2</sup>	=	0.0929	m <sup>2</sup>	10.7642
1	yd <sup>2</sup>	=	0.8361	m <sup>2</sup>	1.196
Volume					
1	in <sup>3</sup>	=	16.387	cm <sup>3</sup> ( ml or cc )	0.061
1	ft <sup>3</sup>	=	0.0283	m <sup>3</sup>	35.3335
1	ft <sup>3</sup>	=	6.229	gal ( Imp )	0.1605
1	ft <sup>3</sup>	=	28.328	l	0.0353
1	yd <sup>3</sup>	=	0.7645	m <sup>3</sup>	1.3079
1	gal ( USA )	=	0.8327	gal ( Imp )	1.2009
Force					
1	lbf	=	0.4535	kgf	2.2046
1	kgf	=	9.8065	N	0.1019
1	ton ( long ) f	=	9.964	kN	0.10036
Pressure and Stress					
1	atm	=	0.1013	MPa	9.869
1	atm	=	1.0133	bar	0.9869
1	lbf / in <sup>2</sup> ( psi )	=	6.894	kN / mm <sup>2</sup> ( kPa )	0.145
1	bar	=	1.0197	kgf / cm <sup>2</sup>	0.09806
Energy ( Work and Heat )					
1	HPh	=	2544.5	Btu	0.00393
1	Btu	=	0.000293	kW.h	3413
1	Btu	=	1.0551	kJ	0.9478
1	Btu	=	107.59	kgf.m	0.00929
1	cal	=	4.187	J	0.239

1 mil = 0.001 in = 0.0254 mm

1 CM ( Circular mil ) =  $0.7854 \times 10^{-6}$  in<sup>2</sup> = 0.5067 x 10<sup>-3</sup>mm<sup>2</sup>

## FORMULA FOR ELECTRIC CALCULATION

To Calculate	Given	D.C.	A.C. single phase	A.C. 3 phase
Current (A)	kW	$A = \frac{1000 \times kW}{V}$	$A = \frac{1000 \times kW}{V \times pf}$	$A = \frac{1000 \times kW}{1.73 \times V \times pf}$
Current (A)	kVA	---	$A = \frac{1000 \times kVA}{V}$	$A = \frac{1000 \times kVA}{1.73 \times V}$
Current (A)	hp	$A = \frac{746 \times hp}{V \times eff}$	$A = \frac{746 \times hp}{V \times eff \times pf}$	$A = \frac{746 \times hp}{1.73 \times eff \times pf}$
Power (kW)	VA	$kW = \frac{A \times V}{1000}$	$kW = \frac{A \times V \times pf}{1000}$	$kW = \frac{1.73 \times A \times V \times pf}{1000}$
Apparent Power (kVA)	VA	---	$kW = \frac{A \times V}{1000}$	$kW = \frac{1.73 \times A \times V}{1000}$

pf - Power factor of equipment or system under consideration

eff - Efficiency of motor or machinery

V - Line voltage

## PUBLICATIONS REFERRED TO

AS 1531	Conductors - Bare Overhead - Aluminium And Aluminium Alloy
AS 3607	Conductors - Bare Overhead, Aluminium And Aluminium Alloy -Steel Reinforced
ASTM B 230	Specification For Aluminium 1350 - H19 Wire For Electrical Purposes
ASTM B 231	Specification For Concentric-Lay-Stranded Aluminium 1350 Conductors
ASTM B 232	Specification For Concentric - Lay - Stranded Aluminium Conductor - Steel Reinforced (ACSR).
ASTM B 398	Specification For Aluminium - Alloy 6201-T81 Wire For Electrical Purposes
ASTM B 399	Specification For Concentric - Lay - Stranded Aluminium Alloy 6201 - T81 Conductors.
ASTM B 498	Specification For Zinc-Coated (Galvanized) Steel Core Wire For Aluminium Conductors, Steel Reinforced (ACSR)
ASTM B 606	Specification For High-Strength Zinc-Coated (Galvanized) Steel Core Wire For Aluminium And Aluminium - Alloy Conductors, Steel Reinforced
BS 183	Specification For General Purpose Galvanized Steel Wire Strand
BS 215	Specification For Aluminium Conductors And Aluminium Conductors Steel - Reinforced - For Overhead Power Transmission. Part 1 - Aluminium Stranded Conductors Part 2 - Aluminium Conductors, Steel - Reinforced
BS 2627	Specification For Wrought Aluminium For Electrical Purposes
BS 3242	Specification For Aluminium Alloy Stranded Conductors For Overhead Power Transmission
BS 4565	Specification For Galvanized Steel Wire For Aluminium Conductors, Steel-Reinforced
BS 6485	Specification For PVC - Covered Conductors For Overhead Power Lines
DIN 48 201 Part 5	Aluminium Stranded Conductors
DIN 48201, Part 6	E-AlMgSi Stranded Conductors
DIN 48 204	Steel Reinforced Aluminium Stranded Conductors
JIS C 3108	Hard - Drawn Aluminium Wires For Electrical Purposes
JIS C 3109	Hard - Drawn Aluminium Stranded Conductors
JIS C 3110	Aluminium Conductors Steel Reinforced
MS 1143	Specification For Aluminium Alloy Stranded Conductors For Overhead Power Transmission

The manufacturer reserves the right to modify or vary the construction or specification of any of the products at their discretion and without prior notice. The information contained herein is in line with the appropriate standards and sound electrical practice - it is believed to be reliable but as each applicant is unique, the manufacturer can accept no responsibility as to the suitability of any products for a particular use, or for any errors or omissions, unintentional or otherwise.