


96M0434


## Self-contained Photoelectric Sensor **PZ-V/PZ-M**


#### Instruction Manual




#### Connections

#### Circled numbers 1 to 4 represent the connector pin numbers.

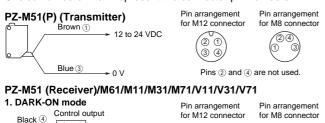




#### 2. LIGHT-ON mode



\* Be sure to connect the pink cable (output control) to the 12 to 24 VDC or 0 V terminal.

#### PZ-M51P (Receiver)/M61P/M11P/M31P/M71P/V11P/V31P/V71P

#### 1. DARK-ON mode






Pin arrangement

for M8 connector

Pin arrangement


1

#### 2. LIGHT-ON mode



 $^{\ast}\,$  Be sure to connect the pink cable (output control) to the 12 to 24 VDC or 0 V terminal.

**Note:** The connector sensors will be released in the near future. Refer to "Model List" for the model of the connector sensor.

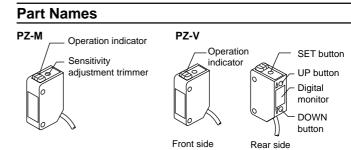

#### Sensitivity Adjustment

#### PZ-V (Digital type)

#### • To detect a moving target (Fully-automatic calibration)

Operation	Procedure	Adjustment		
		Pass a target through the optical axis while pressing the SET button.		
	2	Confirm that "5EL" flashes on the monitor.		
3		Release the SET button. The preset value flashes several times before the normal display appears.		

#### • To detect a stationary target (Two-point calibration)

Operation		Procedure	Adjustment
		1	With no target, press the SET button and release it. "5EE" and the current distance flash alternately.
		2	With the target in place, press and release the SET button. The preset value flashes several times before the normal display appears.

#### To obtain maximum sensitivity (Maximum sensitivity setting)

Operation	Procedure	Adjustment		
6	1	With no target, press the SET button for three seconds or more.		
Ur I	2	Confirm that "5EL" flashes on the monitor.		
	3	Release the SET button. The preset value flashes several times before the normal display appears.		

**Note:** If the green LED turns off or " - - - " flashes after the calibration, the sensitivity has no allowance. In such a case, adjust the sensor head position, and calibrate again.

#### • Fine sensitivity adjustment

- When the ⊲ or ▷ button is pressed and released, the numerical value flashes (approx. 2 seconds). This is the preset value. If the ⊲ or ▷ button is pressed again while the preset value flashes, the preset value can be increased or decreased.
- When the ⊲ or ▷ button is held down for 3 seconds or more, the preset value increases/decreases continuously.

#### Other functions

Function	Operation	Description	Display
Display selection	Press the ⊲ and ▷ buttons simul- taneously and release them.	Change the display as shown on the right.	I2∃ ON OFF   □istance ON/OFF   display display
Key-lock	Press the ⊲ and ▷ buttons simul- taneously for three seconds or more.	Lock the operation buttons to avoid the preset value from being accidentally changed.	Loc flashes and then the normal display appears.
Key-lock cancel	Press the ⊲ and ▷ buttons simul- taneously for three seconds or more.	Unlock the operation buttons to allow the preset value to be changed.	unt flashes and then the normal display appears.

#### Distance display

- The greater the distance between the target and the sensor head, the larger the displayed value becomes.
- If the target or background is out of the detectable range, 999 is displayed.

**Note 1:** The distance value indicates a reference value only. It is not an absolute distance.

**Note 2:** If the target approaches the sensor head closer than the specified range, the displayed value may increase.

#### Sensitivity Adjustment

#### PZ-M (Trimmer type)

#### DARK-ON mode (When LIGHT-ON mode is selected, refer to the description in parentheses.)

	Proce- dure	Operation	Trimmer	Indicators	Adjustment
Thrubeam type	1		ک Max.		With the target in place, turn the trimmer to "Max." With the receiver in place, move the transmitter up/down and right/left. Set the transmitter at the midpoint of the range where the green LED is lit. Secure the transmitter and adjust the receiver position in the same way.
Thrube	2		Max.	Green ●〈●〉 Orange● ⟨·☆›〉	Turn the trimmer counterclockwise from Max. until the green LED turns off. Assume the position as Point A.
	3		A Optimal position Max.	Green ¦ặ-⟨:ặ·⟩ Orange● ⟨:ặ·⟩	Set the trimmer midway between point A and Max. Confirm sensor operation.

#### · LIGHT-ON mode (When DARK-ON mode is selected, refer to the description in parentheses.)

	Proce- dure	Operation	Trimmer	Indicators	Adjustment
ctive type	1	- <u></u>	(B) <sub>A</sub>	Green ●〈●〉 Orange ☆〈●〉	With no target, turn the trimmer clockwise until the orange indicator illuminates (turns off) and assume the position as Point A. If the LED does not illuminate (turn off) even with the trimmer at Max., use Max. as Point A.
Multi-reflective	2	>-[]	<u>ل</u>	Green ●〈●〉 Orange ☆〈●〉	With the target in place, turn the trimmer counterclockwise from Point A until the green LED turns off. Assume the position as Point B.
nΜ	3		B Optimal position A	Green ở (ở (ở ) Orange ở ( ● )	Set the trimmer midway between points A and B. Confirm sensor operation.

\* The adjustment for the retroreflective type is the same as for the thrubeam type.

#### Specifications

#### Retroreflective **Multi-reflective** Туре Thrubeam Model PZ-M51 PZ-M61 1. PZ-M11 1. PZ-M31 1. PZ-M71 1. PZ-V11 1 PZ-V31 1. PZ-V71 1. 0.1 to 1.5 m 5 to 100 mm 5 to 300 mm 20 to 900 mm 5 to 100 mm 5 to 300 mm 20 to 900 mm 10 m Detecting distance <sup>2</sup> (When R-5 (10 x 10 cm (30 x 30 cm (10 x 10 cm (30 x 30 cm (10 x 10 cm (10 x 10 cm white paper) 40 to 300 mm white paper) 150 to 900 mm white paper) 40 to 300 mm reflector is used white paper) white paper) white paper) 30 to 100 mm 30 to 100 mm 150 to 900 mm Setting distance (10 x 10 cm white paper) white paper) white paper) white paper) white paper) white paper) Light source Red LED Infrared LED Red LED Infrared LED Sensitivity adjustment 1-turn trimmer (230°) Automatic calibration Response time 1.5 ms max 1 ms max. (1.2 ms max. with alternate-frequency type, 2 ms max. with M65 only 1.) Operation mode LIGHT-ON/DARK-ON (selectable by wiring) Output: Orange LED, Stable operation: Green LED Indicators <sup>3</sup> Digital monitor 7-segment 3-digit red LED NPN open-collector 100 mA max. (30 V max.), Residual voltage 1 V max. PNP open-collector 4 100mA max. (26.4V max.), Residual voltage 1 V max Control output Protective circuit Reversed polarity protection, Overcurrent protection, Surge absorbe Power supply 12 to 24 VDC ±10%, Ripple (P-P) 10% max T: 24 mA max. Current consumption 34 mA max. 30 mA max 38 mA max. 37 mA max. 45 mA max. 27 mA max Enclosure rating IP-67 Incandescent lamp: 5000 <sup>5.</sup> lux max., Sunlight: 20000 lux max Ambient light -20 to +55°C (-4 to 158°F), No freezing Ambient temperature Relative humidity 35 to 85%, No condensation Vibration 10 to 55 Hz, 1.5 mm double amplitude in X, Y and Z directions, 2 hours respectively Shock 1000 m/s $^2$ in X, Y and Z directions, six times each Housing material Glass-fiber reinforced resin Weight T: Approx.50 g Approx. 55 a Approx. 70 a Approx. 70 a Approx. 55 a (including 2-m cable) R: Approx.55 g

1. The alternate-frequency type is indicated by replacing "1" at the end of model name with "5". The models are PZ-M65, M15, M35, M75, V15 V35 and V75.

2. The detecting distance is obtained with the maximum sensitivity.

3. The transmitter of the PZ-M51 features a power indicator only.

4. The PNP-output type sensor is suffixed with P after the model name.

5. 3000 lux max for the PZ-M71P/V71P.

#### Options

The optional slit plate and polarizing filter are available for the PZ-M51 thrubeam type. Model: A-4 (A set of three types of slit plates and a polarizing filter.)

	Slit plate			
Slit width (mm)	0.5	1	2	
Detecting distance (mm)	500	1000	2000	
Target size (mm)	0.5 x 5	1 x 5	2 x 5	

	Slit plate + Polarizing filter			
Slit width (mm)	No slit	0.5	1	2
Detecting distance (mm)	4000	200	600	1300
Target size (mm)	6 x 6	0.50 x 5	1 x 5	2 x 5

#### Model List


			Cable type	M8 connector type	M12 connector type
Thrubeam		PZ-M51	PZ-M52	PZ-M53	
Retrorefrective		PZ-M61	PZ-M62	PZ-M63	
	100 mm	Digital	PZ-V11	PZ-V12	PZ-V13
		Trimmer	PZ-M11	PZ-M12	PZ-M13
Multi-	300 mm	Digital	PZ-V31	PZ-V32	PZ-V33
reflective		Trimmer	PZ-M31	PZ-M32	PZ-M33
	900 mm	Digital	PZ-V71	PZ-V72	PZ-V73
		Trimmer	PZ-M71	PZ-M72	PZ-M73

# **Mutual Interference**

- The alternate-frequency type allows mutual interference suppression up to two sensors.
- The alternate-frequency type is not available for the thrubeam type.
- To suppress the mutual interference with the thrubeam type or with three or more sensors, contact KEYENCE.


#### **Sensor Head Orientation**

To detect a moving target, consider orientation of the sensor head according to the direction of the movement.



If you want to mount the sensor head in an orientation other than the above, contact KEYENCE.


#### Dimensions

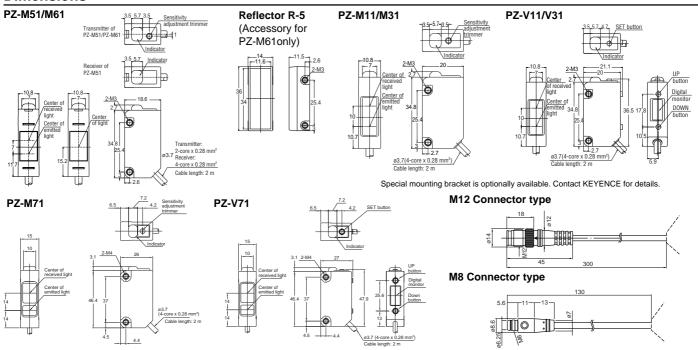


#### I/O Circuit

Circled numbers 1 to 4 represent the connector pin numbers.


#### PZ-M51(P) (Transmitter)



#### PZ-M51 (Receiver)/M61/M11/M31/V11/V31



#### PZ-M51P (Receiver)/M61P/M11P/M31P/V11P/V31P



### Hints On Correct Use

#### 

- The PZ-V/PZ-M series is designed only to detect a target. Do not use it in a safety circuit to protect human body.
- The PZ-V/PZ-M series does not have explosion-proof structure. Do not use it in the atmosphere where flammable gas, liquid or powder exists.
- To extend the cable length, use a cable with at least a 0.3 mm<sup>2</sup> nominal cross-section area. Limit the length of cable extension to no more than 100 m.
- If the amplifier cable is placed together with power lines or high voltage lines in the same conduit, a detection error may occur due to noise interference, or the sensor may be damaged. Isolate the amplifier cable from these lines.
- When using a commercially available switching regulator, ground the frame ground terminal and ground terminal.
- Do not use the PZ-V/PZ-M series outdoors or in a place where extraneous light can enter the light-receiving surface directly.
- When the multi-reflective type is used for the detection of a target with high reflectivity (e.g. mirror-surfaced object), proper detection or distance adjustment may be disabled. In such a case, tilt the sensor head at some angle.
- During maximum sensitivity setting, the detecting distance may vary due to a difference in characteristics of each unit.

### WARRANTIES (MUST ACCOMPANY THE PRODUCTS)

KEYENCE, at its sole option, will refund, repair or replace at no charge any defective Products within 1 year from the date of shipment. Unless stated otherwise herein, the Products should not be used internally in humans, for human transportation, as safety devices or fail-safe systems. EXCEPT FOR THE FOREGOING, ALL EX-PRESS, IMPLIED AND STATUTORY WARRANTIES, INCLUDING WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE AND NON-INFRINGEMENT OF PROPRIETARY RIGHTS, ARE EXPRESSLY DISCLAIMED. KEYENCE SHALL NOT BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, CONSEQUENTIAL OR OTHER DAMAGES, EVEN IF DAMAGES RESULT FROM THE USE OF THE PRODUCTS IN ACCORDANCE WITH ANY SUGGESTIONS OR INFORMATION PROVIDED BY KEYENCE. In some jurisdictions, some of the foregoing warranty disclaimers or damage limitations may not apply.

3

- Be sure to check that the wiring is properly established. Improper wiring may cause a decrease in sensitivity or overheating and sensor damage. (See "I/O Circuit".)
- To mount the sensor, use an M3 screw (coarse thread). Limit the tightening torque to 0.6 N•m or less.
- To mount PZ-M71/V71, use an M4 screw (coarse thread). Limit the tightening torque to 0.7 N•m or less.
- To attach the R-5 reflector, use an M3 screw (coarse thread). Limit the tightening torque to 0.3 N•m or less.
- The displayed value may vary depending on the surrounding environment, such as temperature change or dust.
- Use a stable power supply. The sensor cannot operate properly if the power supply is unstable at power-on or if the ripple exceeds the specified range.

# **KEYENCE**

#### KEYENCE CORPORATION

1-3-14, Higashi-Nakajima, Higashi-Yodogawa-ku, Osaka, 533-8555, Japan PHONE: +81-6-6379-2211 FAX: +81-6-6379-2131

#### AFFILIATED COMPANIES

KEYENCE CORPORATION OF AMERICA PHONE: 201-930-0100 FAX: 201-930-0099 KEYENCE DEUTSCHLAND GmbH PHONE: 06102-36 89-0 FAX: 06102-36 89-100 **KEYENCE (UK) LIMITED** PHONE: 01908-696900 FAX: 01908-696777 **KEYENCE FRANCE S.A.** PHONE: 01 47 92 76 76 FAX: 01 47 92 76 77 KEYENCE SINGAPORE PTE LTD. PHONE: 392-1011 FAX: 392-5055 KEYENCE (MALAYSIA) SDN BHD PHONE: 03-252-2211 FAX: 03-252-2131 KEYENCE (THAILAND) CO., LTD. PHONE: 02-369-2777 FAX: 02-369-2775 KEYENCE TAIWAN CO., LTD. PHONE: 02-2627-3100 FAX: 02-2798-8925 **KEYENCE KOREA CORPORATION** PHONE: 02-563-1270 FAX: 02-563-1271 © KEYENCE CORPORATION, 2000 0061-1 96M0434 Printed in Japan

Downloaded from Arrow.com.