

INSTALLATION AND OPERATION MANUAL

fullriverbattery.com

CONGRATULATIONS ON YOUR PURCHASE OF A FULLRIVER BATTERY!

Maximize the performance of your new battery by thoroughly reading this manual

FULLRIVER BATTERY USA

4030 Adolfo Road Camarillo, CA 93012

Toll Free: (800) 522-8191 Int'l: (805) 484-7900

WWW.FULLRIVERBATTERY.COM

This publication is protected by copyright. All rights are reserved. At no point, may any part of this publication be copied, reproduced, or transmitted by any means or any format without prior written consent from Fullriver Battery.

Fullriver Battery is not liable for direct, indirect, special, exemplary, incidental or consequential damages that may result from any information provided in or omitted from this manual, under any circumstances.

Fullriver Battery reserves the right to make adjustments to this manual at any time, without prior notice or obligation.

Fullriver Battery and the Fullriver Battery logo are registered trademarks of Fullriver Battery Mfg. Co. Ltd.

Table of Contents

| 1. | GETTING STARTED. 2 1.1 - Safety 1.2 - Equipment checklist |
|----|---|
| 2. | INSTALLATION. 2.1 - Selecting the appropriate cable size 2.2 - Terminal connections 2.3 - Battery orientation 2.4 - Series connections 2.5 - Parallel connections 2.6 - Series / parallel connections 2.7 - Cross tying batteries in parallel packs 2.8 - Charging batteries before use |
| 3. | OPERATION |
| 4. | CHARGING |
| 5. | STORAGE |
| 6. | TESTING |
| 7. | YOUR CLEAN-GREEN ENERGY SOLUTION |
| 8. | TRANSPORATION INFORMATION |
| A. | APPENDIX |

WW.FULLRIVERBATTERY.COM PAGE C



INSTALLATION AND OPERATION MANUAL

Getting Started

Before installing your Fullriver battery, please adhere to the following safety guidelines and make sure that you have the proper equipment for installation, operation and diagnostic testing.

1.1 - SAFETY

PROTECT YOURSELF AND PROTECT YOUR BATTERY

- Wear protective gear, including gloves, when handling a battery.
- Install and remove a battery using the lifting handles provided.
- Use a wrench with a rubber coated handle for installing, tightening, or removing battery connections.
- Do not place any objects on top of a battery.
- Do not smoke near a battery.
- Keep flames, sparks and metal objects away from a battery.
- Charge batteries in a ventilated area although AGM batteries typically do not release gas. The safety valve may open to alleviate excess pressure if the battery is over-charged.

ALWAYS USE CAUTION AROUND A BATTERY

1.2 - EQUIPMENT CHECKLIST

- **✓** Gloves
- ☑ Wrench with insulated / rubber coated handle
- ✓ Voltmeter
- **☑** Charger
- ☑ Discharger (if available)

Proper battery installation is the first step in getting the best performance out of your Fullriver battery.

2.1 - SELECTING THE APPROPRIATE CABLE SIZE

Cables must be sized to carry the maximum expected load. Under-sized cables can result in over-heating, melted connections and are a potential fire hazard.

Refer to **TABLE 1** below for the current carrying capacity by cable size. These values are for cable lengths of 6 feet (1.83 meters) or less. It is preferable that all cables in a series connection or in a parallel connection are the same length.

| Cable Gauge (AWG) | Ampacity (Amps) |
|-------------------|-----------------|
| 14 | 25 |
| 12 | 30 |
| 10 | 40 |
| 8 | 55 |
| 6 | 75 |
| 4 | 95 |
| 2 | 130 |
| 1 | 150 |
| 1/0 | 170 |
| 2/0 | 265 |
| 3/0 | 360 |

TABLE 1



To significantly reduce the amount of heat generated at the terminals, use cables with solder-dipped ends.

W.FULLRIVERBATTERY.COM PAGE 3

Installation

2.2 - TERMINAL CONNECTIONS

Terminal connections must be tightened using the correct torque values as defined in **TABLE 2** below. Over or under tightened connections can result in terminal breakage, over-heating and/or meltdown. Using the proper torque value will provide optimum conductivity. To avoid a short circuit, use a wrench with an insulated or rubber coated handle when making terminal connections. See **DIAGRAM 1** below for proper washer placement.

| Terminal Type | ft-lbs | in-lbs | Nm |
|------------------------------|------------|-----------|------------|
| AP, DT (AP), M6, M6M (stud), | 4.2 - 6.0 | 50 - 70 | 5.6 - 7.9 |
| TP07 (AP), TP08 (AP) | | | |
| FR45 | 6.0 - 7.5 | 70 - 90 | 7.9 - 10.1 |
| M8 | 7.1 - 8.0 | 85 - 95 | 9.6 - 10.7 |
| DT (stud), M10M (stud) | 9.2 - 10.4 | 110 - 125 | 12.2 - 14 |

TABLE 2



NEVER place a washer between the mating surfaces of the terminals and cables. This will compromise electrical transmission and increase resistance, resulting in extreme heat generation and probable terminal melting.

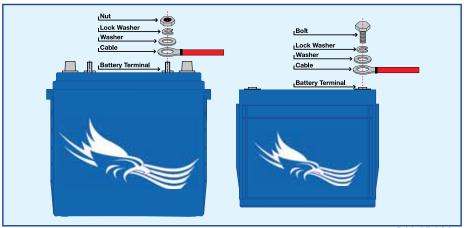


DIAGRAM 1



Loctite® Threadlocker may be used to better secure the terminal connections. Be careful not to get Loctite® between the mating surfaces of the terminal.

2.3 - BATTERY ORIENTATION

The ideal placement of batteries is upright. AGM batteries can be placed on their side if necessary. It is preferred that all the batteries within a pack be placed in the same orientation.



NEVER place batteries in an inverted orientation.

2.4 - SERIES CONNECTIONS

There is more than one option to meet your voltage requirements. For example, for a 12 volt system, you may use one (1) 12 volt battery or two (2) 6 volt batteries wired in a series to make up the 12 volts. You may use as many batteries as you need to make up the system voltage. Connect the positive of one battery to the negative of the next through the entire string. See **DIAGRAM 2** below for the proper series connection.

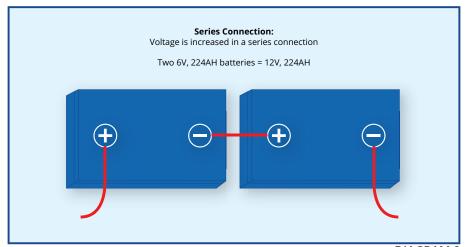


DIAGRAM 2

Installation

2.5 - PARALLEL CONNECTIONS

There is more than one option to meet your energy requirements. For example, to meet the requirements for a 210 Amp-Hour system, you may use one (1) 210 Amp-Hour battery or two (2) 105 Amp-Hour batteries wired in parallel to make up the 210 Amp-Hours. Connect all the positive terminals together and all the negative terminals together in the string. See **DIAGRAM 3** below for proper parallel connection.

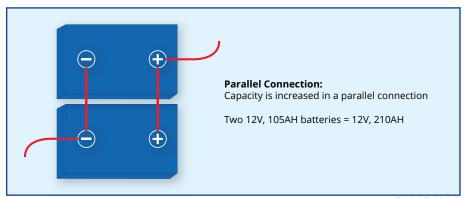


DIAGRAM 3

2.6 - SERIES / PARALLEL CONNECTIONS

Batteries can be connected in both series and parallel to attain the desired system voltage and energy requirements. See **DIAGRAM 4** below for proper series / parallel connections.

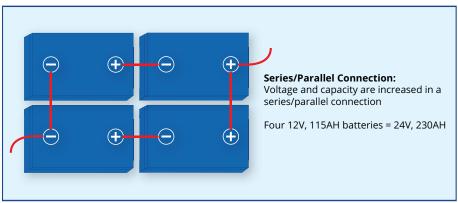


DIAGRAM 4



For optimum performance, the systems positive and negative leads should be connected diagonally opposite (catty-corner) from each other.

2.7 - CROSS TYING BATTERIES IN PARALLEL PACKS

In order to maintain balance in parallel battery packs, it is best to cross tie the batteries. This method of connection will maximize the performanceand life of your battery system. Cross-tying batteries means connecting positive to positives and negatives to negatives of each adjacent battery in the set. See **DIAGRAM 5** below for proper cross tying connections. The dotted lines represent the cross tied cables.

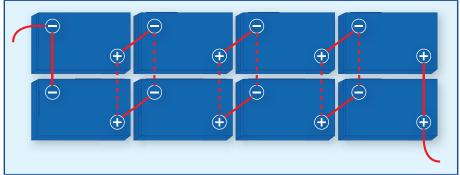


DIAGRAM 5



Leave some space between batteries for airflow and minor battery expansion.

2.8 - CHARGING BATTERIES BEFORE USE

New AGM batteries that have only been stored up to six months will not need to be charged prior to being put into service.

If new AGM batteries have been stored for more than six months, and/or in an exceptionally hot environment, a charge may be necessary prior to being put into service. Also, if the batteries are not charged prior to being put into service, you may experience a slight reduction in range on the first cycle.

| Battery Nominal Voltage | Open Circuit Voltage (O.C.V.) |
|-------------------------|-------------------------------|
| 2 Volt | < 2.0 Volts |
| 6 Volt | < 6.2 Volts |
| 8 Volt | < 8.3 Volts |
| 12 Volt | < 12.5 Volts |

TABLE 3


Check the open circuit voltage (O.C.V.) of each battery in the set and if any battery within the set is less than the values in **TABLE 3** below, recharge the battery set. If the charger has a maintenance mode, select that mode to boost charge the batteries. Otherwise, run the normal charge cycle.

Operation

The performance and life of a battery will vary with the application, usage, temperature and depth of discharge. AGM batteries tend to deliver a higher capacity than rated (up to 10-15% higher) unitl they are broken in (approximately 30 cycles) and settle at their rated capacity.

3.1 - TEMPERATURE EFFECTS ON BATTERY PERFORMANCE AND LIFE

Operating batteries above 80°F (27°C) will yield runtimes above the rated capacity while operating batteries below 80°F (27°C) will yield runtimes below the rated capacity. Cold temperatures can significantly reduce battery capacity (as shown in the chart below).

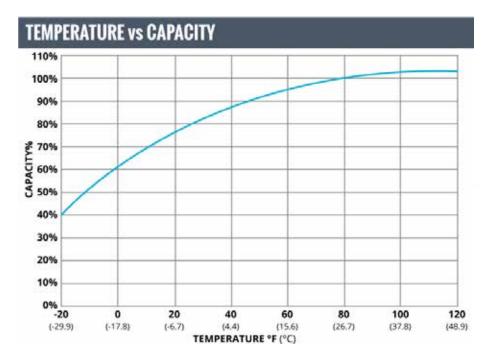

Although higher temperatures increase the battery capacity, they also accelerate corrosion and reduce overall battery life. For example, batteries operating continuously at 100°F (37.8°C), could experience as much as a 25% reduction in life.


3.2 - OPERATING TEMPERATURE RANGE

| Recommended | Maximum |
|-----------------|-----------------|
| 5°F to 104°F | -40°F to 160°F |
| (-15°C to 40°C) | (-40°C to 71°C) |

TABLE 4

3.3 - DEPTH OF DISCHARGE VS. BATTERY LIFE

Battery cycle life will vary significantly depending on the depth of discharge. The deeper the depth of discharge, the fewer the cycles a battery will deliver. Conversely, the shallower the depth of discharge, the more cycles a battery will deliver (as shown in the chart below).

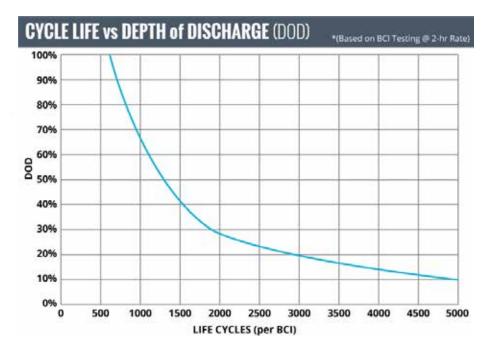



To optimize the health of your battery, limit discharge to 80%.

WWW.FULLRIVERBATTERY.COM PAGE 9

Charging

Using the proper charger is critical to the performance and life of your AGM battery. If you are not sure if you have the right charger for AGM batteries, please call our technical support line at **(800) 522-8191** or email help@fullriverbattery.com for verification.

4.1 - CHARGER INSPECTION

- 1. The charger cable should be insulated and free of breaks or cuts.
- 2. The cable connectors should be clean and properly mated with the battery terminals to ensure a snug connection.
- 3. The charger's AC cord should be free of breaks or cuts and the wall plug should be clean.

4.2 - CHARGING YOUR BATTERIES

- 1. Use an AGM charger or setting whenever available.
- 2. Never use a GEL charger or setting on an AGM battery, as it will undercharge the battery and significantly reduce battery capacity and life.
- Many, but not all, wet battery chargers will work for an AGM battery. Call technical support at (800) 522-8191 or email <u>help@fullriverbattery.com</u> to verify your charger. Be prepared to provide the make and model of your charger.
- 4. Batteries should be fully charged after each use. Opportunity charging can be done, but the batteries should be fully charged at least every other day if they are used daily.
- 5. Charge in a ventilated area, as gasses may be released through the pressure relief valve if the batteries are excessively over-charged.
- 6. If the charger does not have a temperature compensation, above charging at temperatures above 122°F (50°C).

4.3 - CHARGING TEMPERATURE RANGE

| Temp Compensation Recommended | | Maximum | |
|-------------------------------|------------------------------|--------------------------------|--|
| Yes | 5°F to 122°F (-15°C to 50°C) | -40°F to 160°F (-40°C to 71°C) | |
| No | 32°F to 104°F (0°C to 40°C) | 5°F to 122°F (-15°C to 50°C) | |

TABLE 5

4.4 - CHARGING PARAMETERS

Most chargers come pre-set from the factory. If your charger is pre-programmed, use the information below to check if the settings are compatible with AGM batteries. If you have a programmable charger or inverter, use the following information for settings.

4.4.1 - CURRENT

The recommended bulk current is 20% of the 20 Hr. AH capacity or $0.20 \times C20$ (20 Hr. capacity in AH).

Example:

DC115-12 is rated at 115AH @ 20 Hrs. The recommended bulk current is 0.20 x 115 = 23 Amps

The maximum allowable bulk current is 35% of the 20 Hr. AH capacity or $0.35 \times C20$ (20Hr. capacity in AH), unless otherwise stated.

Example:

DC115-12 is rated at 115AH @ 20 Hrs. The recommended bulk current is 0.35 x 115 = 40 Amps

4.4.2 - VOLTAGE SETTINGS

| Charge State | 12 Volt Battery | 24 Volt Battery | 36 Volt Battery | 48 Volt Battery |
|--------------|-----------------|-----------------|-----------------|-----------------|
| Bulk | 14.7 V | 29.4 V | 44.1 V | 58.8 V |
| Absortion | 14.7 V | 29.4 V | 44.1 V | 58.8 V |
| Float | 13.7 V | 27.3 V | 41.0 V | 54.6 V |

TABLE 6

4.4.3 - TEMPERATURE SETTINGS

If you have a programmable charger or inverter that has a temperature compensation setting, it should be set to -4mV / °C / cell or -2mV / °F / cell. **TABLE 7** below has the temperature compensation voltage values for a 12V battery. For a 24V, 36V or 48V system, multiply the values in the table by 2, 3 or 4 respectively.

| Charge Stage | 32°F (0°C) | 50°F (10°C) | 68°F (20°C) | 77°F (25°C) | 86°F (30°C) | 104°F (40°C) |
|--------------|------------|-------------|-------------|-------------|-------------|--------------|
| Bulk | 15.30 V | 15.06 V | 14.82 V | 14.70 V | 14.58 V | 14.34 V |
| Absortion | 15.30 V | 15.06 V | 14.82 V | 14.70 V | 14.58 V | 14.34 V |
| Float | 14.25 V | 14.01 V | 13.77 V | 13.65 V | 13.53 V | 13.29 V |

TABLE 7

Storage

AGM batteries have a much longer shelf life than wet, lead-acid batteries. With a self-discharge of only 1-3% per month, AGM batteries can be stored for a year or longer without needing to be charged.

5.1 - BATTERY STORAGE PROCEDURE

- 1. Charge batteries before they are placed in storage.
- 2. Disconnect batteries from the equipment and charger to eliminate any parasitic loads.
- 3. Check the batteries based on conditions and schedule in **TABLE 8** below.

| Storage Temperature | Storage Time Period |
|-----------------------------|---------------------|
| Below 68°F (20°C) | 9 months |
| 68°F to 86°F (20°C to 30°C) | 6 months |
| Above 86°F (30°C) | 3 months |

TABLE 8

 Check the open circuit voltage (OCV) of each battery in the set. If any battery within the set is less than the values in TABLE 9 below, recharge the battery set.

| Battery Nominal Voltage | Open Circuit Voltage (O.C.V.) |
|-------------------------|-------------------------------|
| 2 Volt | < 2.0 Volts |
| 6 Volt | < 6.2 Volts |
| 8 Volt | < 8.3 Volts |
| 12 Volt | < 12.5 Volts |

TABLE 9


- 5. If the charger has a maintenance mode, select that mode to boost charge batteries. Otherwise, run the normal charge cycle.
- 6. If the batteries are stored shorter than the time periods in **TABLE 8**, they do not need to be recharged prior to being put back into service.



AGM batteries do not have a memory effect; so there is no need to fully discharge batteries prior to charging.

5.2 - TEMPERATURE EFFECTS ON SELF-STORAGE

If the storage environment is hot, batteries will self-discharge faster than in a cold environment as shown in **CHART 3** below.

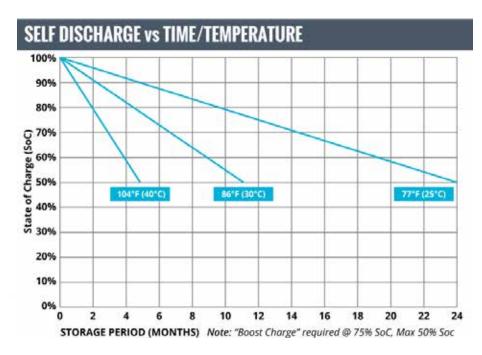



Batteries CAN be safely stored on concrete floors without any negative effects. Concrete floors DO NOT drain batteries.

5.3 - STORAGE TEMPERATURE RANGE

| Recommended | Maximum |
|------------------------------|-------------------------------|
| 5°F to 122°F (-15°C to 50°C) | -40°F to 160°F (40°C to 71°C) |

TABLE 10



Store batteries in a cool, dry environment to minimize self discharge.

Testing

Testing batteries can be complex and there are many application specific variables that cannot be considered in one simple test. This section is a guide to help you determine the overall condition of your batteries. Contact your local Fullriver Battery distributor for assistance.

6.1 - TEST PREPARATION

- 1. Check that the battery cables are in good working condition. Replace any damaged or broken cables.
- 2. Check that all terminal connections are tightened to proper torque specification as described in **TABLE 2**.
- 3. Fully charge batteries.
- 4. Let batteries rest for at least 8 hours once charging is complete.

6.2 - OPEN CIRCUIT VOLTAGE TEST

- 1. Check and record open circuit voltage (O.C.V.) of each battery.
- 2. If all of the batteries are below 6.1V (6V battery), 8.1V (8V battery) or 12.2V (12V battery) the set has failed. Replace the entire set of batteries. In this situation, the battery set had either provided all of its available energy or was severley abused.
- 3. Otherwise, any battery that is 0.25V lower than the highest battery voltage (6V battery), 0.35V lower than the highest battery voltage (8V battery), 0.5V lower than the highest battery voltage (12V battery), might have failed. Make note of these batteries.

All batteries in a good set should be above 6.4V (6V battery), 8.5V (8V battery), and 12.7V (12V battery) when fully charged after at least 8 hours of rest.

6.3 - DISCHARGE TEST (if you do not have a discharger, proceed to section 6.4)

- 1. Connect and start discharger.
- 2. Record minutes (runtime) when discharge is complete. Correct runtime minutes for battery temperature using the following formula:

Mc = Mr [1 - 0.009 (T-27)]

Where Mc is the corrected minutes, Mr is the minutes recorded and T is the temperature at the end of the discharge in °C.

- 3. If the set runs more than 50% of its rated capacity, the batteries are good and the test is complete.
- 4. If the set runs less than 50% of its rated capacity, reconnect the discharger. While under the discharge load, record the end of the discharge voltage for each battery.
- 5. The batteries that are 0.5V lower than the highest end of discharge voltage should be noted.
- 6. If the set delivered less than 50% of its rated capacity, and the same batteries that were noted in STEP 3 of SECTION 6.2 were also the ones noted in STEP 5 of SECTION 6.3, those batteries are most likley failed and should be replaced. Follow the replacement instructions in SECTION 6.5 below.
- Otherwise, please contact your local Fullriver Battery distributor to review your data in detail.. You can also reach technical support by calling (800) 522-8191 or emailing help@fullriverbattery.com. Additional testing may be required depending on your specific application.

6.4 - OPTIONAL TEST

After completing **SECTION 6.1** and **SECTION 6.2**, follow these steps:

- 1. Operate the vehicle/equipment until battery performance decreases.
- 2. Record voltages during and after operation.
- 3. Record time and distance of operation.
- 4. Provide the voltage, time and distance data to a Fullriver Battery distributor or to Fullriver Battery techincal support at **(800) 522-8191** or email **help@fullriverbattery.com**.
- 5. This data will be analyzed in comparison to what is expected of the vehicle/equipment.

6.5 - BATTERY REPLACEMENT INSTRUCTIONS

As long as it is safe to do so, charge the set of batteries before replacing the failed ones to make sure the good batteries are fully charged.

If possible, replace failed batteries with good batteries around the same age from another piece of equipment. Try to avoid mixing new batteries in equipment with old batteries. Put all new batteries in the same piece of equipment.

For battery replacement, follow the installation instructions in **SECTION 2**.

Your Clean-Green Energy Solution

7.1 - FULLRIVER PRODUCTS

Fullriver Battery produces sealed, maintenance-free batteries that are non-hazardous, non-spillable and are made from approximately 80% recycled materials. During normal operation, our batteries will not release any harmful gasses and will not leak any acidic electrolyte into the environment.

Fullriver batteries are classified as safe for air, sea, and ground transportation. They meet all requirements of the International Air Transport Association (I.A.T.A.), the International Civil Aviation Organization (I.C.A.O.), the International Maritime Dangerous Goods (I.M.D.G.), and the Department of Transportation (D.O.T.).

More than 98% of the lead in batteries is recycled - placing lead-acid batteries at the top of the list of most highly recycled consumer products. The recycling loop of a lead-acid battery goes on indefinitely as shown in the **RECYCLING DIAGRAM** on Page 17.

7.2 - FULLRIVER MANUFACTURING

Fullriver Battery manufactures batteries in accordance with international environmental regulations. We continually improve our process in order to minimize waste, recycle all waste that is recyclable and discard waste that is not recyclable in accordance with local disposal regulations. We strictly enforce the use of proper ventilation and protective gear. This enforcement helps minimize employee exposure to lead at a point well below suggested levels.

Your Clean-Green Energy Solution

7.3 - BATTERY RECYCLING



Transportation Information

Fullriver batteries are sealed lead-acid batteries made with Absorbant Glass Mat (AGM) technology. The electrolyte is absored into the fiberglass separator material rather than in a free-flowing liquid form.

Fullriver batteries are non-spillable electric storage batteries. They are exempt from the requirements of DOT's hazardous materials regulations since they adhere to the requirements of code 49 CFR Section 173.159(D), which states:

A non-spillable, wet, electric storage battery is exempt from all other requirements of this subchapter under the following conditions:

- The battery must be protected against short circuits and securely packaged
- The battery and outer packaging must be plainly and durably marked "NON-SPILLABLE" or "NON-SPILLABLE BATTERY"
- The battery must be capable of withstanding the Vibration and Pressure
 Differential test specified in 49 CFR 173.159(d)(3)(i) and 49 CFR 173.159(d)(3)(ii);
- At a temperature of 131°F (55°C), the battery must not contain an unabsorbed, free-flowing liquid, and must be designed so that electrolyte will not flow from a ruptured or cracked case.

Fullriver batteries are protected against short circuits and are securely packaged. Both the batteries and the outer packaging are clearly marked "NON-SPILLABLE". Fullriver batteries were tested by a third party lab and determinded to be in compliance with DOT regulations as stated in code 49 CFR Section 173.159(D).

Since Fullriver batteries meet all the requirements, they are considered non-hazardous and therefore do not require a UN number or additional DOT hazardous material labeling.

This notice is to clarify to shippers and transporters that our batteries are packaged and marked in accordance to 49 CFR 173.159(D) and are determined to be in compliance with DOT HMR49 Non-Hazardous Materials, and the Internaitonal Air Transportation Association (IATA), Special Provisions S.P. A67 & A48.

Therefore, Fullriver batteries are not restriced for shipment by air or any other mans of transporation and are exempt from the hazardous material category.

A.1 - TEMPERATURE RANGES

| Condition Recommended | | Maximum |
|-----------------------|------------------------------|--------------------------------|
| Storage | 5°F to 122°F (-15°C to 50°C) | -40°F to 160°F (-40°C to 71°C) |
| Operation | 5°F to 104°F (-15°C to 40°C) | -40°F to 160°F (-40°C to 71°C) |
| Charge with TC | 5°F to 122°F (-15°C to 50°C) | -40°F to 160°F (-40°C to 71°C) |
| Charge w/o TC | 32°F to 104°F (0°C to 40°C) | 5°F to 122°F (-15°C to 50°C) |

A.2 - STATE OF CHARGE (S.O.C) VS. OPEN CIRCUIT VOLTAGE (O.C.V.)

| State of Charge (S.O.C.) | Open Circuit Voltage (O.C.V.) | | | |
|-----------------------------|-------------------------------|------|------|-------|
| | 2V | 6V | 8V | 12V |
| 100 | 2.14 | 6.42 | 8.56 | 12.83 |
| 90 | 2.12 | 6.36 | 8.48 | 12.72 |
| 80 | 2.10 | 6.30 | 8.40 | 12.60 |
| 70 | 2.08 | 6.24 | 8.32 | 12.47 |
| 60 | 2.06 | 6.17 | 8.23 | 12.34 |
| 50 | 2.03 | 6.10 | 8.14 | 12.20 |
| 40 | 2.01 | 6.03 | 8.04 | 12.06 |
| 30 | 1.99 | 5.96 | 7.94 | 11.91 |
| 20 | 1.96 | 5.88 | 7.84 | 11.76 |
| 10 | 1.94 | 5.81 | 7.74 | 11.61 |

At 80°F (27°C)

fullriverbattery.com

4030 Adolfo Road Camarillo, CA 93012

Toll Free: (800) 522-8191 Int'l: (805) 484-7900

