



# **GKM C4000**

#### Combination Cold Potable Water Meters

Combining two outstanding GKM metering technologies in one extremely compact unit, the GKM C4000's innovative in-line design delivers highly accurate bulk flow metering for application with large variations in flow rate helping to ensure optimum revenue collection.

### **FEATURES**

- Two indutive registers for improved output performance and security
- High turndown ratio
- Highly accurate bulk flow metering for application with large variations in flow rate
- Designed to maximise revenue collection
- Compact, in-line construction for easy installation
- Available in sizes from 50mm to 100mm
- Longer wear life for optimum accuracy

Available in a range of three sizes and suitable for flow rates up to 125m3/h the C4000 features an innovative in-line design which delivers significant benefits, not only at installation but throughout its working lifetime. Offering the benefits of inductive register technology and combining the performance of both the H4000 and V220 range of meters, the C4000 measuring range ensures maximum revenue collection. The C4000 complies with all relevant international quality standards.

### Compact, cost-effective, dependale


With a compact in-line design that simplifies the specification process by eliminating the need to differentiate between left or right-handed by-pass meters, the C4000 also features an easy-change metering insert, carrying both primary and secondary metering module. this can be removed as a complete assembly, significantly reducing the time required for calibration, maintenance or replacemen. As with all Elster meters, the product is designed and manufactured to rigorous quality standards for trouble-free operation - whatever its working environment. The C4000's superb design offers many features which increase its life cycle and reduce costs, including wear-resistant jewelled rotor bearing, tungsten carbide thrust pads and stub spindles with factory-potted moisture resistant electrical connections.

# **Enhanced communication and security**

Using an inductive register to deliver enhanced communication performance and tamper-proof security, the C4000 provides effective protection against fraud. Compatible with Emeris PR6 and PR7 inductive pulse transmitters, the product features both high- and low- speed bi-directional pulse capabilities as standard, and is fully compatible with other common ancillary devices including data logger and AMR systems.

### In-line strainer


The use of GKM H4000 strainer is recommended to protect the rotor and help reduce the effect of turbulence.  $\frac{1}{2} \left( \frac{1}{2} \right) = \frac{1}{2} \left( \frac{1}{2} \right) \left( \frac{1}{2} \right)$ 

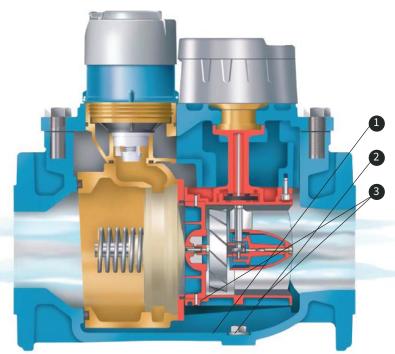

Low mass rotor with hydrodynamic thrust relief

Maximum length flow straightening vanes

Hard surface rotor bearings - tungsten carbide and synthetic sapphire



# **C&I inductive register**

Inductive target for bi-directional pulse communications

Start tell-tale for easy-to-see flow detection

Easy to read-display – 6-figure display for sizes 50mm to 100mm


# **Product Specification**

Size of Meter         DN50         DN80         DN100           Minimum Flowrate $Q_1 \pm 596$ m³/h         0.025         0.025         0.025           Transitional Flowrate $Q_2 \pm 296$ m³/h         0.040         0.040         0.040           Permanent Flowrate $Q_3 \pm 296$ m³/h         25         63         100           Overload Flowrate $Q_4 \pm 296$ m³/h         31.25         78.75         125           Measuring Range (R) $Q_3/Q_1$ 1000         2500         4000           Changeover Flowrate $Q_{x1}$ m³/h         0.8 - 1.4         1.1 - 1.9         1.1 - 2.0           Changeover Flowrate $Q_{x1}$ m³/h         1.6 - 2.0         2.1 - 3.0         2.1 - 3.0           Max Admissible Pressure         bar         16         16         16         16           Pressure Loss Class ΔP         m³         0.63         0.63         0.63           Indicating Range         m³         999 999         999 999         999 999           (Larger Meter)         m³         0.0005         0.0005         0.0005           Indicating Range         m³         0.00002         0.00002						
Transitional Flowrate $Q_2 \pm 2\%$ m³/h 0.040 0.040 0.040 0.040 Permanent Flowrate $Q_3 \pm 2\%$ m³/h 25 63 100 Overload Flowrate $Q_4 \pm 2\%$ m³/h 31.25 78.75 125 Measuring Range (R) $Q_3$ /Q <sub>1</sub> 1000 2500 4000 Changeover Flowrate $Q_4$ m³/h 0.8 · 1.4 1.1 · 1.9 1.1 · 2.0 Changeover Flowrate $Q_4$ m³/h 1.6 · 2.0 2.1 · 3.0 2.1 · 3.0 Max Admissible Pressure bar 16 16 16 16 Pressure Loss Class ΔP m³ 0.63 0.63 0.63 0.63 Indicating Range (Larger Meter) m³ 0.0005 0.0005 0.0005 Interval (Larger Meter)	Size of Meter			DN50	DN80	DN100
Permanent Flowrate $Q_3 \pm 2\%$ m³/h         25         63         100           Overload Flowrate $Q_4 \pm 2\%$ m³/h         31.25         78.75         125           Measuring Range (R) $Q_3/Q_1$ 1000         2500         4000           Changeover Flowrate $Q_{x1}$ m³/h         0.8 - 1.4         1.1 - 1.9         1.1 - 2.0           Changeover Flowrate $Q_{x2}$ m³/h         1.6 - 2.0         2.1 - 3.0         2.1 - 3.0           Max Admissible Pressure         bar         16         16         16           Pressure Loss Class ΔP         m³         0.63         0.63         0.63           Indicating Range         m³         999 999         999 999         999 999         999 999           (Larger Meter)         m³         0.0005         0.0005         0.0005           Indicating Range         m³         0.0005         0.0005         0.0005           Indicating Range         m³         99 999         99 999         99 999         99 999           (Smaller by-pass Meter)         m³         0.00002         0.00002         0.00002         0.00002	Minimum Flowrate	Q <sub>1</sub> ± 5%	m³/h	0.025	0.025	0.025
Overload Flowrate $Q_4 \pm 2\%$ $m^3/h$ $31.25$ $78.75$ $125$ Measuring Range (R) $Q_3/Q_1$ $1000$ $2500$ $4000$ Changeover Flowrate $Q_{x1}$ $m^3/h$ $0.8 - 1.4$ $1.1 - 1.9$ $1.1 - 2.0$ Changeover Flowrate $Q_{x2}$ $m^3/h$ $1.6 - 2.0$ $2.1 - 3.0$ $2.1 - 3.0$ Max Admissible Pressure         bar $16$ $16$ $16$ Pressure Loss Class $\Delta P$ $m^3$ $0.63$ $0.63$ $0.63$ Indicating Range (Larger Meter) $m^3$ $0.0005$ $0.0005$ $0.0005$ Verification Scale Interval (Larger Meter) $m^3$ $0.0005$ $0.0005$ $0.0005$ Verification Scale Interval (Smaller by-pass Meter) $m^3$ $0.00002$ $0.00002$ $0.00002$	Transitional Flowrate	$Q_2 \pm 2\%$	m³/h	0.040	0.040	0.040
Measuring Range (R) $Q_3/Q_1$ 1000       2500       4000         Changeover Flowrate $Q_{x1}$ $m^3/h$ $0.8 - 1.4$	Permanent Flowrate	Q <sub>3</sub> ± 2%	m³/h	25	63	100
Changeover Flowrate $Q_{x1}$ $m^3/h$ $0.8 - 1.4$ $1.1 - 1.9$ $1.1 - 2.0$ Changeover Flowrate $Q_{x2}$ $m^3/h$ $1.6 - 2.0$ $2.1 - 3.0$ $2.1 - 3.0$ Max Admissible Pressure       bar $16$ $16$ $16$ Pressure Loss Class ΔP $m^3$ $0.63$ $0.63$ $0.63$ Indicating Range $m^3$ $999 999$ $999 999$ $999 999$ (Larger Meter) $m^3$ $0.0005$ $0.0005$ $0.0005$ Indicating Range $m^3$ $99999$ $99999$ $999999$ $999999999$ (Smaller by-pass Meter) $m^3$ $0.00002$ $0.00002$ $0.00002$	Overload Flowrate	$Q_4 \pm 2\%$	m³/h	31.25	78.75	125
Changeover Flowrate         Q <sub>x2</sub> m³/h         1.6-2.0         2.1 - 3.0         2.1 - 3.0           Max Admissible Pressure         bar         16         16         16           Pressure Loss Class ΔP         m³         0.63         0.63         0.63           Indicating Range (Larger Meter)         m³         999 999         999 999         999 999           Verification Scale Interval (Larger Meter)         m³         0.0005         0.0005         0.0005           Indicating Range (Smaller by-pass Meter)         m³         99 999         99 999         99 999           Verification Scale Interval (Smaller by-pass Meter)         m³         0.00002         0.00002         0.00002	Measuring Range (R)	$Q_3/Q_1$		1000	2500	4000
Max Admissible Pressure bar 16 16 16  Pressure Loss Class ΔP m³ 0.63 0.63 0.63  Indicating Range m³ 999 999 999 999 999 999 999 999 999	Changeover Flowrate	$Q_{x1}$	m³/h	0.8 - 1.4	1.1 - 1.9	1.1 - 2.0
Pressure Loss Class ΔP m³ 0.63 0.63 0.63  Indicating Range (Larger Meter) m³ 0.0005  Verification Scale Interval (Larger Meter) m³ 0.0005  Indicating Range (Smaller by-pass Meter) m³ 0.00002  Verification Scale Interval (Smaller by-pass Meter) m³ 0.00002	Changeover Flowrate	$Q_{x2}$	m³/h	1.6-2.0	2.1 - 3.0	2.1 - 3.0
Indicating Range (Larger Meter)  Verification Scale Interval (Larger Meter)  Indicating Range (Smaller by-pass Meter)  Indicating Range (Smaller by-pass Meter)  m³  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005	Max Admissible Pressure		bar	16	16	16
(Larger Meter)  Verification Scale Interval (Larger Meter)  Indicating Range (Smaller by-pass Meter)  May 10.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.0005  0.00005  0.00005  0.00005  0.00005  0.00005  0.00005  0.00002	Pressure Loss Class ΔP		m³	0.63	0.63	0.63
(Larger Meter)       Verification Scale     m³     0.0005     0.0005     0.0005       Interval (Larger Meter)     99 999     99 999     99 999       Indicating Range     99 999     99 999     99 999       (Smaller by-pass Meter)     m³     0.00002     0.00002       (Smaller by-pass Meter)	Indicating Range		m <sup>3</sup>	000 000	000 000	000 000
Interval (Larger Meter)  Indicating Range (Smaller by-pass Meter)  Verification Scale Interval (Smaller by-pass Meter)  m³  0.0005	(Larger Meter)		111	999 999	999 999	999 999
Indicating Range (Smaller by-pass Meter)  Verification Scale Interval (Smaller by-pass Meter)  m³  0.00002  0.00002	Verification Scale		m <sup>3</sup>	0.0005	0.0005	0.0005
(Smaller by-pass Meter)  Verification Scale Interval (Smaller by-pass Meter)  m³  0.00002  0.00002	Interval (Larger Meter)		***	0.0003	0.0003	0.0003
(Smaller by-pass Meter) m³  Verification Scale Interval (Smaller by-pass Meter) m³ 0.00002 0.00002 (Smaller by-pass Meter)	Indicating Range			99 999	99 999	99 999
m <sup>3</sup> 0.00002 0.00002 0.00002 (Smaller by-pass Meter)	(Smaller by-pass Meter)		m³	33 333	33 333	33 333
(Smaller by-pass Meter)	Verification Scale Interval		m3	0.00002	0.00002	0.00002
har From 0.3 to 16	(Smaller by-pass Meter)		m	0.00002	0.00002	0.00002
Working pressure range	Working pressure range		bar	From 0.3 to 16		
Orientation requirements all positions but not head down	Orientation requirements			all positions but not head down		

<sup>\*</sup>It is highly recommended to install GKM H4000 Strainer before the bulk water meter to protect the meter. The strainer functions as a filter to prevent solid objects in the pipe from damaging the meter.


### **Dimension**

Size of Meter	DN50	DN80	DN100	
Overall length (A)	300	350	350	
Height (B)	80	104	115	
Diameter (C)	166	201	228	
Height (D)	225	245	255	
Height with lid open (E)	291	316	321	
Width (F)	105	125	140	
Width (G)	100	125	140	
Mechanism removal (H)	400	475	500	
Weight (kg)	25	35	40	

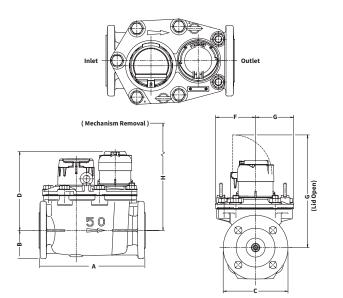

Accuracy Curve and Pulse Connectivity shown overleaf.

### **Typical Accuracy Curve**

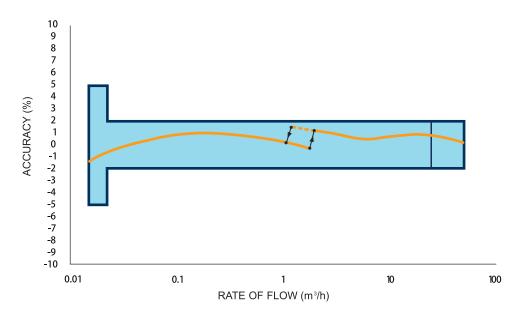

# PR7 designed for the H4000 range of bulk meter Pulse Connectivity

Calculating Pulse Weights when fitted with PR7 inductive pulser

Pulse Weight is calculated by multiplying the Register 'Pulse Factor' (P) by the PR7 'K-Factor' (K) Pulse Weight (Liters per Pulse) =  $P \times K$ 

		K-Factor			
Size	Pulse Factor	K1	K10	K100	K1000
50mm	P:1	1 ltr	10 ltr	100 ltr	1,000 ltr
80mm	P:1	1 ltr	10 ltr	100 ltr	1,000 ltr
100mm	P:1	1 ltr	10 ltr	100 ltr	1,000 ltr

PR7 is an open collector pulse transmitter suitable for data logging, AMR and telemetry equipment. Check with your equipment supplier for full details of compatibility. The PR7 with a K factor of 1 should be used with advanced data loggers, those capable of accepting a 5ms width pulse. Other outputs (K<>1) have a variable pulse width. These can be used with any data lodger.




- 1 On this example 50mm C4000 register, the user can identify from the dial plate both the:
  - -Type of pulser to use ie PR7
  - -Pulse factor ie P:1

# PR6 Designed for the V200 range of volumetric meters

Meter pulse factor	Pulse type	K-Factor	Primary output pulse weight litres/ pulse	Secondary output pulse weight litres/ pulse
PR6P:1	PR6	1:1	1	1
PR6P:10	PR6	1:1	10	10

The C4000 needs a PR6 for the V220 volumetric meter and a PR7 for the Woltmann meter.



- ① On the PR7 unit the user can identify from the label the K-Factors for each output channel
- 2 Primary Output K-Factors
- Secondary Output K-Factors

Pressure equipment directive 97/23/EC. This product is applicable in network for the supply, distribution and discharge of water and associated equipment and is therefore exempt.

Note: Specifications are subject to change without notice.

### **Water Meter Accessories**







